

**STORMWATER POLLUTION  
PREVENTION PLAN  
for  
CONSTRUCTION ACTIVITIES  
at**

**WILSON HILL SOLAR, LLC  
TOWN OF HOOSICK, NY**

**Prepared for**

**WILSON HILL SOLAR, LLC, A SUBSIDIARY OF NEXAMP, INC.  
101 SUMMER STREET, 2<sup>ND</sup> FLOOR  
BOSTON NY, 02110**

**Prepared by  
The Environmental Design Partnership, LLP  
900 Route 146  
Clifton Park, NY 12065  
Telephone: (518) 371-7621  
Facsimile: (518) 371-9540**

**FEBRUARY 2024**

**NOI Permittee: WILSON HILL SOLAR, LLC  
WILSON HILL SOLAR**

# Table of Contents

## **Section 1:**

### **Written Stormwater Pollution Prevention Plan**

- I. Scope
- II. Site Description
- III. Controls
- IV. Compliance with Federal, State, and Local Regulations
- V. Maintenance/Inspection Procedures During Construction
- VI. Long Term Operation and Maintenance Procedures
- VII. Spill Prevention Control and Countermeasures (SPCC) Plan
- VIII. Control of Allowable Non-Stormwater Discharges
- IX. Certification and Notification

## **Section 2:**

### **Plan Set**

### **Site Map and General Location Map**

## **Section 3:**

### **NYS Department of Environmental Conservation Notice of Intent (NOI)**

### **NYS Department of Environmental Conservation NOI Acknowledgement Letter**

### **NYS Department of Environmental Conservation Deep-Ripping and Decompaction**

## **Section 4:**

### **NYS Department of Environmental Conservation SPDES General Permit**

## **Section 5:**

### **NOI Permittee's Certification (Form 1)**

### **Contractor's/Subcontractor's Certification Log (Form 2)**

### **Contractor's Certification for each contractor listed on Form 2 (Form 3)**

### **Inspection Report (Form 4)**

### **Modification Report (Form 5)**

### **Record of Stabilization and Construction Activities Report (Form 6)**

### **Record of Temporary Erosion and Sediment Control Practices (Form 6A)**

### **Project Rainfall Log (Form 7)**

### **Final Stabilization/Termination Checklist (Form 8)**

## **Section 6:**

### **Supplemental Information**

- Stormwater Management Report
- FEMA Flood Mapping
- NYSDEC ERM Mapper
- SHPO Letter of No Effect
- Soils Report (USDA)
- USFW IPAC Results

## **Section 7:**

### **Completed Inspection Reports**

## **SECTION 1**

# **Written Stormwater Pollution Prevention Plan**

**WILSON HILL SOLAR, LLC**

---

I. SCOPE

- A. **PURPOSE:** WILSON HILL SOLAR, LLC intends to implement the appropriate Stormwater Pollution Prevention Plan measures in accordance with the SPDES general permit governing stormwater discharges during construction, and in accordance with erosion control practices. This section provides a descriptive explanation of the means by which WILSON HILL SOLAR, LLC will comply with the National Stormwater Pollution Prevention Program.
- B. **NPDES GENERAL PERMITS FOR STORMWATER DISCHARGE FROM CONSTRUCTION SITES:** Regulations promulgated by the New York State Department of Environmental Conservation (NYSDEC) regulate the discharge of storm water from construction activities on sites where one (1) or more acres of soil is disturbed. One of the ways to comply with these regulations for affected sites is to request coverage under the General Permit for Construction Activities. (Copy enclosed herewith) In order to be authorized to discharge under the General Permit, a Stormwater Pollution Prevention Plan (SWPPP) for the site must be prepared in accordance with all applicable requirements of this permit and followed during the construction activities. If the construction activity is **not** subject to the requirements of a regulated, traditional land use control MS4 a Notice of Intent (NOI) form must be completed and received by the New York State Department of Environmental Conservation at least 5-days prior to any earth-disturbing activities. If the construction activity is subject to the requirements of a regulated, traditional land use control MS4, then the owner/operator must have its SWPPP reviewed and accepted by the MS4 prior to submitting the NOI to the Department. The owner/operator shall have the “MS4 SWPPP Acceptance” form signed and then submit that form along with the NOI to the Department.
- C. **RESPONSIBILITIES OF CONTRACTOR REGARDING THE GENERAL PERMIT:** The CONTRACTOR shall manage the discharge of stormwater from the site in accordance with the SPDES General Permit for Construction Activities conditions and the following provisions of this section of the specifications. The CONTRACTOR shall be responsible for conducting the stormwater management practices in accordance with the permit. The CONTRACTOR shall be responsible for providing qualified inspectors to conduct the inspections required by the SWPPP. The CONTRACTOR shall be responsible for any enforcement action taken or imposed by federal, state, or local agencies, including the cost of fines, construction delays, and remedial actions resulting from the CONTRACTOR’S failure to comply with the permit provisions. It shall be the responsibility of the CONTRACTOR to make any changes to the SWPPP necessary when the CONTRACTOR or any of his subcontractors elects to use borrow or fill or material storage sites, either contiguous to or remote from the construction site, when such sites are used solely for this construction site. Such sites are considered to be part of the construction site covered by the permit and this SWPPP. Off-site borrow, fill, or material storage sites which are used for multiple construction projects are not subject to this requirement, unless specifically required by state or local jurisdictional entity regulations. The CONTRACTOR should consider this requirement in negotiating with earthwork subcontractors, since the choice of an off-site borrow, fill, or material storage site may impact their duty to implement, make changes to, and perform inspections required by the SWPPP for the site.
- D. **NOTICE OF INTENT:** The NOI Permittee petitions the New York State Department of Environmental Conservation for the stormwater discharges during construction at this site to be covered by the SPDES General Permit for Construction Activity for the State of New York. A Notice of Intent (NOI) (using the form required by the NYSDEC) to be covered under this permit is hereby filed. An Erosion and Sediment Control Plan has been prepared and is attached herewith.
- E. **CONTRACTOR RESPONSIBILITIES:** The SWPPP and associated Erosion and Sediment Control Plans represent the **MINIMUM** erosion and sediment control measures that will be required to protect the site during construction. WILSON HILL SOLAR, LLC and the CONTRACTOR understand that additional erosion and sediment control measures will be necessary during construction. It will be the responsibility of the CONTRACTOR to implement additional erosion and sediment control measures as necessary to protect the site

during construction. WILSON HILL SOLAR, LLC and the CONTRACTOR shall designate a Project Manager prior to commencing construction. The Project Manager will ensure that all construction managers and sub-contractors are appropriately assigned and understand the importance of the following topics:

- Erosion and Sedimentation Control for Water Quality Protection
- Implementation of the Erosion and Sedimentation Control Plan
- The Importance to Proper Installation of Erosion and Sedimentation Control Measures
- Regular Inspection by qualified personnel of Erosion and Sedimentation Control Measures
- Diligent Maintenance of Erosion and Sedimentation Control Measures
- Contemporaneous preparation of accurate and complete records regarding inspection and maintenance of Erosion and Sedimentation Control Measures
- Record Keeping for Inspections and Maintenance activities

F. **REQUIREMENTS FOR THE CONTRACTOR AND SUBCONTRACTOR(S):** The *SWPPP Ledger* shall provide a “Contractor’s Certification Log” (**Form 2**), identifying the Company Name, Business Address and Telephone Number along with the Responsible Person for the CONTRACTOR and all subcontractors’ who will implement the measures identified in the SWPPP. Each of the entities identified on **Form 2** shall sign a “Contractor’s Certification” (**Form 3**), verifying they have been instructed and fully understand the requirements of the New York State Department of Environmental Conservation and SWPPP. **This certification must be signed, by a fully qualified individual on behalf of each entity, prior to the beginning of any construction activities and shall be filed in the project’s SWPPP Ledger.**

Additionally, the “Trained Contractor” must be identified on Form 3 and his/her credentials should be kept on-site in the SWPPP ledger.

G. **STORMWATER POLLUTION PREVENTION PROGRAM LOCATION REQUIREMENTS:** The *SWPPP Ledger* is meant to be a working document that shall be maintained at the site of the Construction Activities at all times throughout the project, shall be readily available upon request by the NOI Permittee’s personnel or New York State Department of Environmental Conservation or any other agency with regulatory authority over stormwater issues, and shall be kept on-site until the site complies with the Final Stabilization section of this document. Refer to Part VII., F., Duty to Provide Information, of the General Permit for additional public viewing requirements.

H. **SWPPP LEDGER:** The SWPPP Ledger shall be a 3-ring Binder, tabbed and indexed for the following sections:

**SECTION 1:**

- **Written SWPPP**

**SECTION 2:**

- **Site Map and General Location Map**
- **Erosion and Sediment Control Plan(s)**
- **Phasing Plan**
- **NYSDEC Deep-Ripping and Decompaction April 2008**

**SECTION 3:**

- **New York State Notice of Intent**
- **New York State NOI Acknowledgement Letter**

**SECTION 4:**

- **New York State SPDES General Permit**

**SECTION 5:**

- **NOI Permittee’s Certification (Form 1)**

- **Contractor's/Subcontractor's Certification Log (Form 2)**
- **Contractor's Certification for each contractor listed on Form 2 (Form 3)**
- **Inspection Report (Form 4)**
- **Modification Report (Form 5)**
- **Record of Stabilization and Construction Activities Report (Form 6)**
- **Record of Temporary Erosion and Sediment Control Practices (Form 6A)**
- **Project Rainfall Log (Form 7)**
- **Final Stabilization/Termination Checklist (Form 8)**

**SECTION 6:**

- **Supplemental Information**
  - Stormwater Management Report
  - FEMA Flood Mapping
  - NYSDEC ERM Mapper
  - SHPO Letter of No Effect
  - Soils Report (USDA)
  - USFW IPAC Results

**SECTION 7:**

- **Completed Inspection Forms**

The Project Manager must review and evaluate for compliance the *SWPPP Ledger* at each Project Review meeting. All Inspection and Maintenance Forms (*Forms 4 - 7*) will be initialed by the Project Manager at each reporting interval.

- I. **INSPECTIONS AND RECORD KEEPING:** Inspections are required at least weekly by a “Qualified Inspector”. Sites that have a waiver to disturb greater than five (5) acres require two (2) inspections every seven (7) days with at least two (2) days between inspections. Inspections shall continue until the site complies with the “Final Stabilization” section of this document and a Notice of Termination (NOT) has been filed with the NYSDEC. Each inspection must be followed up by a report documenting the inspector’s findings and request the required maintenance and/or repair for the erosion and sedimentation control measures. The inspector shall notify the Project Manager within one day of the inspection of any deficiencies. Within one day of this notification the Project Manager must commence with corrective measures. It is imperative that the Project Manager documents the Inspection and Maintenance of all erosion and sedimentation control measures as soon as possible after the inspection and/or maintenance is completed. These records are used to prove that the required inspection and maintenance were performed and shall be placed in the *SWPPP Ledger*. In addition to inspection and maintenance reports, records should be kept of the Construction Activities that occur on the site. The Project Sponsor shall retain copies of the SWPPP, all reports and data for a minimum of five (5) years after the project is complete. The following list identifies the **required** Inspection and Maintenance documentation that must be maintained by the Project Manager under this SWPPP.

- **Form 4            Inspection Report for SWPPP**
- **Form 5            Requested Changes to the SWPPP (Modification Report)**
- **Form 6            Record of Stabilization and Construction Activities**
- **Form 6A          Record of Temporary Erosion and Sediment Control Practices**
- **Form 7            Project Rainfall Log**

- J. **SWPPP MODIFICATIONS:** The inspection report should also identify if any revisions to the SWPPP are warranted due to unexpected conditions. The SWPPP is meant to be a dynamic working guide that is to be kept current and amended whenever the design, construction, operation, or maintenance of the site changes in a way which significantly affects the potential for the discharge of pollutants or when the plan proves to be ineffective in eliminating or significantly minimizing pollutant discharges. Any such changes to the SWPPP must be made in writing on the Modification Report Form (**Form 5**) within 7 days of the date such modification or amendment is made. The CONTRACTOR’S failure to monitor or report deficiencies to the NOI Permittee will

result in the CONTRACTOR being liable for fines and construction delays resulting from any federal, state, or local agency enforcement action.

- K. **FINAL STABILIZATION AND TERMINATION OF PERMIT COVERAGE:** The site will be considered finally stabilized when all soil disturbing activities have been completed and a uniform perennial vegetative cover for the unpaved areas and areas not covered by permanent structures has been established or equivalent permanent stabilization measures have been established and the development area no longer discharges stormwater associated with construction activities and a Notice of Termination (NOT) form filed by the NOI Permittee with the New York State Department of Environmental Conservation. This filing terminates coverage under the General Permit and terminates the CONTRACTOR'S responsibility to implement the SWPPP. Requirements of the SWPPP, including periodic inspections, must be continued until the NOT is filed.

## **II. SITE DESCRIPTION**

---

### A. PROJECT NAME AND LOCATION

The Wilson Hill Solar, LLC project site is geographically situated at Latitude N 42° 54' 10.9", Longitude W 73° 22' 50.7" in the Town of WILSON HILL SOLAR, RENSSELAER COUNTY, NEW YORK. The site is located on the north side of WILSON HILL ROAD, east of the intersection with FOG HILL ROAD. The project site is comprised of 99.52 +/- acres of land. The overall disturbance area is ±27.1 acres. The project is bounded on the north, east, and west by PRIVATE RURAL PROPERTY and on the south by WILSON HILL ROAD. Access to the project will be from WILSON HILL ROAD. The entire parcel will remain privately owned and maintained. Approximately ±7.95 acres of impervious surfaces, including travel surfaces and buildings will be constructed. Reclamation of disturbed areas will be conducted on an ongoing basis as construction progresses. On-going reclamation during construction will consist of all activities listed in Section 1.III.A.1 for temporary actions. Permanent reclamation activities for the laydown area and temporary access road outside of the solar array shall follow the NYSDEC Deep-Ripping and Decompaction April 2008 guidance. Final stabilization is defined as the completion of all soil disturbance activities with the phase area having perennial vegetative cover with a density of eighty (80) percent, or other equivalent stabilization measures such as permanent landscape mulches, rock rip-rap or washed/crushed stone.

### B. NOI PERMITTEE'S NAME AND ADDRESS

**WILSON HILL SOLAR, LLC  
101 SUMMER STREET, 2<sup>nd</sup> FLOOR  
BOSTON, MA 02110**

### C. PROJECT DESCRIPTION

The project will involve the installation of 585 W solar modules installed on a ground mounted racking system. The modules will be wired in series strings and connected in parallel to the inverters, which convert the photovoltaic output power from DC to AC. The solar electric system will be interconnected with the existing site electrical system in accordance with the applicable electrical code and National Grid requirements, and as approved by the Town of Hoosick. Also included, as a permanent element of the development is on-site stormwater management. The estimated time for completion of the construction project is approximately one (1) year.

The proposed project will consist of the following key components:

- Solar modules
- Power inverter enclosures
- Power transformers

- Underground electrical conduits
- Operations and Maintenance (O&M)
- Building supervisory control and data acquisition (SCADA) system
- Overhead interconnection electrical line
- Access and maintenance roads

D. RUNOFF COEFFICIENT, SOILS, AND RAINFALL INFORMATION

The predevelopment Curve Number (CN) for green areas was determined to be 71 (HSG C) or 78 (HSG D). Soils within the project area consist of silty loams that fall in the hydrologic soil group C or D, as described by the Soil Conservation Service. The post development CN for disturbed green areas outside of the fenced array is 71 (HSG C) or 78 (HSG D), and for inside of the array the CN for the disturbed areas is 80 (HSG D), and the weighted CN for the post-development contributing area is 79. A CN of 98 was used for all post-development impervious surface areas.

The site is in Rensselaer County, which receives an average of 42 inches of rainfall annually with the highest amounts of rainfall received in the months of June and July.

E. NAME OF RECEIVING WATERS

Drainage will be direct to open, vegetated swales along the proposed access roads to a series of stormwater management or stormwater diversion areas (bioretention area, ponds), with emergency overflows directed to the minor tributary of middle Hoosic River to the east.

F. INDIAN COUNTRY LANDS

The site is not located on any known current or previously designated Indian Country lands.

G. ENDANGERED OR THREATENED SPECIES

A review of the New York State Department of Environmental Conservation's (NYSDEC) Environmental Resource Mapper (<http://www.dec.ny.gov/imsmaps/ERM/viewer.htm>) indicated no known State regulated rare plants, rare animals or significant natural communities on-site. A letter has been directed to NYSDEC New York Natural Heritage Program requesting they provide us with a determination as to whether the proposed activity is likely to result in the take or taking of any species listed as endangered or threatened in 6 NYCRR Part 182.

H. HISTORIC PLACES

A review of the New York State Historic Preservation Office (OPRHP) Geographic Information System Mapper (<http://www.oprhp.state.ny.us/nr/main.asp>) indicated that the site is not located in an archeo sensitive area. A letter has been received from the OPRHP Historic Preservation Field Services Bureau stating that the project is likely to have no impact. This letter is included within Section 6 of the SWPPP.

### III. CONTROLS

---

A. EROSION AND SEDIMENT CONTROLS

The following section describes the anticipated Erosion and Sediment Controls required for use during construction of the proposed site. These controls represent the **MINIMUM** erosion and sediment control measures that will be required to protect the site during construction. **Additional erosion and sediment control measures will be necessary during construction.** It will be the responsibility of the NOI permittee to



authorize the CONTRACTOR to implement all additional erosion and sediment control measures necessary to protect the site during construction.

1. Stabilization practices include (but not limited to):
  - a) Land clearing activities shall be done only in areas where earthwork will be performed and shall progress as earthwork is needed
  - b) Frequent watering of excavation and fill areas to minimize wind erosion during construction.
  - c) Use of stabilization fabric for all slopes having a slope of 1V:3H or greater.
  - d) Seeding and planting of all unpaved areas
    - Temporary seedings should be made within 24 hours of construction or disturbance. If not, the soil must be scarified prior to seeding.
    - Broadcasting or hydroseeding may be used as seeding methods.
    - Seeding mixtures should be as follows
      - a) Ryegrass (annual or perennial) applied at 30 lbs. per acre (0.7 lbs./1000 sq. ft.)
      - b) Certified "Aroostook" winter rye (cereal rye) applied at 100 lbs. per acre (2.5 lbs./1000 sq. ft.) \*Winter rye shall be used if seeding in October/November.
  - e) Soil Restoration
    - For heavy construction staging areas outside of the solar array and the temporary road, follow the NYSDEC Deep Ripping and Decompaction April 2008 guidance.
    - Scarify all compact, slowly permeable, medium and fine textured subsoil areas. Scarify at approximately right angles to the slope direction in soil areas that are steeper than 5 percent.
    - Remove refuse, woody plant parts, stones over 3 inches in diameter, and other liter.
    - Topsoil material shall have at least 2 percent by weight of fine textured stable organic material, and no greater than 6 percent.
    - Topsoil shall have no less than 20 percent fine textured material (passing the No. 200 sieve) and not more than 15 percent clay.
    - Topsoil shall not be placed when it is partly frozen, muddy, or on frozen slopes or over ice, snow, or standing water.
  - f) Mulching
    - In areas where soil disturbance activity has temporarily or permanently ceased, the application of soil stabilization measures must be initiated by the end of the next business day and completed within seven (7) days from the date the current soil disturbance activity ceased.
    - For grass / legume establishment apply straw mulch applied at 2 ton/acre (90 lbs./1000 sq. ft.) and anchor with wood fiber mulch (hydromulch) at 500-750 lbs./acre (11 – 17 lbs./1000 sq. ft.)
  - g) Protecting Vegetation During Construction
    - Limit soil placement over existing tree and shrub roots to a maximum of 3 inches.
    - Use retaining walls and terraces to protect roots of trees and shrubs when grades are lowered. Lowered grades should start no closer than the dripline of the tree.
    - Avoid trenching within the dripline of the tree.
    - Construction limits should be identified and clearly marked to exclude equipment.
2. Structural practices include (but not limited to):
  - a) Inlet protection and outlet protection using silt fences
    - See detail on Erosion and Sediment Control Plans
  - b) Perimeter protection using silt fences
  - c) Sediment basin(s)
  - d) Stabilized construction exit points
    - Aggregate size shall be 2 inch stone or reclaimed / recycled concrete equivalent
    - Thickness shall be not less than 6 inches

- Width to be the full width of the access point, but not less than 12 ft
  - Length shall be as required, but not less than 50 ft.
  - Filter cloth shall be applied over the entire area to be covered with aggregate
  - The entrance shall be maintained in a condition which will prevent tracking of sediment onto public rights-of-way or streets. When necessary, wheels must be cleaned to remove sediment prior to entrance onto public rights-of-way.
- e) Storm sewer
- f) Stormwater detention ponds (which may also serve as a temporary sediment basin)
- g) Straw Bale Dike
- Straw bale dikes have an estimated design life of three months.
  - Shall only be used where no other practice is feasible
- i) Stone Check Dam
- Use graded stone 2 to 15 inches in size
  - Sediment accumulated behind the check dam shall be removed as needed to allow drainage through the check dam and prevent large flows from carrying sediment over the dam.
3. NYS Ag and Markets Requirements

Stripped topsoil should be stockpiled from work areas (e.g. parking areas, electric conductor trenches, along access roads, equipment pads) and kept separate from other excavated material (rock and/or subsoil) until the completion of the facility for final restoration. For proper topsoil segregation, at least 25 feet of additional temporary workspace (ATWS) may be needed along “open-cut” underground utility trenches. All topsoil will be stockpiled as close as is reasonably practical to the area where stripped/removed and shall be used for restoration on that particular area. Any topsoil removed from permanently converted agricultural areas (e.g. permanent roads, etc.) should be temporarily stockpiled and eventually spread evenly in adjacent agricultural areas within the project Limits of Disturbance (LOD); however not to significantly alter the hydrology of the area. Clearly designate topsoil stockpile areas and topsoil disposal areas in the field and on construction drawings; changes or additions to the designated stockpile areas may be needed based on field conditions in consultation with the EM. Sufficient LOD (as designated on the site plan or by the EM) area should be allotted to allow adequate access to the stockpile for topsoil replacement during restoration.

Topsoil stockpiles on agricultural areas left in place prior to October 31st should be seeded with Aroostook Winter Rye or equivalent at an application rate of three bushels (168 lbs.) per acre and mulched with straw mulch at rate of two to three bales per 1000 Sq. Ft.

Topsoil stockpiles left in place between October 31st and May 31st should be mulched with straw at a rate of two to three bales per 1000 Sq. Ft. to prevent soil loss.

4. Sequence of Major Activities

The CONTRACTOR will be responsible for implementing erosion and sediment control measures outlined in the SWPPP and any additional erosion and sediment control measures required to stabilize the site. The CONTRACTOR may designate these tasks to certain subcontractors as appropriate, but the ultimate responsibility for implementing these controls and ensuring their proper functioning remains with the CONTRACTOR. The order of activities will be as follows (refer to Stormwater Pollution Prevention Plan Sheet contained in this SWPPP for additional details):

Phase 1:

- a) Conduct a delineation of the limits of disturbance for each project phase. The project shall be constructed in phases not to exceed 5 acres as shown on the phasing plans. Each phase shall be completed and stabilized before the commencement of the next phase.

- b) Install perimeter silt fences and grade stormwater areas. Stormwater areas are to be used as temporary sediment basins during construction.
- c) Construct temporary construction roads and laydown areas at locations shown on the SWPPP plan sheet.
- d) Grade stormwater areas, to be used as temporary sediment traps during construction.
- e) Remove topsoil, as required, and stockpile according to Ags & Market's recommendations.
- f) Install temporary access road and laydown area.
- g) Begin clearing and grubbing operations. Clearing and grubbing shall be done only in areas where earthwork will be performed and only in areas where building is planned to commence within 7 days after clearing and grubbing. Clearing and grubbing operations shall be limited so that no more than 5 acres of disturbed soil exists at any one time without prior written approval from the NYS DEC.
- h) Temporary Stabilization.

Phase 2:

- a) Field delineation of the limits of work.
- b) Install erosion and sediment control practices within phase.
- c) Frequent watering of the excavation and fill areas shall be done to minimize wind erosion.
- d) Commence site grading and solar panel construction.
- e) Disturbed areas of the site where construction activity has ceased for more than 7 days should be temporarily seeded and watered.
- f) Install protective silt fences at the ends of all exposed storm sewer pipes.
- g) Place required riprap at locations shown on the plans.
- h) Carry out final grading and seeding and planting, including stormwater management basins.
- i) Install overland flow dispersion devices with compost filter socks upgrade of devices.
- j) Install solar racking and panels. Move compost filter socks as necessary.

Phase 3:

- a) Field delineation of the limits of work.
- b) Install erosion and sediment control practices within phase.
- c) Frequent watering of the excavation and fill areas shall be done to minimize wind erosion.
- d) Commence site grading and solar panel construction.
- e) Disturbed areas of the site where construction activity has ceased for more than 7 days should be temporarily seeded and watered.
- f) Install protective silt fences at the ends of all exposed storm sewer pipes.

- g) Place required riprap at locations shown on the plans.
- h) Carry out final grading and seeding and planting, including stormwater management basins.
- i) Install overland flow dispersion devices with compost filter socks upgrade of devices.
- j) Install solar racking and panels. Move compost filter socks as necessary.

Phase 4:

- a) Field delineation of the limits of work.
- b) Install erosion and sediment control practices within phase.
- c) Frequent watering of the excavation and fill areas shall be done to minimize wind erosion.
- d) Solar panel construction.
- e) Disturbed areas of the site where construction activity has ceased for more than 7 days should be temporarily seeded and watered.
- f) Carry out final grading and seeding and planting.
- g) Install overland flow dispersion devices with compost filter socks upgrade of devices.
- h) Install solar racking and panels. Move compost filter socks as necessary.

Phase 5:

- a) Remove temporary construction roads only prior to the utility maintenance road construction in these areas (These areas are to be constructed last).
- b) Construct permanent maintenance access road for utilities.
- c) Remove silt fencing only after all construction is complete and exposed surfaces are stabilized.
- d) Follow NYSDEC guidance included in Section 2 to reclaim all soils that have been compacted due to heavy construction laydown and the temporary access road outside of solar array. Final stabilization is defined as the completion of all soil disturbance activities with the phase area having perennial vegetative cover with a density of eighty (80) percent, or other equivalent stabilization measures such as permanent landscape mulches, rock rip-rap or washed/crushed stone.

5. Stormwater Management

The proposed stormwater management system was designed by The Environmental Design Partnership, Clifton Park, NY. The following paragraphs summarize the stormwater management measures to be incorporated on the site to control pollutants in stormwater discharges after construction is completed. A copy of the Stormwater Management Report is enclosed under Section 6 – Supplemental Information.

Five (5) stormwater management areas, constructed as bioretention areas and a wet pond, will be constructed to provide sufficient volume to hold all storm events up to 100 years and allow the water to recharge into the ground. The basins will have an emergency overflow spillway area to provide a safe overland flow path in the event that the basin capacities may be exceeded.

6. Post-Construction Maintenance of the Stormwater Management System

Post construction maintenance and protection of the Stormwater Management System shall be performed in accordance with Section VI. LONG TERM OPERATION AND MAINTENANCE PROCEDURES of the SWPPP.

B. OTHER CONTROLS

1. Waste Disposal

All waste materials will be collected and stored in a securely lidded metal dumpster rented from a local waste management company which must be a solid waste management company licensed to do business in New York State. The dumpster will comply with all local and state solid waste management regulations.

All trash and construction debris from the site will be deposited in the dumpster. The dumpster will be emptied as often as necessary, and the trash will be hauled to a landfill approved by New York State and the local government authority. No construction waste materials will be buried on site. All personnel will be instructed regarding the correct procedures for waste disposal. Notices stating these practices will be posted in the job site construction office trailer, and the job site superintendent will be responsible for seeing that these procedures are followed.

2. Sanitary Waste

All sanitary waste will be collected from the portable units a minimum of two times per week by a licensed portable facility provider in complete compliance with local and state regulations.

3. Off-Site Vehicle Tracking

A stabilized construction exit will be provided to help reduce vehicle tracking of sediments. The paved streets adjacent to the site entrance will be inspected daily and swept as necessary to remove any excess mud, dirt, or rock tracked from the site. Dump trucks hauling material from the construction site will be covered with a tarpaulin. The job site superintendent will be responsible for seeing that these procedures are followed.

4. Concrete Waste From Concrete Trucks

a) Emptying of excess concrete and/or washout from concrete delivery trucks will be allowed on the job site, but only in either (1) specifically designated diked areas which have been prepared to prevent contact between the concrete and/or washout and stormwater which will be discharged from the site or (2) in locations where waste concrete can be poured into forms to make riprap or other useful concrete products.

b) The hardened residue from the concrete washout diked areas will be disposed of in accordance with the procedures given in the Spill Prevention Control and Countermeasures (SPCC) Plan and in accordance with applicable state and federal regulations. The job site superintendent will be responsible for seeing that these procedures are followed.

5. Hazardous Substances and Hazardous Waste

a) All hazardous waste materials will be disposed of by the CONTRACTOR in the manner specified by local, state, and/or federal regulations and by the manufacturer of such products. Site personnel will be instructed in these practices by the job site superintendent, who will also be responsible for seeing that these practices are followed. Material Safety Data Sheets (MSDS's) for each substance with hazardous properties that is used on the job site will be obtained and used for the proper management of potential wastes that may result from these

products. An MSDS will be posted in the immediate area where such product is stored and/or used and another copy of each MSDS will be maintained in the SWPPP file at the job site construction trailer office. Each employee who must handle a substance with hazardous properties will be instructed on the use of MSDS sheets and the specific information in the applicable MSDS for the product he/she is using, particularly regarding spill control techniques.

- b) The CONTRACTOR will implement the Spill Prevention Control and Countermeasures (SPCC) Plan found within this SWPPP and will train all personnel in the proper cleanup and handling of spilled materials. No spilled hazardous materials or hazardous wastes will be allowed to come in contact with stormwater discharges. If such contact occurs, the stormwater discharge will be contained on site until appropriate measures in compliance with state and federal regulations are taken to dispose of such contaminated stormwater. It shall be the responsibility of the job site superintendent to properly train all personnel in the use of the SPCC plan.
- c) Any spills of hazardous materials which are in quantities in excess of Reportable Quantities as defined by EPA regulations shall be immediately reported to the EPA National Response Center 1-800-424-8802.
- d) In order to minimize the potential for a spill of hazardous materials to come into contact with stormwater, the following steps will be implemented:
  - All materials with hazardous properties (such as pesticides, petroleum products, fertilizers, detergents, construction chemicals, acids, paints, paint solvents, cleaning solvents, additives for soil stabilization, concrete curing compounds and additives, etc.) will be stored in a secure location, under cover, when not in use. All such materials shall have secondary containment to prevent contamination of soil and runoff.
  - The minimum practical quantity of all such materials will be kept on the job site.
  - A spill control and containment kit (containing, for example, absorbent such as kitty litter or sawdust, acid neutralizing powder, brooms, dust pans, mops, rags, gloves, goggles, plastic and metal trash containers, etc.) will be provided at the storage site.
  - All of the product in a container will be used before the container is disposed of. All such containers will be triple-rinsed with water prior to disposal. The rinse water used in these containers will be disposed of in a manner in compliance with state and federal regulations and will not be allowed to mix with stormwater discharges.
  - All products will be stored in and used from the original container with the original product label.
  - All products will be used in strict compliance with instructions on the product label.
  - The disposal of excess or used products will be in strict compliance with instructions on the product label.

6. Contaminated Soils

- a) Any contaminated soils (resulting from spills of materials with hazardous properties) which may result from construction activities will be contained and cleaned up immediately in accordance with the procedures given in the Spill Prevention Control and Countermeasures (SPCC) Plan and in accordance with applicable state and federal regulations.
- b) The job site superintendent will be responsible for seeing that these procedures are followed.

#### **IV. COMPLIANCE WITH FEDERAL, STATE, AND LOCAL REGULATIONS**

---

- A. The CONTRACTOR will obtain copies of any and all local and state regulations that are applicable to stormwater management, erosion control, and pollution minimization at this job site and will comply fully with such regulations. The CONTRACTOR will submit written evidence of such compliance if requested by any agent of a regulatory body. The CONTRACTOR will comply with all conditions of the New York State Department of Environmental Conservation SPDES General Permit for Construction Activities, including the conditions related to maintaining the SWPPP and evidence of compliance with the SWPPP at the job site and allowing regulatory personnel access to the job site and to records in order to determine compliance.

#### **V. MAINTENANCE/INSPECTION PROCEDURES DURING CONSTRUCTION**

---

- A. Erosion and Sediment Control and Stabilization Measures Maintenance and Inspection Practices
1. The following is a list of erosion and sediment controls to be used on this site during construction practice.
    - a) Stabilization practices for this site include:
      - o Land clearing activities shall be done only in areas where earthwork will be performed and shall progress as earthwork is needed
      - o Frequent watering of excavation and fill areas to minimize wind erosion during construction.
      - o Use of stabilization fabric for all slopes having a slope of 1V:3H or greater.
      - o Temporary seeding and planting of all unpaved areas using the hydromulching grass seeding technique shall be conducted where soil has been disturbed. In areas of staging and the temporary road, deep-ripping and decompaction shall be applied after temporary seeding and planting.
      - o Permanent seeding and planting of all unpaved areas using the hydromulching grass seeding technique shall be conducted where soil has been disturbed, and after deep-ripping and decompaction in specified areas.
    - b) Structural practices for this site include:
      - o Perimeter protection using silt fences
      - o Inlet protection and outlet protection using silt fences
      - o Storm sewer
      - o Stabilized construction exit points
      - o Stormwater detention ponds (which may also serve as a temporary sediment basin)
    - c) All erosion and sediment controls measures shall remain in place until 80% vegetative cover has been achieved. Any resulting disturbance from said removal to be seeded prior to demobilization. Final stabilization activities for this site include:
      - o Permanent seeding and planting of all unpaved areas using the hydromulching grass seeding technique shall be conducted where soil has been disturbed, and after deep-ripping and decompaction in specified areas.
      - o Restoration of impermeable gravel roads with gravel conforming to NYSDOT Item 304.03 Type 2 minimum CBR 20% fine grade to within  $\pm 1/4$ " of true grade compacted to a minimum 95% modified proctor maximum density.
      - o Restoration of permeable roads shall include deep-ripping and decompaction conforming to NYSDEC guidelines with clean gravel meeting the specifications of NYSDOT Item 703.02 with size designation 3 and 3A of Table 703-4 filling the geogrid per approved NYSDEC Limited Use Pervious Access Road Detail. Gravel shall not be compacted.
      - o Roadside ditches shall be cleaned out of any eroded sediment and brush.
      - o Removal of any sediment from stormwater management systems.
      - o Additional erosion and sediment controls may be required after construction.

2. The following inspection and maintenance practices will be used to maintain erosion and sediment controls and stabilization measures.
  - a) All control measures will be inspected once every seven (7) days at a minimum. Sites that have a waiver to disturb greater than five (5) acres require two (2) inspections every seven (7) days with at least two (2) days between inspections.
  - b) All measures will be maintained in good working order; if repairs are found to be necessary, they will be initiated within 24 hours of report.
  - c) Built up sediment will be removed from silt fence when it has reached one-third the height of the fence.
  - d) Silt fences will be inspected for depth of sediment, tears, etc., to see if the fabric is securely attached to the fence posts, and to see that the fence posts are securely in the ground.
  - e) The sediment basins will be inspected for depth of sediment and built up sediment will be removed when it reaches 50 percent of the capacity.
  - f) Temporary and permanent seeding and all other stabilization measures will be inspected for bare spots, washouts, and healthy growth.
  - g) A maintenance inspection report will be made after each inspection. Copies of the report forms to be completed by the inspector are included in this SWPPP.
  - h) The job site superintendent will be responsible for selecting and training the individuals who will be responsible for these inspections, maintenance and repair activities, and filling out inspection and maintenance reports.
  - i) Personnel selected for the inspection and maintenance responsibilities will receive appropriate instruction from the job site superintendent. They will be trained in all the inspection and maintenance practices necessary for keeping the erosion and sediment controls that are used onsite in good working order. They will also be trained in the completion of, initiation of actions required by, and the filing of the inspection forms. Documentation of this personnel training will be kept on site with the SWPPP.
  - j) Disturbed areas and material storage areas will be inspected for evidence of or potential for pollutants entering stormwater systems.
  - k) Report to the NYS Department of Environmental Conservation within 24 hours any noncompliance with the SWPPP that will endanger public health or the environment. Follow up with a written report within 5 days of the noncompliance event.

**B. Inspection and Maintenance Report Forms**

Once installation of any required or optional erosion control device or measure has been implemented, weekly inspections of each measure shall be performed by the CONTRACTOR'S inspection personnel. The Inspection and Maintenance Reports found in this SWPPP shall be used by the inspectors to inventory and report the condition of each measure to assist in maintaining the erosion and sediment control measures in good working order.

These report forms shall become an integral part of the SWPPP and shall be made readily accessible to governmental inspection officials, the NOI Permittee's Engineer, and the NOI Permittee for review upon request during visits to the project site. In addition, copies of the reports shall be provided to any of these persons, upon request, via mail or facsimile transmission. Inspection and maintenance report forms are to be maintained by the NOI Permittee for five years following the final stabilization of the site.

**C. Other Record-Keeping Requirements**

The CONTRACTOR shall keep the following records related to construction activities at the site:

- Dates when major grading activities occur and the areas that were graded
- Dates and details concerning the installation of structural controls
- Dates when construction activities cease in an area
- Dates when areas are stabilized, either temporarily or permanently
- Dates of rainfall and the amount of rainfall



- Dates and descriptions of the character and amount of any spills of hazardous materials
- Records of reports filed with regulatory agencies if reportable quantities of hazardous materials spilled

D. Winter Operations

The following is a list of erosion and sediment controls and inspection and maintenance practices for winter operations for this site.

- a) **Prior to November 1<sup>st</sup> of any given year all exposed soil areas must be covered with:**
  - o Mulch
  - o Seed and mulch
  - o Geotextile
  - o Erosion control matting
  - o Rock or
  - o Other approved mulch to prevent soil from eroding
- b) Install sediment barriers (silt fence or drop inlet protection) at ALL necessary perimeter and sensitive locations BEFORE SOIL FREEZES.
- c) Slopes and Stockpiles:
  - o Protect slopes and stockpiles with anchored straw or mulch, rolled erosion control product or other durable covering.
  - o Sediment barrier must be installed around piles and at slope toes to prevent soil transport from the pile or slope.
  - o Stabilize exposed areas BEFORE snow covers them.
- d) All entrance/exit locations must be properly stabilized and maintained to accommodate snow management.
- e) Inspections:
  - o If soil disturbance is COMPLETELY suspended AND site is PROPERLY STABILIZED, qualified inspection frequency may be reduced with written notification to NYSDEC or MS4.
  - o Confirmation must be received from NYSDEC prior to reducing inspection frequency.
  - o Monthly inspections must be performed at a minimum.
  - o Sediment control measures should be checked after rain or snowmelt events.
  - o Regular inspections must resume by March 15<sup>th</sup>.

**VI. LONG TERM OPERATION AND MAINTENANCE PROCEDURES**

---

- A. The proposed WILSON HILL SOLAR project will be PRIVATELY and the operation and maintenance requirements will be the responsibility of the private owner.

The entire Stormwater Management System shall be inspected on a yearly basis to ensure that the system operates in the manner originally intended. Specific components of the system shall require additional attention as described below.

1. Bioretention Areas

- a. Bioretention Areas shall be inspected annually and following major storm events to ensure the system operates in the manner originally intended. The inspection should include, but not be limited to, the following components; all outlet orifices, embankment, emergency spillway, drain, accumulation of sediment, and general erosion control measures.
- b. Re-grading and re-vegetation shall be performed as necessary and rip-rap shall be replaced as necessary.

- c. Embankments shall be mowed a minimum of twice per year to discourage woody growth and control weeds.
- d. Debris and litter shall be removed from basins during regular mowing operations or more frequently as necessary.
- e. Accumulated sediment shall be removed from the wet pond area when 10 percent of the basin capacity has been lost due to sedimentation or at a minimum of every 10 to 20 years.

## 2. Wet Ponds

- a. Ponds shall be inspected annually and following major storm events to ensure the system operates in the manner originally intended. The inspection should include, but not be limited to, the following components; all outlet orifices, embankment, emergency spillway, drain, accumulation of sediment, and general erosion control measures.
- b. Special attention should be provided to ensure the low flow outlet orifice continues to function properly with the base Pocket Pond elevation maintained at the elevation of the low flow outlet orifice.
- c. Re-grading and re-vegetation shall be performed as necessary and rip-rap shall be replaced as necessary.
- d. Embankments shall be mowed a minimum of twice per year to discourage woody growth and control weeds.
- e. Debris and litter shall be removed from basins during regular mowing operations or more frequently as necessary.
- f. Accumulated sediment shall be removed from the wet pond area when 10 percent of the pond capacity has been lost due to sedimentation or at a minimum of every 10 to 20 years.
- g. Accumulated sediment in the forebay shall occur every five to six years or after 50% of the total forebay capacity has been filled.

## 3. Attenuation Areas

- a. Ponds shall be inspected annually and following major storm events to ensure the system operates in the manner originally intended. The inspection should include, but not be limited to, the following components; all outlet orifices, embankment, emergency spillway, drain, accumulation of sediment, and general erosion control measures.
- b. Re-grading and re-vegetation shall be performed as necessary and rip-rap shall be replaced as necessary.
- c. Embankments shall be mowed a minimum of twice per year to discourage woody growth and control weeds.
- d. Debris and litter shall be removed from basins during regular mowing operations or more frequently as necessary.
- e. Accumulated sediment shall be removed from the wet pond area when 10 percent of the pond capacity has been lost due to sedimentation or at a minimum of every 10 to 20 years.

## 4. Open Channels

- a. Open channels shall be inspected annually and following major storm events to ensure the system operates in the manner originally intended.
- b. Removal of sediment build-up within the bottom of the channel or filter strip shall be required when 25% of the channel volume has been exceeded.

## 5. Closed Drainage System

- a. Pipes shall be inspected annually and following major storm events to ensure the system operates in the manner originally intended.

## 6. Soil Restoration

- a. The laydown area and temporary access road outside of the solar array is required to receive "full soil restoration" according to NYSDEC Deep-Ripping and De-compaction April 2008.
- b. All other disturbed arrays shall be seeded per the Planting Plan.

**STORMWATER POLLUTION PREVENTION PLAN  
SUMMARY OF EROSION AND SEDIMENT CONTROL AND STABILIZATION MEASURES  
MAINTENANCE/INSPECTION PROCEDURES**

- All control measures will be inspected at least once every seven (7) days. Sites that have a waiver to disturb greater than five (5) acres require two (2) inspections every seven (7) days with at least two (2) days between inspections.
- All measures will be maintained in good working order; if a repair is necessary, it will be initiated within 24 hours of report.
- Built-up sediment will be removed from silt fences when it has reached one-third the height of the fence.
- Silt fences will be inspected for depth of sediment, tears, to see if the fabric is securely attached to the fence posts, and to see that the fence posts are firmly in the ground.
- Sediment basins, if present, will be inspected for depth of sediment, and built-up sediment will be removed when it reaches 50% of the design capacity or at the end of the job.
- Diversion dikes, if present, will be inspected and any breaches promptly repaired.
- Temporary and permanent seeding and planting and other stabilization measures will be inspected for bare spots, washouts, and healthy growth.
- A maintenance inspection report will be made after each inspection. Copies of the report forms to be used are included in this SWPPP.
- The site job superintendent will select the individuals who will be responsible for inspections, maintenance and repair activities, and filling out the inspection and maintenance reports.
- Personnel selected for inspection and maintenance responsibilities will receive training from the site job superintendent. They will be trained in all the inspection and maintenance practices necessary for keeping the erosion and sediment controls used onsite in good working order.
- Disturbed areas and materials storage areas will be inspected for evidence of or potential for pollutants entering stormwater systems.
- Report to The Department of Environmental Conservation within 24 hours any noncompliance with the SWPPP that will endanger public health or the environment. Follow up with a written report within 5 days of the noncompliance event.

**STORMWATER POLLUTION PREVENTION PLAN**  
**CONSTRUCTION/IMPLEMENTATION CHECKLIST**

1. Maintain Records (Project Manager) of Construction Activities, including:
  - Dates when major grading activities occur
  - Dates when construction activities temporarily cease on a portion of the site
  - Dates when construction activities permanently cease on a portion of the site
  - Dates when stabilization measures are initiated on the site
  - Dates of rainfall and the amount of rainfall
  - Dates and descriptions of the character and amount of any spills of hazardous materials
  - Records of reports filed with regulatory agencies if reportable quantities of hazardous materials spilled
  
2. Prepare Inspection Reports (Qualified Inspector) summarizing:
  - Name of inspector
  - Qualifications of inspector
  - Measures/areas inspected
  - Observed conditions
  - Changes necessary to the SWPPP
  
3. Report Releases of Reportable Quantities of Oil or Hazardous Materials (Project Manager, if they occur):
  - Notify National Response Center (1-800-424-8802) immediately
  - Notify permitting authority in writing within 14 days
  - Modify the pollution prevention plan to include:
    - the date of release
    - circumstances leading to the release
    - steps taken to prevent reoccurrence of the release
  
4. Modify Pollution Prevention Plan (per Qualified Inspector) as necessary to:
  - Comply with the minimum permit requirements when notified by The Department of Environmental Conservation that the plan does not comply
  - Address a change in design, construction operation, or maintenance that has an effect on the potential for discharge of pollutants
  - Prevent reoccurrence of reportable quantity releases of a hazardous material or oil

## **VII. SPILL PREVENTION CONTROL AND COUNTERMEASURES (SPCC) PLAN**

---

### **A. MATERIALS COVERED**

The following materials or substances with known hazardous properties are expected to be present onsite during construction:

Concrete	Cleaning solvents
Detergents	Petroleum based products
Paints	Pesticides
Paint solvents	Acids
Fertilizers	Concrete additives
Soil stabilization additives	

### **B. MATERIAL MANAGEMENT PRACTICES**

The following are the material management practices that will be used to reduce the risk of spills or other accidental exposure of materials and substances to stormwater runoff.

#### **1. Good Housekeeping**

The following good housekeeping practices will be followed onsite during the construction project.

- a) An effort will be made to store only enough product required to do the job.
- b) All materials stored onsite will be stored in a neat, orderly manner and, if possible, under a roof or other enclosure.
- c) Products will be kept in their original containers with the original manufacturer's label in legible condition.
- d) Substances will not be mixed with one another unless recommended by the manufacturer.
- e) Whenever possible, all of a product will be used up before disposing of the container.
- f) Manufacturer's recommendations for proper use and disposal will be followed.
- g) The job site superintendent will be responsible for daily inspections to ensure proper use and disposal of materials.

#### **2. Hazardous Products**

These practices will be used to reduce the risks associated with hazardous materials.

- a) Products will be kept in original containers with the original labels in legible condition.
- b) Original labels and material safety data sheets (MSDS's) will be procured and used for each material.
- c) If surplus product must be disposed of, manufacturer's or local/state/federal recommended methods for proper disposal will be followed.
- d) A spill control and containment kit (containing, for example, absorbent such as kitty litter or sawdust, acid neutralizing powder, brooms, dust pans, mops, rags, gloves, goggles, plastic and metal trash containers, etc.) will be provided at the storage site.

- e) All of the product in a container will be used before the container is disposed of. All such containers will be triple-rinsed with water prior to disposal. The rinse water used in these containers will be disposed of in a manner in compliance with state and federal regulations and will not be allowed to mix with stormwater discharges.

### 3. Product Specific Practices

The following product specific practices will be followed on the job site.

#### a) Petroleum Products

All onsite vehicles will be monitored for leaks and receive regular preventative maintenance to reduce the chance of leakage. Petroleum products will be stored in tightly sealed containers which are clearly labeled. Any petroleum storage tanks used onsite will have a dike or berm containment structure constructed around it to contain any spills that may occur. Any asphalt substances used onsite will be applied according to the manufacturer's recommendations.

#### b) Fertilizers

Fertilizers will be applied only in the minimum amounts recommended by the manufacturer. Once applied, fertilizer will be worked in the soil to limit exposure to stormwater. Storage will be in a covered shed. The contents of any partially used bags of fertilizer will be transferred to a sealable plastic bin to avoid spills.

#### c) Paints, Paint Solvents, and Cleaning Solvents

All containers will be tightly sealed and stored when not in use. Excess paint and solvents will not be discharged to the storm sewer system but will be properly disposed of according to manufacturer's instructions or state and federal regulations.

#### d) Concrete Trucks

Concrete trucks will be allowed to wash out or discharge surplus concrete or drum wash water on the site, but only in either (1) specifically designated diked areas which have been prepared to prevent contact between the concrete and/or washout from stormwater and groundwater with a plastic liner of 10 mil or greater which will be discharged from the site or (2) in locations where waste concrete can be poured into forms to make riprap or other useful concrete products.

The hardened residue from the concrete washout diked areas will be disposed of in the same manner as other non-hazardous construction waste materials or may be broken up and used on site as deemed appropriate by the CONTRACTOR. The job site superintendent will be responsible for seeing that these procedures are followed.

### 4. Spill Prevention Practices

In addition to the good housekeeping and material management practices discussed in the previous sections of this plan, the following practices will be followed for spill prevention and cleanup.

- a) Manufacturer's recommended methods for spill cleanup will be clearly posted and site personnel will be trained regarding these procedures and the location of the information and cleanup supplies.
- b) Materials and equipment necessary for spill cleanup will be kept in the material storage area onsite in spill control and containment kit (containing, for example, absorbent such as kitty

litter or sawdust, acid neutralizing powder, brooms, dust pans, mops, rags, gloves, goggles, plastic and metal trash containers, etc.).

- c) All spills will be cleaned up immediately after discovery.
- d) The spill area will be kept well ventilated and personnel will wear appropriate protective clothing to prevent injury from contact with the hazardous substances.
- e) Spills of toxic or hazardous materials will be reported to the appropriate federal, state, and/or local government agency, regardless of the size of the spill. Spills of amounts that exceed Reportable Quantities of certain substances specifically mentioned in federal regulations (40 CFR 302 list and oil) will be immediately reported to the EPA National Response Center, telephone 1-800-424-8802. Reportable Quantities of some substances which may be used at the job site are as follows:
  - oil - appearance of a film or sheen on water
  - pesticides - usually 1 lb.
  - acids - 5000 lb.
  - solvents, flammable - 100 lb.
- f) The SPCC plan will be adjusted to include measures to prevent this type of spill from recurring and how to clean up the spill if there is another one. A description of the spill, what caused it, and the cleanup measures will also be included. If the spill exceeds a Reportable Quantity, all federal regulations regarding reports of the incident will be complied with.
- g) The job site superintendent will be the spill prevention and cleanup coordinator. He will designate the individuals who will receive spill prevention and cleanup training. These individuals will each become responsible for a particular phase of prevention and cleanup. The names of these personnel will be posted in the material storage area and in the office trailer onsite.

## **VIII. CONTROL OF ALLOWABLE NON-STORMWATER DISCHARGES**

- A. Certain types of discharges are allowable under the NYS Department of Environmental Conservation SPDES General Permit for Construction Activity, and it is the intent of this SWPPP to allow such discharges. These types of discharges will be allowed under the conditions that no pollutants will be allowed to come in contact with the water prior to or after its discharge. The control measures, which have been outlined previously in this SWPPP, will be strictly followed to ensure that no contamination of these non-stormwater discharges takes place. The following allowable non-stormwater discharges that may occur from the job site include:
  - a) Discharges from fire fighting activities
  - b) Fire hydrant flushings (see note below)
  - c) Waters used to wash vehicles or control dust in order to minimize offsite sediment tracking
  - d) Potable water sources such as waterline flushings (see note below), irrigation drainage from watering vegetation, routine exterior building washdown (without detergents present) (See Note below)
  - e) Pavement washwaters where spills or leaks of hazardous materials have not occurred or detergents have not been used
  - f) Springs and other uncontaminated groundwater, including dewatering ground water infiltration

- g) Foundation or footing drains where no contamination with process materials such as solvents is present

NOTE: CONTRACTOR shall neutralize any super-chlorinated water from water distribution pipes before releasing it into the environment. Neutralization techniques are available from the Operator's Engineer.

## **IX. CERTIFICATION AND NOTIFICATION**

---


- A. The NYS Department of Environmental Conservation requires that certifications of knowledge of the contents of this SWPPP and agreement to follow the SWPPP be made by the NOI Permittee and the CONTRACTOR. The terms of the General Permit also require that each CONTRACTOR sign the SWPPP plan, (Form 3) thereby making them co-permittees and acknowledging their responsibility for certain operational aspects of the plan. These certifications should be signed before the CONTRACTOR begins activities and should be filed with the site's SWPPP at the jobsite. These certifications are provided within this document, see Table of Contents for location.



## **SECTION 2**

### **Plan Set**

#### **Site Map and General Location Map**

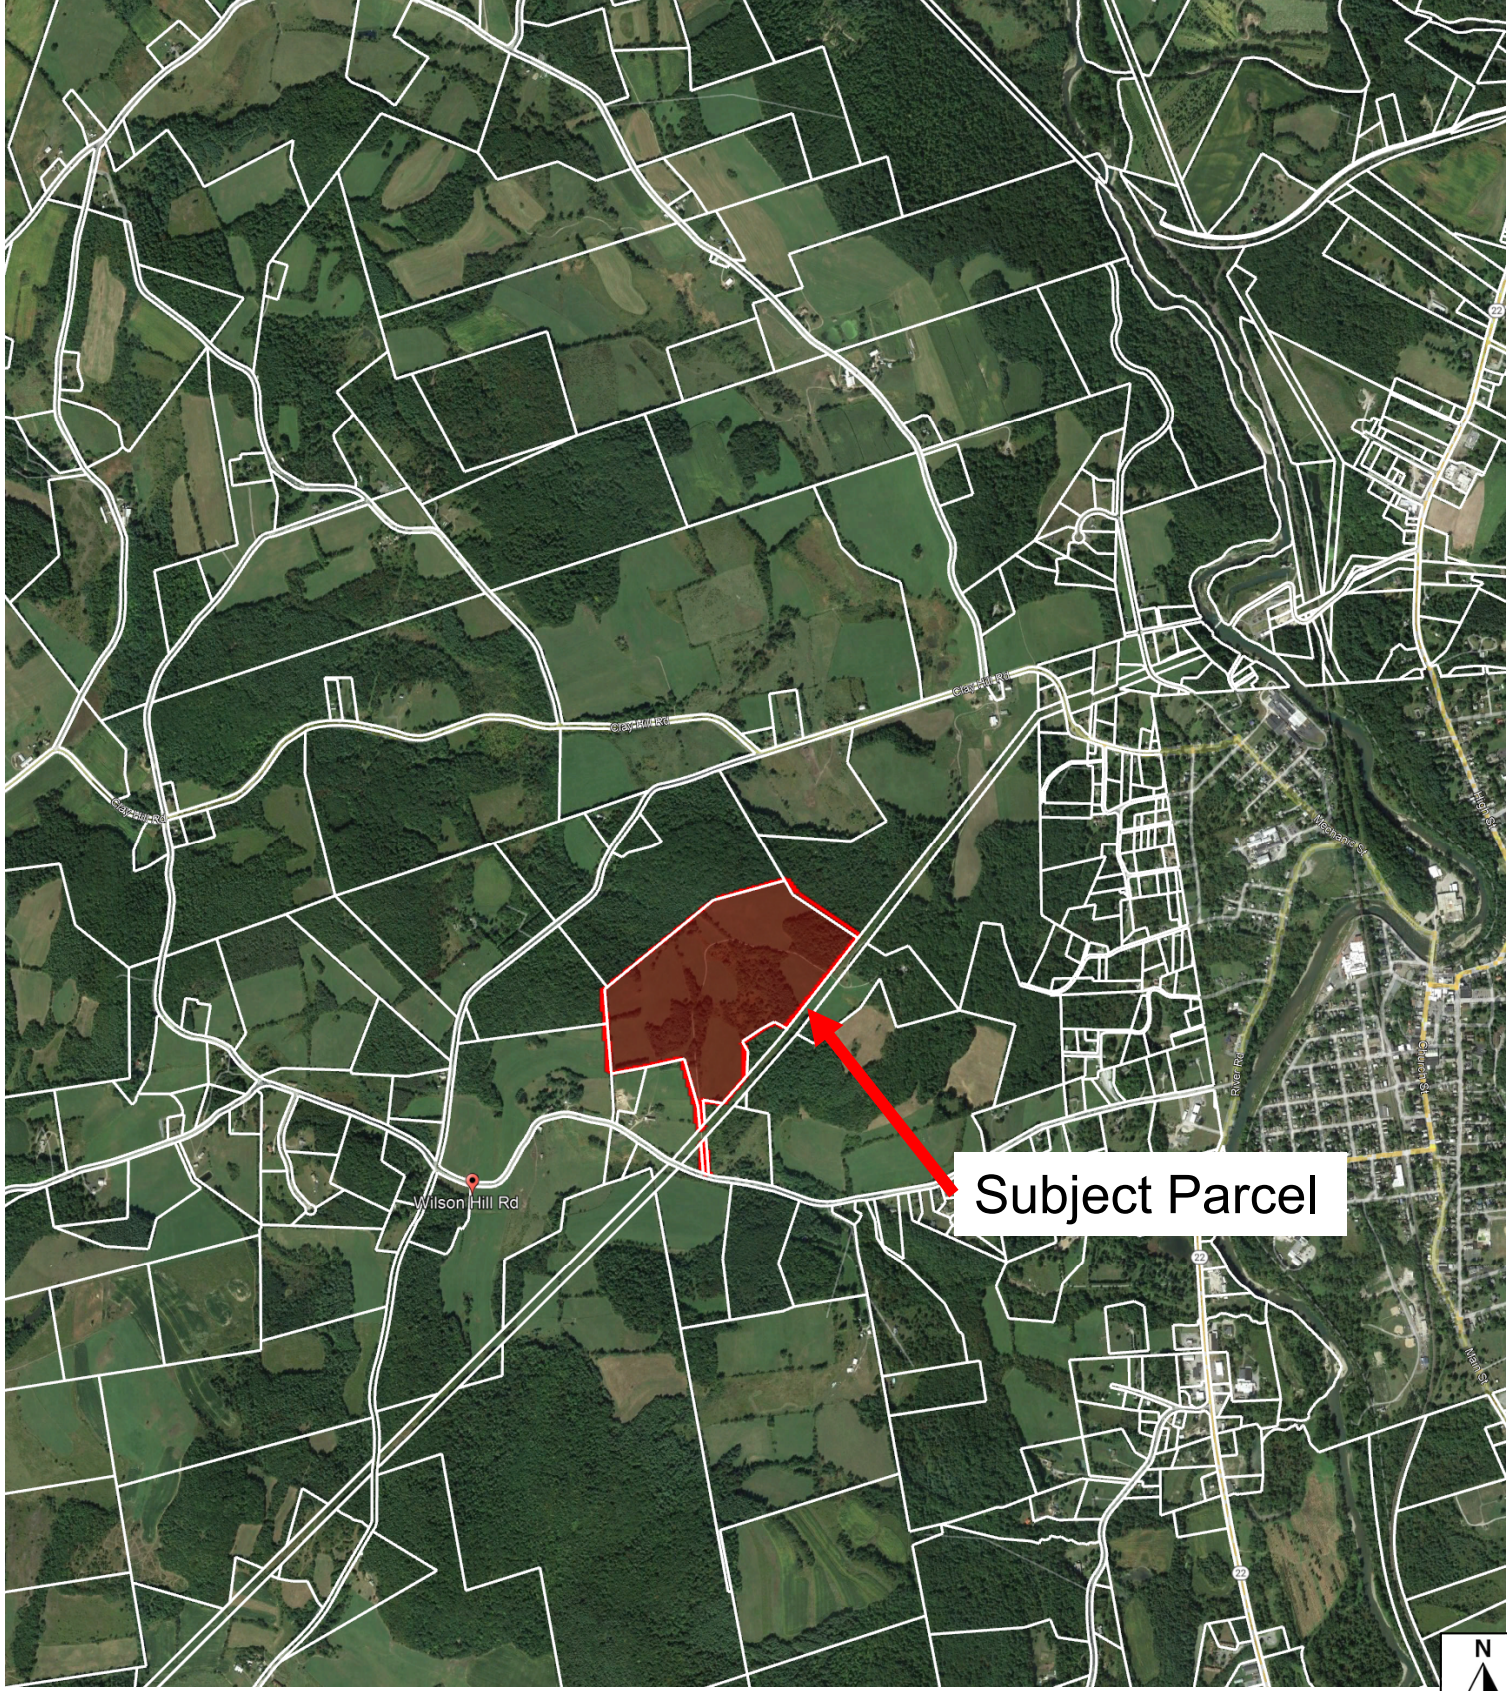

NOT TO SCALE

# Site Location Map

## 469 Wilson Hill Road

Town of Hoosick

Source: Google Earth

Rensselaer County, NY

August 21, 2023

The Environmental  
Design Partnership, LLP  
© 2023

Figure:

1

## **SECTION 3**

**Federal, State or Local Notice of Intent (NOI)**

**NYSDEC NOI Acknowledgement Letter**

**NYSDEC Deep-Ripping and Decompaction Guidance**

# NOI for coverage under Stormwater General Permit for Construction Activity

version 1.37

(Submission #: HQ1-0XR3-VGHF6, version 1)

## Details

---

**Submission Alias**      Wilson Hill Road Solar Array  
**Originally Started By**      Brandon Ferguson  
**Alternate Identifier**      Wilson Hill Road Solar Array  
**Submission ID**              HQ1-0XR3-VGHF6  
**Submission Reason**      New  
**Status**                      Draft

## Form Input

---

### Owner/Operator Information

**Owner/Operator Name (Company/Private Owner/Municipality/Agency/Institution, etc.)**  
Wilson Hill Solar, LLC

**Owner/Operator Contact Person Last Name (NOT CONSULTANT)**  
Fike

**Owner/Operator Contact Person First Name**  
Kelley

**Owner/Operator Mailing Address**  
101 Summer Street, 2nd Floor

**City**  
Boston

**State**  
MA

**Zip**

02110

**Phone**

845-772-2963

**Email**

kfike@nexamp.com

**Federal Tax ID**

26-1541318

If the owner/operator is an organization, provide the Federal Tax ID number, or Employer Identification Number (EIN), in the format xx-xxxxxxx. If the owner/operator is an individual and not an organization, enter "Not Applicable" or "N/A" and do not provide the individual's social security number.

**Project Location****Project/Site Name**

Wilson Hill Road Solar Array

**Street Address (Not P.O. Box)**

469 Wilson Hill Road

**Side of Street**

North

**City/Town/Village (THAT ISSUES BUILDING PERMIT)**

Town of Hoosick

**State**

NY

**Zip**

12090

**DEC Region**

4

The DEC Region must be provided. Please use the NYSDEC Stormwater Interactive Map (<https://gisservices.dec.ny.gov/gis/stormwater/>) to confirm which DEC Region this site is located in. To view the DEC Regions, click on "Other Useful Reference Layers" on the left side of the map, then click on "DEC Administrative Boundary." Zoom out as needed to see the Region boundaries.

For projects that span multiple Regions, please select a primary Region and then provide the additional Regions as a note in Question 39.

**County**

RENSSELAER

**Name of Nearest Cross Street**

Fog Hill Road

**Distance to Nearest Cross Street (Feet)**

850

**Project In Relation to Cross Street**

East

**Tax Map Numbers Section-Block-Parcel**

26-1-12.21/1

**Tax Map Numbers**

NONE PROVIDED

If the project does not have tax map numbers (e.g. linear projects), enter "Not Applicable" or "N/A".

**1. Coordinates**

---

Provide the Geographic Coordinates for the project site. The two methods are:

- Navigate to the project location on the map (below) and click to place a marker and obtain the XY coordinates.
- The "Find Me" button will provide the lat/long for the person filling out this form. Then pan the map to the correct location and click the map to place a marker and obtain the XY coordinates.

**Navigate to your location and click on the map to get the X,Y coordinates**

42.900895102639076,-73.38223675800164

**Project Details****2. What is the nature of this project?**

Redevelopment with increase in impervious area

For the purposes of this eNOI, "New Construction" refers to any project that does not involve the disturbance of existing impervious area (i.e. 0 acres). If existing impervious area will be disturbed on the project site, it is considered redevelopment with either increase in impervious area or no increase in impervious area.

**3. Select the predominant land use for both pre and post development conditions.**

**Pre-Development Existing Landuse**

Pasture/Open Land

**Post-Development Future Land Use**

Other: Solar Field

**3a. If Single Family Subdivision was selected in question 3, enter the number of subdivision lots.**

NONE PROVIDED

---

4. In accordance with the larger common plan of development or sale, enter the total project site acreage, the acreage to be disturbed and the future impervious area (acreage)within the disturbed area.

\*\*\* ROUND TO THE NEAREST TENTH OF AN ACRE. \*\*\*

**Total Site Area (acres)**

99.5

**Total Area to be Disturbed (acres)**

27.1

**Existing Impervious Area to be Disturbed (acres)**

0.4

**Future Impervious Area Within Disturbed Area (acres)**

0.8

**5. Do you plan to disturb more than 5 acres of soil at any one time?**

No

---

6. Indicate the percentage (%) of each Hydrologic Soil Group(HSG) at the site.

**A (%)**

0.0

**B (%)**

0.0

**C (%)**

3.2

**D (%)**

96.8

**7. Is this a phased project?**

Yes

**8. Enter the planned start and end dates of the disturbance activities.****Start Date**

04/01/2024

**End Date**

09/30/2024

**9. Identify the nearest surface waterbody(ies) to which construction site runoff will discharge.**

Minor Tributary of the middle Hoosick River

Drainage ditches and storm sewer systems are not considered surface waterbodies. Please identify the surface waterbody that they discharge to. If the nearest surface waterbody is unnamed, provide a description of the waterbody, such as, "Unnamed tributary to Niagara River."

**9a. Type of waterbody identified in question 9?**

Stream/Creek Off Site

**Other Waterbody Type Off Site Description**

NONE PROVIDED

**9b. If "wetland" was selected in 9A, how was the wetland identified?**

NONE PROVIDED

**10. Has the surface waterbody(ies) in question 9 been identified as a 303(d) segment in Appendix E of GP-0-20-001?**

No

**11. Is this project located in one of the Watersheds identified in Appendix C of GP-0-20-001?**

No

**12. Is the project located in one of the watershed areas associated with AA and AA-S classified waters?**

No

Please use the DEC Stormwater Interactive Map (<https://gisservices.dec.ny.gov/gis/stormwater/>) to confirm if this site is located in one of the watersheds of an AA or AA-S classified water. To view the watershed areas, click on "Permit Related Layers" on the left side of the map, then click on "Class AA AAS Watersheds."



**If No, skip question 13.**

**13. Does this construction activity disturb land with no existing impervious cover and where the Soil Slope Phase is identified as D (provided the map unit name is inclusive of slopes greater than 25%), E or F on the USDA Soil Survey?**

NONE PROVIDED

**If Yes, what is the acreage to be disturbed?**

NONE PROVIDED

**14. Will the project disturb soils within a State regulated wetland or the protected 100 foot adjacent area?**

No

**15. Does the site runoff enter a separate storm sewer system (including roadside drains, swales, ditches, culverts, etc)?**

Yes

**16. What is the name of the municipality/entity that owns the separate storm sewer system?**

Town of Hoosick

**17. Does any runoff from the site enter a sewer classified as a Combined Sewer?**

No

**18. Will future use of this site be an agricultural property as defined by the NYS Agriculture and Markets Law?**

No

**19. Is this property owned by a state authority, state agency, federal government or local government?**

No

**20. Is this a remediation project being done under a Department approved work plan? (i.e. CERCLA, RCRA, Voluntary Cleanup Agreement, etc.)**

No

## **Required SWPPP Components**

**21. Has the required Erosion and Sediment Control component of the SWPPP been developed in conformance with the current NYS Standards and Specifications for Erosion and Sediment Control (aka Blue Book)?**

Yes

**22. Does this construction activity require the development of a SWPPP that includes the post-construction stormwater management practice component (i.e. Runoff Reduction, Water Quality and Quantity Control practices/techniques)?**

Yes

**If you answered No in question 22, skip question 23 and the Post-construction Criteria and Post-construction SMP Identification sections.**

**23. Has the post-construction stormwater management practice component of the SWPPP been developed in conformance with the current NYS Stormwater Management Design Manual?**

Yes

**24. The Stormwater Pollution Prevention Plan (SWPPP) was prepared by:**  
Professional Engineer (P.E.)

**SWPPP Preparer**

Environmental Design Partnership

**Contact Name (Last, First)**

Alessandrini Stephanie

**Mailing Address**

900 Rt 146

**City**

Clifton Park

**State**

NY

**Zip**

12065

**Phone**

518-371-7621

**Email**

salessandrini@edpllp.com

**Download SWPPP Preparer Certification Form**

Please take the following steps to prepare and upload your preparer certification form:

- 1) Click on the link below to download a blank certification form
- 2) The certified SWPPP preparer should sign this form
- 3) Scan the signed form
- 4) Upload the scanned document

[Download SWPPP Preparer Certification Form](#)

**Please upload the SWPPP Preparer Certification**

[swpppcert\\_ex.pdf - 12/22/2023 07:45 AM](#)

**Comment**

NONE PROVIDED

**Erosion & Sediment Control Criteria**

**25. Has a construction sequence schedule for the planned management practices been prepared?**

Yes

**26. Select all of the erosion and sediment control practices that will be employed on the project site:****Temporary Structural**

Check Dams  
 Construction Road Stabilization  
 Level Spreader  
 Sediment Traps  
 Silt Fence  
 Stabilized Construction Entrance

**Biotechnical**

None

**Vegetative Measures**

Grassed Waterway  
 Seeding  
 Topsoiling

**Permanent Structural**

Land Grading  
 Riprap Slope Protection  
 Rock Outlet Protection

**Other**

NONE PROVIDED

**Post-Construction Criteria**

**\* IMPORTANT: Completion of Questions 27-39 is not required if response to Question 22 is No.**

**27. Identify all site planning practices that were used to prepare the final site plan/layout for the project.**

Preservation of Undisturbed Area  
 Reduction of Clearing and Grading

**27a. Indicate which of the following soil restoration criteria was used to address the requirements in Section 5.1.6("Soil Restoration") of the Design Manual (2010 version).**

All disturbed areas will be restored in accordance with the Soil Restoration requirements in Table 5.3 of the Design Manual (see page 5-22).

**28. Provide the total Water Quality Volume (WQv) required for this project (based on final site plan/layout). (Acre-feet)**

0.730

**29. Post-construction SMP Identification**

Use the Post-construction SMP Identification section to identify the RR techniques (Area Reduction), RR techniques (Volume Reduction) and Standard SMPs with RRv Capacity that were used to reduce the Total WQv Required (#28).

Identify the SMPs to be used by providing the total impervious area that contributes runoff to each technique/practice selected. For the Area Reduction Techniques, provide the total contributing area (includes pervious area) and, if applicable, the total impervious area that contributes runoff to the technique/practice.

Note: Redevelopment projects shall use the Post-Construction SMP Identification section to identify the SMPs used to treat and/or reduce the WQv required. If runoff reduction techniques will not be used to reduce the required WQv, skip to question 33a after identifying the SMPs.

**30. Indicate the Total RRv provided by the RR techniques (Area/Volume Reduction) and Standard SMPs with RRv capacity identified in question 29. (acre-feet)**

0.148

**31. Is the Total RRv provided (#30) greater than or equal to the total WQv required (#28)?**

No

**If Yes, go to question 36. If No, go to question 32.**

**32. Provide the Minimum RRv required based on HSG. [Minimum RRv Required = (P) (0.95) (Ai) / 12, Ai=(s) (Aic)] (acre-feet)**

0.144

**32a. Is the Total RRv provided (#30) greater than or equal to the Minimum RRv Required (#32)?**

Yes

**If Yes, go to question 33.**

Note: Use the space provided in question #39 to summarize the specific site limitations and justification for not reducing 100% of WQv required (#28). A detailed evaluation of the specific site limitations and justification for not reducing 100% of the WQv required (#28) must also be included in the SWPPP.

If No, sizing criteria has not been met; therefore, NOI can not be processed. SWPPP preparer must modify design to meet sizing criteria.

**33. SMPs**

Use the Post-construction SMP Identification section to identify the Standard SMPs and, if applicable, the Alternative SMPs to be used to treat the remaining total WQv (=Total WQv Required in #28 - Total RRv Provided in #30).

Also, provide the total impervious area that contributes runoff to each practice selected.

NOTE: Use the Post-construction SMP Identification section to identify the SMPs used on Redevelopment projects.

**33a. Indicate the Total WQv provided (i.e. WQv treated) by the SMPs identified in question #33 and Standard SMPs with RRv Capacity identified in question #29. (acre-feet)**

0.582

Note: For the standard SMPs with RRv capacity, the WQv provided by each practice = the WQv calculated using the contributing drainage area to the practice - provided by the practice. (See Table 3.5 in Design Manual)

**34. Provide the sum of the Total RRv provided (#30) and the WQv provided (#33a).**

0.730

**35. Is the sum of the RRv provided (#30) and the WQv provided (#33a) greater than or equal to the total WQv required (#28)?**

Yes

If Yes, go to question 36.

If No, sizing criteria has not been met; therefore, NOI can not be processed. SWPPP preparer must modify design to meet sizing criteria.

**36. Provide the total Channel Protection Storage Volume (CPv required and provided or select waiver (#36a), if applicable.**

**CPv Required (acre-feet)**

NONE PROVIDED

**CPv Provided (acre-feet)**

NONE PROVIDED

**36a. The need to provide channel protection has been waived because:**

Reduction of the total CPv is achieved on site through runoff reduction techniques or infiltration systems.

**37. Provide the Overbank Flood (Qp) and Extreme Flood (Qf) control criteria or select waiver (#37a), if applicable.**

**Overbank Flood Control Criteria (Qp)**

**Pre-Development (CFS)**

70.73

**Post-Development (CFS)**

50.13

**Total Extreme Flood Control Criteria (Qf)**

**Pre-Development (CFS)**

141.81

**Post-Development (CFS)**

104.33

**37a. The need to meet the Qp and Qf criteria has been waived because:**

NONE PROVIDED

**38. Has a long term Operation and Maintenance Plan for the post-construction stormwater management practice(s) been developed?**

Yes

**If Yes, Identify the entity responsible for the long term Operation and Maintenance**

Wilson Hill Solar, LLC

**39. Use this space to summarize the specific site limitations and justification for not reducing 100% of WQv required (#28). (See question #32a) This space can also be used for other pertinent project information.**

Steep slopes and poor soil conditions prevent the possibility of using other stormwater treatment practices to meet the criteria.

**Post-Construction SMP Identification****Runoff Reduction (RR) Techniques, Standard Stormwater Management Practices (SMPs) and Alternative SMPs**

Identify the Post-construction SMPs to be used by providing the total impervious area that contributes runoff to each technique/practice selected. For the Area Reduction Techniques, provide the total contributing area (includes pervious area) and, if applicable, the total impervious area that contributes runoff to the technique/practice.

**RR Techniques (Area Reduction)**

---

Round to the nearest tenth

**Total Contributing Acres for Conservation of Natural Area (RR-1)**

NONE PROVIDED

**Total Contributing Impervious Acres for Conservation of Natural Area (RR-1)**

NONE PROVIDED

**Total Contributing Acres for Sheetflow to Riparian Buffers/Filter Strips (RR-2)**

NONE PROVIDED

**Total Contributing Impervious Acres for Sheetflow to Riparian Buffers/Filter Strips (RR-2)**

NONE PROVIDED

**Total Contributing Acres for Tree Planting/Tree Pit (RR-3)**

NONE PROVIDED

**Total Contributing Impervious Acres for Tree Planting/Tree Pit (RR-3)**

NONE PROVIDED

**Total Contributing Acres for Disconnection of Rooftop Runoff (RR-4)**

NONE PROVIDED

**RR Techniques (Volume Reduction)**

---

**Total Contributing Impervious Acres for Disconnection of Rooftop Runoff (RR-4)**

NONE PROVIDED

**Total Contributing Impervious Acres for Vegetated Swale (RR-5)**

NONE PROVIDED

**Total Contributing Impervious Acres for Rain Garden (RR-6)**

NONE PROVIDED

**Total Contributing Impervious Acres for Stormwater Planter (RR-7)**

NONE PROVIDED

**Total Contributing Impervious Acres for Rain Barrel/Cistern (RR-8)**

NONE PROVIDED

**Total Contributing Impervious Acres for Porous Pavement (RR-9)**

NONE PROVIDED

**Total Contributing Impervious Acres for Green Roof (RR-10)**

NONE PROVIDED

**Standard SMPs with RRv Capacity**

---

**Total Contributing Impervious Acres for Infiltration Trench (I-1)**

NONE PROVIDED

**Total Contributing Impervious Acres for Infiltration Basin (I-2)**

NONE PROVIDED

**Total Contributing Impervious Acres for Dry Well (I-3)**

NONE PROVIDED

**Total Contributing Impervious Acres for Underground Infiltration System (I-4)**

NONE PROVIDED

**Total Contributing Impervious Acres for Bioretention (F-5)**

3.71

**Total Contributing Impervious Acres for Dry Swale (O-1)**

NONE PROVIDED

**Standard SMPs**

---

**Total Contributing Impervious Acres for Micropool Extended Detention (P-1)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Wet Pond (P-2)**  
3.92

**Total Contributing Impervious Acres for Wet Extended Detention (P-3)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Multiple Pond System (P-4)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Pocket Pond (P-5)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Surface Sand Filter (F-1)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Underground Sand Filter (F-2)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Perimeter Sand Filter (F-3)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Organic Filter (F-4)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Shallow Wetland (W-1)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Extended Detention Wetland (W-2)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Pond/Wetland System (W-3)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Pocket Wetland (W-4)**  
NONE PROVIDED

**Total Contributing Impervious Acres for Wet Swale (O-2)**  
NONE PROVIDED

**Alternative SMPs (DO NOT INCLUDE PRACTICES BEING USED FOR PRETREATMENT ONLY)**

---

**Total Contributing Impervious Area for Hydrodynamic**  
NONE PROVIDED

**Total Contributing Impervious Area for Wet Vault**  
NONE PROVIDED



**Total Contributing Impervious Area for Media Filter**

NONE PROVIDED

**"Other" Alternative SMP?**

NONE PROVIDED

**Total Contributing Impervious Area for "Other"**

NONE PROVIDED

**Provide the name and manufacturer of the alternative SMPs (i.e. proprietary practice(s)) being used for WQv treatment.**

**Note: Redevelopment projects which do not use RR techniques, shall use questions 28, 29, 33 and 33a to provide SMPs used, total WQv required and total WQv provided for the project.**

**Manufacturer of Alternative SMP**

NONE PROVIDED

**Name of Alternative SMP**

NONE PROVIDED

**Other Permits**

**40. Identify other DEC permits, existing and new, that are required for this project/facility.**

None

**If SPDES Multi-Sector GP, then give permit ID**

NONE PROVIDED

**If Other, then identify**

NONE PROVIDED

**41. Does this project require a US Army Corps of Engineers Wetland Permit?**

No

**If "Yes," then indicate Size of Impact, in acres, to the nearest tenth**

NONE PROVIDED

**42. If this NOI is being submitted for the purpose of continuing or transferring coverage under a general permit for stormwater runoff from construction activities, please indicate the former SPDES number assigned.**

NONE PROVIDED

**MS4 SWPPP Acceptance**

**43. Is this project subject to the requirements of a regulated, traditional land use control MS4?**

No

**If No, skip question 44****44. Has the "MS4 SWPPP Acceptance" form been signed by the principal executive officer or ranking elected official and submitted along with this NOI?**

NONE PROVIDED

**MS4 SWPPP Acceptance Form Download**

Download form from the link below. Complete, sign, and upload.

[MS4 SWPPP Acceptance Form](#)**MS4 Acceptance Form Upload**

NONE PROVIDED

**Comment**

NONE PROVIDED

**Owner/Operator Certification****Owner/Operator Certification Form Download**

Download the certification form by clicking the link below. Complete, sign, scan, and upload the form.

[Owner/Operator Certification Form \(PDF, 45KB\)](#)**Upload Owner/Operator Certification Form**[Wilson Hill NOI\\_OwnerOperator\\_Executed.pdf - 12/22/2023 07:34 AM](#)**Comment**

NONE PROVIDED

**Attachments**

Date	Attachment Name	Context	User
12/22/2023 7:45 AM	swpppcert_ex.pdf	Attachment	Brandon Ferguson
12/22/2023 7:34 AM	Wilson Hill NOI_OwnerOperator_Executed.pdf	Attachment	Brandon Ferguson



# Owner/Operator Certification Form

## SPDES General Permit For Stormwater Discharges From Construction Activity (GP-0-20-001)

Project/Site Name: \_\_\_\_\_

eNOI Submission Number: \_\_\_\_\_

eNOI Submitted by:                      Owner/Operator                      SWPPP Preparer                      Other

### Certification Statement - Owner/Operator

I have read or been advised of the permit conditions and believe that I understand them. I also understand that, under the terms of the permit, there may be reporting requirements. I hereby certify that this document and the corresponding documents were prepared under my direction or supervision. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. I further understand that coverage under the general permit will be identified in the acknowledgment that I will receive as a result of submitting this NOI and can be as long as sixty (60) business days as provided for in the general permit. I also understand that, by submitting this NOI, I am acknowledging that the SWPPP has been developed and will be implemented as the first element of construction, and agreeing to comply with all the terms and conditions of the general permit for which this NOI is being submitted.

Owner/Operator First Name

M.I.    Last Name

\_\_\_\_\_  
Signature

\_\_\_\_\_  
Date



# SWPPP Preparer Certification Form

---

*SPDES General Permit for Stormwater  
Discharges From Construction Activity  
(GP-0-20-001)*

## **Project Site Information** Project/Site Name

## **Owner/Operator Information** Owner/Operator (Company Name/Private Owner/Municipality Name)

## **Certification Statement – SWPPP Preparer**

I hereby certify that the Stormwater Pollution Prevention Plan (SWPPP) for this project has been prepared in accordance with the terms and conditions of the GP-0-20-001. Furthermore, I understand that certifying false, incorrect or inaccurate information is a violation of this permit and the laws of the State of New York and could subject me to criminal, civil and/or administrative proceedings.

First name

MI

Last Name

Signature

Date

**New York State Department of Environmental Conservation  
Division of Water  
625 Broadway, 4th Floor  
Albany, New York 12233-3505  
\*(NOTE: Submit completed form to address above)\***

**NOTICE OF TERMINATION for Storm Water Discharges Authorized  
under the SPDES General Permit for Construction Activity**

**Please indicate your permit identification number:** NYR \_\_\_\_\_

**I. Owner or Operator Information**

1. Owner/Operator Name:

2. Street Address:

3. City/State/Zip:

4. Contact Person:

4a. Telephone:

4b. Contact Person E-Mail:

**II. Project Site Information**

5. Project/Site Name:

6. Street Address:

7. City/Zip:

8. County:

**III. Reason for Termination**

9a.  All disturbed areas have achieved final stabilization in accordance with the general permit and SWPPP. **\*Date final stabilization completed** (month/year): \_\_\_\_\_

9b.  Permit coverage has been transferred to new owner/operator. Indicate new owner/operator's permit identification number: NYR \_\_\_\_\_  
(Note: Permit coverage can not be terminated by owner identified in I.1. above until new owner/operator obtains coverage under the general permit)

9c.  Other (Explain on Page 2)

**IV. Final Site Information:**

10a. Did this construction activity require the development of a SWPPP that includes post-construction stormwater management practices?  yes  no (If no, go to question 10f.)

10b. Have all post-construction stormwater management practices included in the final SWPPP been constructed?  yes  no (If no, explain on Page 2)

10c. Identify the entity responsible for long-term operation and maintenance of practice(s)?

\_\_\_\_\_

**NOTICE OF TERMINATION for Storm Water Discharges Authorized under the  
SPDES General Permit for Construction Activity - continued**

10d. Has the entity responsible for long-term operation and maintenance been given a copy of the operation and maintenance plan required by the general permit?     yes     no

10e. Indicate the method used to ensure long-term operation and maintenance of the post-construction stormwater management practice(s):

- Post-construction stormwater management practice(s) and any right-of-way(s) needed to maintain practice(s) have been deeded to the municipality.
- Executed maintenance agreement is in place with the municipality that will maintain the post-construction stormwater management practice(s).
- For post-construction stormwater management practices that are privately owned, a mechanism is in place that requires operation and maintenance of the practice(s) in accordance with the operation and maintenance plan, such as a deed covenant in the owner or operator's deed of record.
- For post-construction stormwater management practices that are owned by a public or private institution (e.g. school, university or hospital), government agency or authority, or public utility; policy and procedures are in place that ensures operation and maintenance of the practice(s) in accordance with the operation and maintenance plan.

10f. Provide the total area of impervious surface (i.e. roof, pavement, concrete, gravel, etc.) constructed within the disturbance area? \_\_\_\_\_  
(acres)

11. Is this project subject to the requirements of a regulated, traditional land use control MS4?     yes  
 no  
(If Yes, complete section VI - "MS4 Acceptance" statement)

**V. Additional Information/Explanation:**  
(Use this section to answer questions 9c. and 10b., if applicable)

**VI. MS4 Acceptance - MS4 Official (principal executive officer or ranking elected official) or Duly Authorized Representative** (Note: Not required when 9b. is checked -transfer of coverage)

I have determined that it is acceptable for the owner or operator of the construction project identified in question 5 to submit the Notice of Termination at this time.

Printed Name:

Title/Position:

Signature:

Date:

**NOTICE OF TERMINATION for Storm Water Discharges Authorized under the  
SPDES General Permit for Construction Activity - continued**

**VII. Qualified Inspector Certification - Final Stabilization:**

I hereby certify that all disturbed areas have achieved final stabilization as defined in the current version of the general permit, and that all temporary, structural erosion and sediment control measures have been removed. Furthermore, I understand that certifying false, incorrect or inaccurate information is a violation of the referenced permit and the laws of the State of New York and could subject me to criminal, civil and/or administrative proceedings.

Printed Name:

Title/Position:

Signature:

Date:

**VIII. Qualified Inspector Certification - Post-construction Stormwater Management Practice(s):**

I hereby certify that all post-construction stormwater management practices have been constructed in conformance with the SWPPP. Furthermore, I understand that certifying false, incorrect or inaccurate information is a violation of the referenced permit and the laws of the State of New York and could subject me to criminal, civil and/or administrative proceedings.

Printed Name:

Title/Position:

Signature:

Date:

**IX. Owner or Operator Certification**

I hereby certify that this document was prepared by me or under my direction or supervision. My determination, based upon my inquiry of the person(s) who managed the construction activity, or those persons directly responsible for gathering the information, is that the information provided in this document is true, accurate and complete. Furthermore, I understand that certifying false, incorrect or inaccurate information is a violation of the referenced permit and the laws of the State of New York and could subject me to criminal, civil and/or administrative proceedings.

Printed Name:

Title/Position:

Signature:

Date:

(NYS DEC Notice of Termination - January 2015)



Department of  
Environmental  
Conservation

**New York State**  
**DEPARTMENT OF ENVIRONMENTAL CONSERVATION**

Division of Water

---

# **Deep-Ripping and Decompaction**

---

**April 2008**

**New York State**  
**Department of Environmental Conservation**



Document Prepared by:

John E. Lacey,  
Land Resource Consultant and Environmental Compliance Monitor  
(Formerly with the Division of Agricultural Protection and Development Services,  
NYS Dept. of Agriculture & Markets)

## Alternative Stormwater Management Deep-Ripping and Decompaction

### Description

The two-phase practice of 1) “Deep Ripping;” and 2) “Decompaction” (deep subsoiling), of the soil material as a step in the cleanup and restoration/landscaping of a construction site, helps mitigate the physically induced impacts of soil compression; i.e.: soil compaction or the substantial increase in the bulk density of the soil material.

Deep Ripping and Decompaction are key factors which help in restoring soil pore space and permeability for water infiltration. Conversely, the physical actions of cut-and-fill work, land grading, the ongoing movement of construction equipment and the transport of building materials throughout a site alter the architecture and structure of the soil, resulting in: the mixing of layers (horizons) of soil materials, compression of those materials and diminished soil porosity which, if left unchecked, severely impairs the soil’s water holding capacity and vertical drainage (rainfall infiltration), from the surface downward.

In a humid climate region, compaction damage on a site is virtually guaranteed over the duration of a project. Soil in very moist to wet condition when compacted, will have severely reduced permeability. Figure 1 displays the early stage of the deep-ripping phase (Note that all topsoil was stripped prior to construction access, and it remains stockpiled until the next phase – decompaction – is complete). A heavy-duty tractor is pulling a three-shank ripper on the first of several series of incrementally deepening passes through the construction access corridor’s densely compressed subsoil material. Figure 2 illustrates the approximate volumetric composition of a loam surface soil when conditions are good for plant growth, with adequate natural pore space for fluctuating moisture conditions.



Fig. 1. A typical deep ripping phase of this practice, during the first in a series of progressively deeper “rips” through severely compressed subsoil.

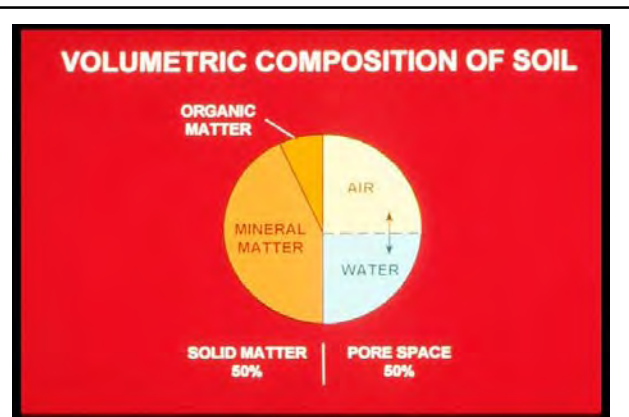


Fig. 2. About 50% of the volume of undisturbed loam surface soil is pore space, when soil is in good condition for plant growth. Brady, 2002.

## Recommended Application of Practice

The objective of Deep Ripping and Decompaction is to effectively fracture (vertically and laterally) through the thickness of the physically compressed subsoil material (see Figure 3), restoring soil porosity and permeability and aiding infiltration to help reduce runoff. Together with topsoil stripping, the “two-phase” practice of Deep Ripping and Decompaction first became established as a “best management practice” through ongoing success on commercial farmlands affected by heavy utility construction right-of-way projects (transmission pipelines and large power lines).

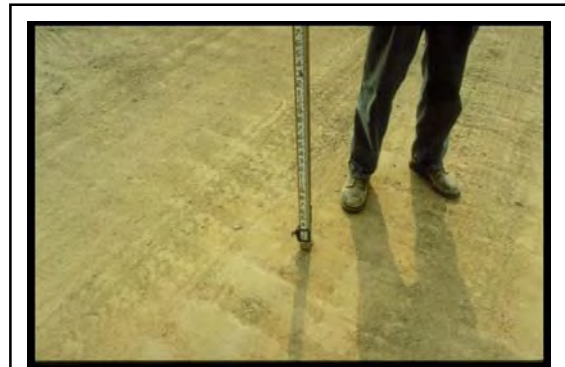


Fig. 3. Construction site with significant compaction of the deep basal till subsoil extends 24 inches below this exposed cut-and-fill work surface.

Soil permeability, soil drainage and cropland productivity were restored. For broader construction application, the two-phase practice of Deep Ripping and Decompaction is best adapted to areas impacted with significant soil compaction, on contiguous open portions of large construction sites and inside long, open construction corridors used as temporary access over the duration of construction. Each mitigation area should have minimal above-and-below-ground obstructions for the easy avoidance and maneuvering of a large tractor and ripping/decompacting implements. Conversely, the complete two-phase practice is not recommended in congested or obstructed areas due to the limitations on tractor and implement movement.

## Benefits

Aggressive “deep ripping” through the compressed thickness of exposed subsoil before the replacement/respreading of the topsoil layer, followed by “decompaction,” i.e.: “sub-soiling,” through the restored topsoil layer down into the subsoil, offers the following benefits:

- Increases the project (larger size) area’s direct surface infiltration of rainfall by providing the open site’s mitigated soil condition and lowers the demand on concentrated runoff control structures
- Enhances direct groundwater recharge through greater dispersion across and through a broader surface than afforded by some runoff-control structural measures
- Decreases runoff volume generated and provides hydrologic source control
- May be planned for application in feasible open locations either alone or in

conjunction with plans for structural practices (e.g., subsurface drain line or infiltration basin) serving the same or contiguous areas

- Promotes successful long-term revegetation by restoring soil permeability, drainage and water holding capacity for healthy (rather than restricted) root-system development of trees, shrubs and deep rooted ground cover, minimizing plant drowning during wet periods and burnout during dry periods.

## Feasibility/Limitations

The effectiveness of Deep Ripping and Decompaction is governed mostly by site factors such as: the original (undisturbed) soil's hydrologic characteristics; the general slope; local weather/timing (soil moisture) for implementation; the space-related freedom of equipment/implement maneuverability (noted above in **Recommended Application of Practice**), and by the proper selection and operation of tractor and implements (explained below in **Design Guidance**). The more notable site-related factors include:

### Soil

In the undisturbed condition, each identified soil type comprising a site is grouped into one of four categories of soil hydrology, Hydrologic Soil Group A, B, C or D, determined primarily by a range of characteristics including soil texture, drainage capability when thoroughly wet, and depth to water table. The natural rates of infiltration and transmission of soil-water through the undisturbed soil layers for Group A is "high" with a low runoff potential while soils in Group B are moderate in infiltration and the transmission of soil-water with a moderate runoff potential, depending somewhat on slope. Soils in Group C have slow rates of infiltration and transmission of soil-water and a moderately high runoff potential influenced by soil texture and slope; while soils in Group D have exceptionally slow rates of infiltration and transmission of soil-water, and high runoff potential.

In Figure 4, the profile displays the undisturbed horizons of a soil in Hydrologic Soil Group C and the naturally slow rate of infiltration through the subsoil. The slow rate of infiltration begins immediately below the topsoil horizon (30 cm), due to the limited amount of macro pores, e.g.: natural subsoil fractures, worm holes and root channels. Infiltration after the construction-induced mixing and compression of such subsoil material is virtually absent; but can be restored back to this natural level with the two-phase practice of deep ripping and decompaction, followed by the permanent establishment of an appropriate, deep taproot

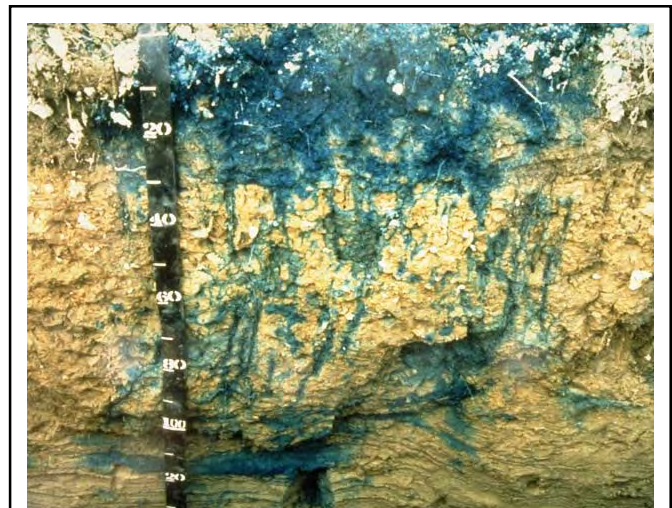


Fig. 4. Profile (in centimeters) displaying the infiltration test result of the natural undisturbed horizons of a soil in Hydrologic Soil Group C.

lawn/ground cover to help maintain the restored subsoil structure. Infiltration after construction-induced mixing and compression of such subsoil material can be notably rehabilitated with the Deep Ripping and Decomaction practice, which prepares the site for the appropriate long-term lawn/ground cover mix including deep taproot plants such as clover, fescue or trefoil, etc. needed for all rehabilitated soils.

Generally, soils in Hydrologic Soil Groups A and B, which respectively may include deep, well-drained, sandy-gravelly materials or deep, moderately well-drained basal till materials, are among the easier ones to restore permeability and infiltration, by deep ripping and decomaction. Among the many different soils in Hydrologic Soil Group C are those unique glacial tills having a natural fragipan zone, beginning about 12 to 18 inches (30 – 45cm), below surface. Although soils in Hydrologic Soil Group C do require a somewhat more carefully applied level of the Deep Ripping and Decomaction practice, it can greatly benefit such affected areas by reducing the runoff and fostering infiltration to a level equal to that of pre-disturbance.

Soils in Hydrologic Soil Group D typically have a permanent high water table close to the surface, influenced by a clay or other highly impervious layer of material. In many locations with clay subsoil material, the bulk density is so naturally high that heavy trafficking has little or no added impact on infiltration; and structural runoff control practices rather than Deep Ripping and Decomaction should be considered.

The information about Hydrologic Soil Groups is merely a general guideline. Site-specific data such as limited depths of cut-and-fill grading with minimal removal or translocation of the inherent subsoil materials (as analyzed in the county soil survey) or, conversely, the excavation and translocation of deeper, unconsolidated substratum or consolidated bedrock materials (unlike the analyzed subsoil horizons' materials referred to in the county soil survey) should always be taken into account.

Sites made up with significant quantities of large rocks, or having a very shallow depth to bedrock, are not conducive to deep ripping and decomaction (subsoiling); and other measures may be more practical.

### **Slope**

The two-phase application of 1) deep ripping and 2) decomaction (deep subsoiling), is most practical on flat, gentle and moderate slopes. In some situations, such as but not limited to temporary construction access corridors, inclusion areas that are moderately steep along a project's otherwise gentle or moderate slope may also be deep ripped and decomacted. For limited instances of moderate steepness on other projects, however, the post-construction land use and the relative alignment of the potential ripping and decomaction work in relation to the lay of the slope should be reviewed for safety and practicality. In broad construction areas predominated by moderately steep or steep slopes, the practice is generally not used.

### **Local Weather/Timing/Soil Moisture**

Effective fracturing of compressed subsoil material from the exposed work surface, laterally and vertically down through the affected zone is achieved only when the soil material is moderately dry to moderately moist. Neither one of the two-phases, deep ripping nor decomaction (deep

subsoiling), can be effectively conducted when the soil material (subsoil or replaced topsoil) is in either a “plastic” or “liquid” state of soil consistency. Pulling the respective implements legs through the soil when it is overly moist only results in the “slicing and smearing” of the material or added “squeezing and compression” instead of the necessary fracturing. Ample drying time is needed for a “rippable” soil condition not merely in the material close to the surface, but throughout the material located down to the bottom of the physically compressed zone of the subsoil.

The “poor man’s Atterberg field test” for soil plasticity is a simple “hand-roll” method used for quick, on-site determination of whether or not the moisture level of the affected soil material is low enough for: effective deep ripping of subsoil; respreading of topsoil in a friable state; and final decompaction (deep subsoiling). Using a sample of soil material obtained from the planned bottom depth of ripping, e.g.: 20 - 24 inches below exposed subsoil surface, the sample is hand rolled between the palms down to a 1/8-inch diameter thread. (Use the same test for stored topsoil material before respreading on the site.) If the respective soil sample crumbles apart in segments no greater than 3/8 of an inch long, by the time it is rolled down to 1/8 inch diameter, it is low enough in moisture for deep ripping (or topsoil replacement), and decompaction. Conversely, as shown in Figure 5, if the rolled sample stretches out in increments greater than 3/8 of an inch long before crumbling, it is in a “plastic” state of soil consistency and is too wet for subsoil ripping (as well as topsoil replacement) and final decompaction.



Fig. 5. Augered from a depth of 19 inches below the surface of the replaced topsoil, this subsoil sample was hand rolled to a 1/8-inch diameter. The test shows the soil at this site stretches out too far without crumbling; it indicates the material is in a plastic state of consistence, too wet for final decompaction (deep subsoiling) at this time.

## Design Guidance

Beyond the above-noted site factors, a vital requirement for the effective Deep Ripping and Decompaction (deep subsoiling), is implementing the practice in its distinct, two-phase process:

- 1) Deep rip the affected thickness of exposed subsoil material (see Figure 10 and 11), aggressively fracturing it before the protected topsoil is reapplied on the site (see Figure 12); and
- 2) Decompact (deep subsoil), simultaneously through the restored topsoil layer and the upper half of the affected subsoil (Figure 13). The second phase, “decompaction,” mitigates the partial recompaction which occurs during the heavy process of topsoil spreading/grading. Prior to deep ripping and decompacting the site, all construction activity, including construction equipment and material storage, site cleanup and trafficking (Figure 14), should be finished; and the site closed off to further disturbance. Likewise, once the practice is underway and the area’s soil permeability and

rainfall infiltration are being restored, a policy limiting all further traffic to permanent travel lanes is maintained.

The other critical elements, outlined below, are: using the proper implements (deep, heavy-duty rippers and subsoilers), and ample pulling-power equipment (tractors); and conducting the practice at the appropriate speed, depth and pattern(s) of movement.

Note that an appropriate plan for the separate practice of establishing a healthy perennial ground cover, with deep rooting to help maintain the restored soil structure, should be developed in advance. This may require the assistance of an agronomist or landscape horticulturist.

### Implements

Avoid the use of all undersize implements. The small-to-medium, light-duty tool will, at best, only “scarify” the uppermost surface portion of the mass of compacted subsoil material. The term “chisel plow” is commonly but incorrectly applied to a broad range of implements. While a few may be adapted for the moderate subsoiling of non-impacted soils, the majority are less durable and used for only lighter land-fitting (see Figure 6).



Fig. 6. A light duty chisel implement, not adequate for either the deep ripping or decompaction (deep subsoiling) phase.

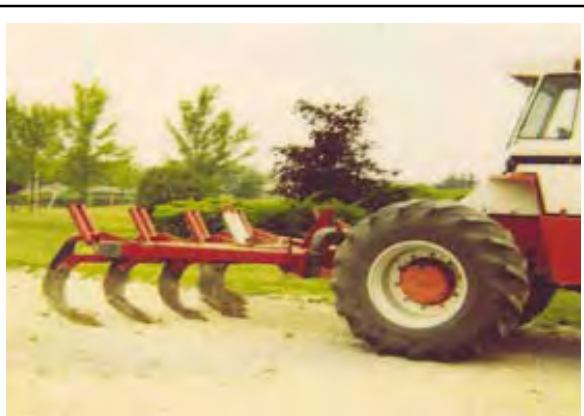


Fig. 7. One of several variations of an agricultural ripper. This unit has long, rugged shanks mounted on a steel V-frame for deep, aggressive fracturing through Phase 1.

Use a “heavy duty” agricultural-grade, deep ripper (see Figures 7,9,10 and 11) for the first phase: the lateral and vertical fracturing of the mass of exposed and compressed subsoil, down and through, to the bottom of impact, prior to the replacement of the topsoil layer. (Any oversize rocks which are uplifted to the subsoil surface during the deep ripping phase are picked and removed.) Like the heavy-duty class of implement for the first phase, the decompaction (deep subsoiling) of Phase 2 is conducted with the heavy-duty version of the deep subsoiler. More preferable is the angled-leg variety of deep subsoiler (shown in Figures 8 and 13). It minimizes the inversion of the subsoil and topsoil layers while laterally and vertically fracturing the upper half of the previously ripped subsoil layer and all of the topsoil layer by delivering a momentary, wave-like “lifting and shattering” action up through the soil layers as it is pulled.

### **Pulling-Power of Equipment**

Use the following rule of thumb for tractor horsepower (hp) whenever deep ripping and decompacting a significantly impacted site: For both types of implement, have at least 40 hp of tractor pull available for each mounted shank/ leg.

Using the examples of a 3-shank and a 5-shank implement, the respective tractors should have 120 and 200 hp available for fracturing down to the final depth of 20-to-24 inches per phase. Final depth for the deep ripping in Phase 1 is achieved incrementally by a progressive series of passes (see Depth and Patterns of Movement, below); while for Phase 2, the full operating depth of the deep subsoiler is applied from the beginning.

The operating speed for pulling both types of implement should not exceed 2 to 3 mph. At this slow and managed rate of operating speed, maximum functional performance is sustained by the tractor and the implement performing the soil fracturing. Referring to Figure 8, the implement is the 6-leg version of the deep angled-leg subsoiler. Its two outside legs are “chained up” so that only four legs will be engaged (at the maximum depth), requiring no less than 160 hp, (rather than 240 hp) of pull. The 4-wheel drive, articulated-frame tractor in Figure 8 is 174 hp. It will be decompacting this unobstructed, former construction access area simultaneously through 11 inches of replaced topsoil and the upper 12 inches of the previously deep-ripped subsoil. In constricted areas of Phase 1) Deep Ripping, a medium-size tractor with adequate hp, such as the one in Figure 9 pulling a 3-shank deep ripper, may be more maneuverable.

Some industrial-grade variations of ripping implements are attached to power graders and bulldozers. Although highly durable, they are generally not recommended. Typically, the shanks or “teeth” of these rippers are too short and stout; and they are mounted too far apart to achieve the well-distributed type of lateral and vertical fracturing of the soil materials necessary to restore soil permeability and infiltration. In addition, the power graders and bulldozers, as pullers, are far less maneuverable for turns and patterns than the tractor.



Fig. 8. A deep, angled-leg subsoiler, ideal for Phase 2 decompaction of after the topsoil layer is graded on top of the ripped subsoil.



Fig. 9. This medium tractor is pulling a 3-shank deep ripper. The severely compacted construction access corridor is narrow, and the 120 hp tractor is more maneuverable for Phase 1 deep ripping (subsoil fracturing), here.



## Depth and Patterns of Movement

As previously noted both Phase 1 Deep Ripping through significantly compressed, exposed subsoil and Phase 2 Decompaction (deep subsoiling) through the replaced topsoil and upper subsoil need to be performed at maximum capable depth of each implement. With an implement's guide wheels attached, some have a "normal" maximum operating depth of 18 inches, while others may go deeper. In many situations, however, the tractor/implement operator must first remove the guide wheels and other non essential elements from the implement. This adapts the ripper or the deep subsoiler for skillful pulling with its frame only a few inches above surface, while the shanks or legs, fracture the soil material 20-to-24 inches deep.

There may be construction sites where the depth of the exposed subsoil's compression is moderate, e.g.: 12 inches, rather than deep. This can be verified by using a  $\frac{3}{4}$  inch cone penetrometer and a shovel to test the subsoil for its level of compaction, incrementally, every three inches of increasing depth. Once the full thickness of the subsoil's compacted zone is finally "pieced" and there is a significant drop in the psi measurements of the soil penetrometer, the depth/thickness of compaction is determined. This is repeated at several representative locations of the construction site. If the thickness of the site's subsoil compaction is verified as, for example, ten inches, then the Phase 1 Deep Ripping can be correspondingly reduced to the implement's minimum operable depth of 12 inches. However, the Phase 2 simultaneous Decompaction (subsoiling) of an 11 inch thick layer of replaced topsoil and the upper subsoil should run at the subsoiling implements full operating depth.



Fig. 10. An early pass with a 3-shank deep ripper penetrating only 8 inches into this worksite's severely compressed subsoil.



Fig. 11. A repeat run of the 3-shank ripper along the same patterned pass area as Fig. 9; here, incrementally reaching 18 of the needed 22 inches of subsoil fracture.

Typically, three separate series (patterns) are used for both the Phase 1 Deep Ripping and the Phase 2 Decompaction on significantly compacted sites. For Phase 1, each series begins with a moderate depth of rip and, by repeat-pass, continues until full depth is reached. Phase 2 applies the full depth of Decompaction (subsoiling), from the beginning.

Every separate series (pattern) consists of parallel, forward-and-return runs, with each progressive

pass of the implement's legs or shanks evenly staggered between those from the previous pass. This compensates for the shank or leg-spacing on the implement, e.g., with 24-to-30 inches between each shank or leg. The staggered return pass ensures lateral and vertical fracturing actuated every 12 to 15 inches across the densely compressed soil mass.

### Large, Unobstructed Areas

For larger easy areas, use the standard patterns of movement:

- The first series (pattern) of passes is applied lengthwise, parallel with the longest spread of the site; gradually progressing across the site's width, with each successive pass.
- The second series runs obliquely, crossing the first series at an angle of about 45 degrees.
- The third series runs at right angle (or 90 degrees), to the first series to complete the fracturing and shattering on severely compacted sites, and avoid leaving large unbroken blocks of compressed soil material. (In certain instances, the third series may be optional, depending on how thoroughly the first two series loosen the material and eliminate large chunks/blocks of material as verified by tests with a 3/4-inch cone penetrometer.)



Fig. 12. Moderately dry topsoil is being replaced on the affected site now that Phase 1 deep ripping of the compressed subsoil is complete.



Fig. 13. The same deep, angled-leg subsoiler shown in Fig. 7 is engaged at maximum depth for Phase 2, decompaction (deep soiling), of the replaced topsoil and the upper subsoil materials.

### Corridors

In long corridors of limited width and less maneuverability than larger sites, e.g.: along compacted areas used as temporary construction access, a modified series of pattern passes are used.

- First, apply the same initial lengthwise, parallel series of passes described above.

- A second series of passes makes a broad “S” shaped pattern of rips, continually and gradually alternating the “S” curves between opposite edges inside the compacted corridor.
- The third and final series again uses the broad, alternating S pattern, but it is “flip-flopped” to continually cross the previous S pattern along the corridor’s centerline. This final series of the S pattern curves back along the edge areas skipped by the second series.

## Maintenance and Cost

Once the two-phase practice of Deep Ripping and Decompaction is completed, two items are essential for maintaining a site’s soil porosity and permeability for infiltration. They are: planting and maintaining the appropriate ground cover with deep roots to maintain the soil structure (see Figure 15); and keeping the site free of traffic or other weight loads.

Note that site-specific choice of an appropriate vegetative ground-cover seed mix, including the proper seeding ratio of one or more perennial species with a deep taproot system and the proper amount of lime and soil nutrients (fertilizer mix) adapted to the soil-needs, are basic to the final practice of landscaping, i.e: surface tillage, seeding/planting/fertilizing and culti-packing or mulching is applied. The "maintenance" of an effectively deep-ripped and decompacted area is generally limited to the successful perennial (long-term) landscape ground cover; as long as no weight-bearing force of soil compaction is applied.



Fig. 14. The severely compacted soil of a temporary construction yard used daily by heavy equipment for four months; shown before deep ripping, topsoil replacement, and decompaction.



Fig. 15. The same site as Fig. 14 after deep ripping of the exposed subsoil, topsoil replacement, decompaction through the topsoil and upper subsoil and final surface tillage and revegetation to maintain soil permeability and infiltration.

The Deep Ripping and Decompaction practice is, by necessity, more extensive than periodic subsoiling of farmland. The cost of deep ripping and decompacting (deep subsoiling), will vary according to the depth and severity of soil-material compression and the relative amount of tractor and implement time that is required. In some instances, depending on open maneuverability, two-to-three acres of compacted project area may be deep-ripped in one day. In other situations of more severe compaction and - or less maneuverability, as little as one acre may be fully ripped in a day. Generally, if the Phase 1) Deep Ripping is fully effective, the Phase 2) Decompaction should be completed in  $2/3$  to  $3/4$  of the time required for Phase 1.

Using the example of two acres of Phase 1) Deep Ripping in one day, at \$1800 per day, the net cost is \$900 per acre. If the Phase 2) Decompacting or deep subsoiling takes  $3/4$  the time as Phase 1, it costs \$675 per acre for a combined total of \$1575 per acre to complete the practice (these figures do not include the cost of the separate practice of topsoil stripping and replacement). Due to the many variables, it must be recognized that cost will be determined by the specific conditions or constraints of the site and the availability of proper equipment.

## Resources

### Publications:

- American Society of Agricultural Engineers. 1971. *Compaction of Agricultural Soils*. ASAE.
- Brady, N.C., and R.R. Weil. 2002. *The Nature and Properties of Soils*. 13<sup>th</sup> ed. Pearson Education, Inc.
- Baver, L.D. 1948. *Soil Physics*. John Wiley & Sons.
- Carpachi, N. 1987 (1995 fifth printing). *Excavation and Grading Handbook, Revised*. 2<sup>nd</sup> ed. Craftsman Book Company
- Ellis, B. (Editor). 1997. *Safe & Easy Lawn Care: The Complete Guide to Organic Low Maintenance Lawn*. Houghton Mifflin.
- Harpstead, M.I., T.J. Sauer, and W.F. Bennett. 2001. *Soil Science Simplified*. 4<sup>th</sup> ed. Iowa State University Press.
- Magdoff, F., and H. van Es. 2000. *Building Soils for Better Crops*. 2<sup>nd</sup> ed. Sustainable Agricultural Networks
- McCarthy, D.F. 1993. *Essentials of Soil Mechanics and Foundations, Basic Geotechnics* 4<sup>th</sup> ed. Regents/Prentice Hall.
- Plaster, E.J. 1992. *Soil Science & Management*. 3<sup>rd</sup> ed. Delmar Publishers.
- Union Gas Limited, Ontario, Canada. 1984. *Rehabilitation of Agricultural Lands, Dawn-Kerwood Loop Pipeline; Technical Report*. Ecological Services for Planning, Ltd.; Robinson, Merritt & Devries, Ltd. and Smith, Hoffman Associates, Ltd.
- US Department of Agriculture in cooperation with Cornell University Agricultural Experiment Station. Various years. *Soil Survey of (various names) County, New York*. USDA.

### Internet Access:

- Examples of implements:  
V-Rippers. Access by internet search of *John Deere Ag -New Equipment for 915* (larger-frame model) *V-Rippe*; and, *for 913* (smaller-frame model) *V-Ripper*. Deep, angled-leg subsoiler. Access by internet search of: *Bigham Brothers Shear Bolt Paratill-Subsoiler*.  
[http://salesmanual.deere.com/sales/salesmanual/en\\_NA/primary\\_tillage/2008/feature/rippers/915v\\_pattern\\_frame.html?sbu=ag&link=prodcats](http://salesmanual.deere.com/sales/salesmanual/en_NA/primary_tillage/2008/feature/rippers/915v_pattern_frame.html?sbu=ag&link=prodcats) Last visited March 08.
- Soils data of USDA Natural Resources Conservation Service. *NRCS Web Soil Survey*. <http://websoilsurvey.nrcs.usda.gov/app/> and *USDA-NRCS Official Soil Series Descriptions; View by Name*. <http://ortho.ftw.nrcs.usda.gov/cgi-bin/osd/osdname.cgi> . Last visited Jan. 08.
- Soil penetrometer information. Access by internet searches of: *Diagnosing Soil Compaction using a Penetrometer (soil compaction tester)*, *PSU Extension*; as well as *Dickey-john Soil Compaction Tester*.  
<http://www.dickey-johnproducts.com/pdf/SoilCompactionTest.pdf> and <http://cropsoil.psu.edu/Extension/Facts/uc178pdf> Last visited Sept. 07

## **SECTION 4**

### **Federal, State or Local NPDES General Permit**

## **SECTION 5**

### **Certifications, Forms, Reports, and Daily Logs**

STORMWATER POLLUTION PREVENTION PLAN  
NOI PERMITTEE'S CERTIFICATION

FORM 1

**Construction Site**  
**WILSON HILL SOLAR**  
**TOWN OF HOOSICK, Rensselaer County, New York**

STORMWATER POLLUTION PREVENTION PLAN DATED August, 2023, revised January, 2024

**NOI PERMITTEE'S CERTIFICATION:**

"I certify under penalty of law that this document was prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that false statements made herein are punishable as a class A misdemeanor pursuant to Section 210.45 of the Penal Law."

NOI Permittee's  
Designated Project Manager: \_\_\_\_\_

Signed: \_\_\_\_\_

Printed Name: \_\_\_\_\_

Position: \_\_\_\_\_

Date: \_\_\_\_\_



**STORMWATER POLLUTION PREVENTION PLAN  
CONTRACTOR'S CERTIFICATION LOG**

**FORM 2**

**Construction Site  
WILSON HILL SOLAR  
TOWN OF HOOSICK, Rensselaer County, New York**

<b>Company Name</b>	
<b>Address</b>	
<b>Contact Name</b>	
<b>Telephone Number</b>	
<b>Cell Phone/Pager</b>	
<b>Scope of Services</b>	
<b>Certification Date</b>	

<b>Company Name</b>	
<b>Address</b>	
<b>Contact Name</b>	
<b>Telephone Number</b>	
<b>Cell Phone/Pager</b>	
<b>Scope of Services</b>	
<b>Certification Date</b>	

<b>Company Name</b>	
<b>Address</b>	
<b>Contact Name</b>	
<b>Telephone Number</b>	
<b>Cell Phone/Pager</b>	
<b>Scope of Services</b>	
<b>Certification Date</b>	

Designated Project Manager \_\_\_\_\_

**STORMWATER POLLUTION PREVENTION PLAN  
CONTRACTOR'S/SUBCONTRACTOR'S CERTIFICATION  
FORM 3**

*This form to be completed for each contractor listed on Form 2. Reproduce as needed*

**Construction Site  
WILSON HILL SOLAR  
TOWN OF HOOSICK, Rensselaer County, New York  
CONSTRUCTION POLLUTION PREVENTION PROGRAM  
DATED August, 2023, revised January, 2024**

**CONTRACTOR'S CERTIFICATION:**

“I hereby certify under penalty of law that I understand and agree to comply with the terms and conditions of the SWPPP and agree to implement any corrective actions identified by the *qualified inspector* during a site inspection. I also understand that the *owner or operator* must comply with the terms and conditions of the most current version of the New York State Pollutant Discharge Elimination System (“SPDES”) general permit for stormwater discharges from construction activities and that it is unlawful for any person to cause or contribute to a violation of water quality standards. Furthermore, I am aware that there are significant penalties for submitting false information, that I do not believe to be true, including the possibility of fine and imprisonment for knowing violations.”

The Contractor/Subcontractor further understands that the SWPPP and associated Erosion and Sediment Control Plans represent the **MINIMUM** erosion and sediment control measures that will be required to protect the site during construction. Additional erosion and sediment control measures will be necessary during construction. It will be the responsibility of Contractor/Subcontractor to implement all additional erosion and sediment control measures necessary to protect the site during construction.

**CONTRACTOR:**

Name (Print): \_\_\_\_\_

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

Title: \_\_\_\_\_

Company Name: \_\_\_\_\_

Address: \_\_\_\_\_  
\_\_\_\_\_

Phone: \_\_\_\_\_

**SUBCONTRACTOR:**

Name (Print): \_\_\_\_\_

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

Title: \_\_\_\_\_

Company Name: \_\_\_\_\_

Address: \_\_\_\_\_  
\_\_\_\_\_

Phone: \_\_\_\_\_

Elements of SWPPP Contractor/Subcontractor responsible for: \_\_\_\_\_

Name of Trained Contractor Responsible for SWPPP Implementation: \_\_\_\_\_

Title of Trained Contractor Responsible for SWPPP Implementation: \_\_\_\_\_

**FORM 4**  
**WILSON HILL SOLAR, LLC – WILSON HILL SOLAR**  
**SWPPP # \_\_\_\_\_**

This form to be completed by Contractor's designated inspector at least weekly. Reproduce as needed.

**SWPPP INSPECTION REPORTS**

Page 1 of \_\_\_\_\_  
Date \_\_\_\_\_

**Weather and Soil Conditions**

Weather Conditions: \_\_\_\_\_  
Soil Conditions:     Dry  Wet  Saturated  Snow Covered  Frozen

**Maintaining Water Quality**

**Yes No NA**

- Is there an increase in turbidity causing a substantial visible contrast to natural conditions?
- Is there residue from oil and floating substances, visible oil film, or globules or grease?
- All disturbance is within the limits of the approved plans.
- Have receiving lake/bay, stream, and/or wetland been impacted by silt from project?

**Housekeeping**

1. General Site Conditions

**Yes No NA**

- Is construction site litter and debris appropriately managed?
- Are facilities and equipment necessary for implementation of erosion and sediment control in working order and/or properly maintained?
- Is construction impacting the adjacent property?
- Is dust adequately controlled?

2. Temporary Stream Crossing

**Yes No NA**

- Maximum diameter pipes necessary to span creek without dredging are installed.
- Installed non-woven geotextile fabric beneath approaches.
- Is fill composed of aggregate (no earth or soil)?
- Rock on approaches is clean enough to remove mud from vehicles and prevent sediment from entering stream during high flow.

**Runoff Control Practices**

1. Excavation Dewatering

**Yes No NA**

- Upstream and downstream berms (sandbags, inflatable dams, etc.) are installed per plan.
- Clean water from upstream pool is being pumped to the downstream pool.
- Sediment-laden water from work area is being discharged to a silt-trapping device.
- Constructed upstream berm with one-foot minimum freeboard.

2. Water Bar

**Yes No NA**

- Installed per plan with vehicle crossings stabilized with gravel.
- Outlet located on undisturbed soil or lined with riprap.
- Bar height is 12-inch minimum from bottom of channel with minimum base width of 6-foot.

3. Interceptor Dikes and Swales

**Yes No NA**

- Installed per plan with minimum side slopes 1V:3H or flatter.
- Stabilized by geotextile fabric, seed, or mulch with no erosion occurring.
- Sediment-laden runoff directed to sediment trapping structure.

**FORM 4**  
**WILSON HILL SOLAR, LLC – WILSON HILL SOLAR**  
**SWPPP # \_\_\_\_\_**

This form to be completed by Contractor's designated inspector at least weekly. Reproduce as needed.

**SWPPP INSPECTION REPORT**

Page 2 of \_\_\_\_\_  
Date \_\_\_\_\_

**4. Stone Check Dam**

**Yes No NA**

- Is channel stable? (flow is not eroding soil underneath or around the structure).
- Check is in good condition (rocks in place and no permanent pools behind the structure).
- Has accumulated sediment been removed?

**5. Rock Outlet Protection**

**Yes No NA**

- Installed per plan.
- Installed concurrently with pipe installation.

**Soil Stabilization**

**1. Topsoil and Spoil Stockpiles**

**Yes No NA**

- Stockpiles are stabilized with vegetation and/or mulch.
- Sediment control is installed at the toe of the slope.

**2. Revegetation**

**Yes No NA**

- Temporary seedings and mulch have been applied to idle areas.
- Four inches minimum of topsoil has been applied under permanent seedings.

**Sediment Control Practices**

**1. Stabilized Construction Entrance**

**Yes No NA**

- Stone is clean enough to effectively remove mud from vehicles.
- Installed per standards and specifications?
- Does all traffic use the stabilized entrance to enter and leave site?
- Is adequate drainage provided to prevent ponding at entrance?

**2. Silt Fence**

**Yes No NA**

- Installed on Contour, ten feet from toe of slope (not across conveyance channels).
  - Joints constructed by wrapping the two ends together for continuous support.
  - Fabric buried six inches minimum.
  - Posts are stable, fabric is tight and without rips or frayed areas.
- Sediment accumulation is \_\_\_\_\_% of design capacity.

**3. Storm Drain Inlet Protection (Use for Stone & Block; Filter Fabric; Curb; or, Excavated practices)**

**Yes No NA**

- Installed concrete blocks lengthwise so open ends face outward, not upward.
  - Placed wire screen between No. 3 crushed stone and concrete blocks.
  - Drainage area is one acre or less.
  - Excavated area is 900 cubic feet.
  - Excavated side slopes should be 2:1.
  - 2" x 4" frame is constructed and structurally sound.
  - Posts three-foot maximum spacing between posts.
  - Fabric is embedded 1 to 1.5 feet below ground and secured to frame/posts with staples at maximum eight inch spacing.
  - Posts are stable, fabric is tight and without rips or frayed areas.
- Sediment accumulation \_\_\_\_\_% of design capacity.

**FORM 4**  
**WILSON HILL SOLAR, LLC – WILSON HILL SOLAR**  
**SWPPP # \_\_\_\_\_**

This form to be completed by Contractor's designated inspector at least weekly. Reproduce as needed.

**SWPPP INSPECTION REPORT**

Page 3 of \_\_\_\_\_  
Date \_\_\_\_\_

**4. Temporary Sediment Trap**

**Yes No NA**

Outlet structure is constructed per the approved plan or drawing.

Geotextile fabric has been placed beneath rock fill.

Sediment accumulation is \_\_\_\_\_% of design capacity.

**5. Temporary Sediment Basin**

**Yes No NA**

Basin and outlet structure constructed per the approved plan.

Basin side slopes are stabilized with seed/mulch.

Drainage structure flushed and basin surface restored upon removal of sediment basin facility.

Sediment accumulation is \_\_\_\_\_% of design capacity.

**Dust Control Practices**

**1. Haul Road and Current Work Areas**

**Yes No NA**

Are all traffic surface areas sufficiently treated to prevent fugitive dust?

Are any areas of site's non-traffic and work area experiencing wind erosion?

Are there any disturbed areas in need of temporary seed and mulch to protect surface from wind erosion?

Is watering truck on-site?

Is dust visible in air at any location of the site?

**Note:** Not all erosion and sediment control practices are included in this listing. Add additional pages to this list as required by site-specific design.

Construction inspection checklists for post-development stormwater management practices can be found in Appendix F of the New York Stormwater Management Design Manual.

Description of condition of runoff at all points of discharge from the construction site. (This shall include identification of discharges of sediment from the construction site. Include discharges from conveyance systems (i.e. pipes, culverts, ditches, etc.) and overland flow.) \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

Description of areas that are disturbed at the time of the inspection and areas that have been stabilized (temporary and/or final) since the last inspection (see Page 5 for Sketch). \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_



**STORMWATER POLLUTION PREVENTION PLAN  
MODIFICATION REPORT  
FORM 5**

*This form to be used only when Contractor's designated inspector believes changes to the SWPPP and/or Erosion and Sediment control plans is warranted. For example, additional erosion control measures needed or removal of specific control measures can be done without adverse impact. This form must be approved by Designated Project Manager prior to implementation.*

**Construction Site  
WILSON HILL SOLAR  
TOWN OF HOOSICK, Rensselaer County, New York**

**CHANGES REQUIRED FOR STORMWATER POLLUTION PREVENTION PLAN**

<b>To:</b>	<b>Designated Project Manager</b>	<b>Date:</b>
<b>Address:</b>		
<b>Telephone:</b>		
<b>Facsimile:</b>		
<b>Sent Via:</b>	<input type="checkbox"/> <b>Facsimile</b>	<input type="checkbox"/> <b>E-mail</b> <input type="checkbox"/> <b>US Mail</b>

INSPECTOR: \_\_\_\_\_ DATE: \_\_\_\_\_  
(Print)

\_\_\_\_\_  
(Signature)

QUALIFICATIONS OF INSPECTOR: \_\_\_\_\_

CHANGES REQUIRED TO THE STORMWATER POLLUTION PREVENTION PLAN: \_\_\_\_\_

\_\_\_\_\_  
\_\_\_\_\_

REASONS FOR CHANGES: \_\_\_\_\_

\_\_\_\_\_  
\_\_\_\_\_

TO BE PERFORMED BY: \_\_\_\_\_ ON OR BEFORE: \_\_\_\_\_

APPROVED BY DESIGNATED PROJECT MANAGER \_\_\_\_\_ DATE: \_\_\_\_\_

**STORMWATER POLLUTION PREVENTION PLAN  
RECORD OF STABILIZATION AND CONSTRUCTION ACTIVITIES  
FORM 6**

**Construction Site  
WILSON HILL SOLAR**

**TOWN OF HOOSICK, Rensselaer County, New York**

A record of dates when major grading activities occur, when construction activities temporarily or permanently cease on a portion of the site, and when stabilization measures are initiated shall be maintained until final site stabilization is achieved and the Notice of Termination is filed. *Reproduce copies of this form as needed.*

**MAJOR GRADING, CONSTRUCTION, OR STABILIZATION ACTIVITIES**

Description of Activity: \_\_\_\_\_

Begin Date: \_\_\_\_\_ Site Contractor: \_\_\_\_\_

Location: \_\_\_\_\_

End Date: \_\_\_\_\_

Description of Activity: \_\_\_\_\_

Begin Date: \_\_\_\_\_ Site Contractor: \_\_\_\_\_

Location: \_\_\_\_\_

End Date: \_\_\_\_\_

Description of Activity: \_\_\_\_\_

Begin Date: \_\_\_\_\_ Site Contractor: \_\_\_\_\_

Location: \_\_\_\_\_

End Date: \_\_\_\_\_

Description of Activity: \_\_\_\_\_

Begin Date: \_\_\_\_\_ Site Contractor: \_\_\_\_\_

Location: \_\_\_\_\_

End Date: \_\_\_\_\_

Description of Activity: \_\_\_\_\_

Begin Date: \_\_\_\_\_ Site Contractor: \_\_\_\_\_

Location: \_\_\_\_\_

End Date: \_\_\_\_\_

**Designated Project Manager** \_\_\_\_\_



**STORMWATER POLLUTION PREVENTION PLAN  
RECORD OF TEMPORARY EROSION AND SEDIMENT CONTROL PRACTICES  
FORM 6A**

**Construction Site  
WILSON HILL SOLAR**

**TOWN OF HOOSICK, Rensselaer County, New York**

A record of the timing of temporary erosion and sediment control practices to be implemented, including the timing of initial placement and the duration that each practice should remain in place. The record may reflect the actual date of planned installation or the specific construction activity with which it will be associated. The timing of removal may reflect an actual date or the length of time over which the practice will be implemented.

**TEMPORARY EROSION AND SEDIMENT CONTROL PRACTICES**

Description of Practice: \_\_\_\_\_

Date/Timing of Initial Placement: \_\_\_\_\_ Site Contractor: \_\_\_\_\_

Location: \_\_\_\_\_

Projected Date/Timing of Removal: \_\_\_\_\_

Description of Practice: \_\_\_\_\_

Date/Timing of Initial Placement: \_\_\_\_\_ Site Contractor: \_\_\_\_\_

Location: \_\_\_\_\_

Projected Date/Timing of Removal: \_\_\_\_\_

Description of Practice: \_\_\_\_\_

Date/Timing of Initial Placement: \_\_\_\_\_ Site Contractor: \_\_\_\_\_

Location: \_\_\_\_\_

Projected Date/Timing of Removal: \_\_\_\_\_

Description of Practice: \_\_\_\_\_

Date/Timing of Initial Placement: \_\_\_\_\_ Site Contractor: \_\_\_\_\_

Location: \_\_\_\_\_

Projected Date/Timing of Removal: \_\_\_\_\_

Description of Practice: \_\_\_\_\_

Date/Timing of Initial Placement: \_\_\_\_\_ Site Contractor: \_\_\_\_\_

Location: \_\_\_\_\_

Projected Date/Timing of Removal: \_\_\_\_\_

**Designated Project Manager** \_\_\_\_\_

YEAR 20\_\_

STORMWATER POLLUTION PREVENTION PLAN  
PROJECT RAINFALL LOG (to be completed by Contractor)

FORM 7

Month	Jan	Feb	Mar	Apr	May	June	July	Aug	Sep	Oct	Nov	Dec
Day												
1												
2												
3												
4												
5												
6												
7												
8												
9												
10												
11												
12												
13												
14												
15												
16												
17												
18												
19												
20												
21												
22												
23												
24												
25												
26												
27												
28												
29												
30												
31												
PM Initials												

NOI Permittee: WILSON HILL SOLAR, LLC  
WILSON HILL SOLAR

**STORMWATER POLLUTION PREVENTION PLAN**

**FINAL STABILIZATION CERTIFICATION /NOTICE OF TERMINATION CHECKLIST**

**FORM 8**

*This form is to be completed by Contractor and submitted to Designated Project Manager for approval only after Contractor believes all work regulated by SWPPP is complete.*

**Construction Site  
WILSON HILL SOLAR  
TOWN OF HOOSICK, Rensselaer County, New York**

1.  All soil disturbing activities are complete.
2.  Temporary Erosion and Sediment Control Measures have been removed or will be removed at the appropriate time.
3.  All areas of the Construction Site not otherwise covered by a permanent pavement or structure have been stabilized with a uniform perennial vegetative cover with a density of 85% or equivalent measures have been employed.

**CONTRACTOR'S CERTIFICATION:**

*“I certify under penalty of law that all storm water discharges associated with industrial activity from the identified project that are authorized by NPDES general permit have been eliminated and that all disturbed areas and soils at the construction site have achieved Final Stabilization and all temporary erosion and sediment control measures have been removed or will be removed at the appropriate time.”*

Company Name \_\_\_\_\_

Name (Print) \_\_\_\_\_

Signature \_\_\_\_\_

Date \_\_\_\_\_

APPROVED BY DESIGNATED PROJECT MANAGER \_\_\_\_\_ DATE: \_\_\_\_\_

## **SECTION 6**

### **Supplemental Information**

- 1. Stormwater Management Narrative – Appendices and Figures Available Upon Request**
- 2. FEMA Flood Mapping**
- 3. NYSDEC Environmental Resource Mapper**
- 4. SHPO Letter of No Effect**
- 5. Soils Report (USDA)**
- 6. USFW IPAC Results**

# **Stormwater Management Narrative**

## **Wilson Hill Road Solar Array**

**469 Wilson Hill Road  
Town of Hoosick  
Rensselaer County, New York**

**Applicant:**

**Wilson Hill Solar, LLC  
101 Summer Street, 2<sup>nd</sup> Floor  
Boston, MA 02110**

***JUNE 2023***

*Revised February, 2024*

Prepared By:

The Environmental Design Partnership, LLP  
900 Route 146  
Clifton Park, NY 12065

## TABLE OF CONTENTS

### Contents

1.0	Introduction .....	3
2.0	Redevelopment Justification .....	3
3.0	Existing Conditions.....	4
3.1	Soil and Groundwater Conditions .....	4
4.0	Predevelopment Stormwater Analysis .....	5
5.0	Stormwater Management Planning and Practice Selection .....	6
6.0	Post-Development Stormwater Analysis .....	6
6.1	Stormwater Management Areas #1 through #4 – Bioretention Areas .....	8
6.2	Stormwater Management Area #5 – Wet Pond.....	8
6.3	Redevelopment Criteria .....	8
6.3.1	<i>Water Quantity</i> .....	8
6.3.2	<i>Channel Protection</i> .....	9
6.3.3	<i>Water Quality (WQ<sub>v</sub>)</i> .....	9
6.3.4	<i>Runoff Reduction Volume (RR<sub>v</sub>)</i> .....	11
7.0	NYSDEC Solar Panel Construction Guidance Stormwater Analysis.....	12
8.0	Summary .....	14

### Figures

Figure 1 – Site Location Map

Figure 2 – Pre-development Drainage Map

Figure 3 – Post-development Drainage Map

### Attachments

Attachment A – WQ<sub>v</sub> Calculations

Attachment B – Stormwater Modeling Calculations

---

## 1.0 Introduction

Wilson Hill Solar, LLC is proposing the development of a solar farm on an existing parcel of land totaling approximately 99.52± acres located on the northern side of Wilson Hill Road in the Town of Hoosick, New York. The proposed site development includes a solar farm which consists of approximately 7.11± acres of solar panels spaced 30.0± feet center to center and the construction of approximately 2,250± linear feet (LF) of access road, stormwater management areas, and eight-foot-high perimeter fencing. The total area of proposed disturbance is approximately 27.1± acres and 7.55± acres of impervious area will be added to the site from the existing 0.4± acres of impervious area.

A stormwater management system has been designed to provide pollutant removal, reduce channel erosion, prevent overbank flooding, and safely control extreme flood events in accordance with the NYS Stormwater Management Design Manual (Design Manual). The NYS Department of Environmental Conservation (NYSDEC) issued specific guidance in April 2018 relative to stormwater management design considerations for solar panel installations. The temporary erosion control measures and post-construction stormwater management systems for this project have been designed in accordance with those guidelines and subsequent discussions with the NYSDEC relative to their guidelines. Section 7.0 of this report addresses specific solar panel application guidance.

The proposed stormwater management system for the project will include roadside swales, attenuation ponds, bioretention areas, and a wet pond designed to convey runoff from the proposed gravel or paved stormwater access roads, solar panels, and the solar equipment pad. Runoff from the impervious access road and solar panels is directed into vegetated swales that discharge into bioretention areas or a wet pond. Additional roadside swales are proposed to direct stormwater runoff from the solar panel array into attenuation ponds to protect against washouts.

This narrative presents a review of the design concepts and parameters of the stormwater management system for the proposed increased impervious areas, in accordance with NYSDEC solar application guidance, including the access roads and the equipment pads. The purpose of the stormwater management narrative is to assure that changes in the surface runoff characteristics, as a result of the proposed construction, will not adversely impact adjacent or downstream properties. On-site stormwater management will be implemented in accordance with the Design Manual and NYSDEC solar application guidance to accommodate both additional stormwater runoff and to provide water quality treatment according to the green infrastructure standards.

## 2.0 Redevelopment Justification

Redevelopment Activity is defined as “...the disturbance and reconstruction of existing impervious area, including impervious areas that were removed from a project site within five (5) years of preliminary project plan submission to the local government (i.e. site plan,

---

subdivision, etc.)”, according to the NYSDEC SPDES General Permit GP-0-20-001 for Stormwater Discharges from Construction Activity.

The proposed solar facility will be constructed on an abandoned farm field. As part of the proposed development, a section of an existing impervious roadway will be improved. Therefore, this project is considered a redevelopment project.

The Design Manual states several of the challenges encountered during redevelopment projects include “...the need to tie in to the existing drainage infrastructure... ...the presence of underground utilities, incompatible surrounding land usages, highly compacted soils that are not suitable for infiltration, and contaminated soils that require mitigation.”

Due to these constraints, the Design Manual offers “alternative sizing criteria” which differs from the standards and sizing criteria listed in other portions of the manual. These standards include:

- **Water Quantity:** Analyzing how redevelopment and new development activities change the existing hydrology and discharge rates from the project site.
- **Channel Protection:** Channel protection is known as stream channel protection, designed to protect stream channels from erosion. It is accomplished by providing 24-hour extended detention of the one-year, 24-hour storm event. For redevelopment projects, channel protection is not required if the post-construction 1-year 24-hour discharge rate and velocity is less than or equal to the pre-construction discharge rate.
- **Water Quality:** Water quality volumes must be treated for redevelopment projects by implementing conventional treatment standards, alternative treatment standards, or a combination of both.

The proposed redevelopment meets the alternative sizing criteria put forth in the Design Manual; more detail will be provided in Section 6 of this report.

### **3.0 Existing Conditions**

The site generally consists of a farm field with small patches of wooded areas. The topography of the land consists of drainage from northeast to southwest. The typical slopes in the area of proposed development range from 10% to 20%, with localized areas over 30%. Elevations at the site vary between 734 and 1087 feet above sea level.

#### **3.1 Soil and Groundwater Conditions**

The USDA Natural Resources Conservation Service Soil Survey identifies the soils on the site, in the area of proposed development, to consist of sandy to silty loams, which range from somewhat poorly drained to moderately well drained, and which are predominantly classified as Hydrologic Soil Group (HSG) C/D. The results from the USDA Natural Resources Conservation Service Soil Survey (Soil Survey) are included in Section 6 of the SWPPP.



## 4.0 Predevelopment Stormwater Analysis

The existing hydrologic conditions, in the area to be disturbed as a result of the proposed construction, were analyzed using Applied Microcomputer Systems' "HydroCAD" computer modeling program. The HydroCAD stormwater modeling program employs the United States Department of Agriculture's Soil Conservation Service (SCS) Technical Release 20 (TR-20) method for stormwater analysis. Using this modeling technique, the site is divided into "subcatchments" that represent specific areas contributing stormwater runoff to an existing, or proposed drainage feature. The subcatchments typically flow through "reaches" (i.e., swales, channels, or pipes) that convey the stormwater to storm basins or discharge areas.

A hydrologic model of the existing site was prepared using the Hydrocad program. Five (4) subcatchments were used to represent the existing drainage condition, see Figure 2.

The existing parameters of topography, vegetation, slope and soil type are all incorporated into the predevelopment model.

Table 1 presents a summary of the pre-development stormwater peak discharge for the 1 year, 10 year and 100-year design storm events at the respective Design Points. As will be discussed in subsequent sections, the post development stormwater discharge rate has been limited to the predevelopment discharge rate for the 1-year, 10-year, and 100-year storm events.

**Table 1: Pre-Development Runoff Rates**

Storm Event	Design Point Discharge (cfs)					Total Discharge offsite (cfs)
	OFFA	OFFB	OFFC	OFFD	OFFE	
1-Year (2.19")	7.92	9.21	1.72	1.09	2.50	20.41
10-Year (3.63")	24.66	30.68	5.54	3.35	10.70	70.73
50-Year (5.18")	40.17	50.98	9.05	5.44	15.29	119.29
100-Year (6.05")	47.36	60.34	10.66	6.40	22.81	141.81

The pre-development Curve Numbers (CN) for the existing ground covers are listed in Table 2.

**Table 2: Pre-Development Ground Cover**

Pre-Development Ground Cover Description	Curve Number
Gravel Surface, HSG C/D	96
Meadow non-grazed, HSG D	78
Meadow non-grazed, HSG C	71
Woods, Fair HSG D	79

The weighted CN for the pre-development conditions for the site is approximately 79. The HydroCAD model results for the pre-development conditions are included within Attachment B.

Design Point OFFA conveys flows to the neighboring property to the south. Design Point OFFB, OFFC, and OFFD conveys flows to a low point off the property in the southeastern direction. Design Point OFFE includes runoff from the existing gravel access drive that flows to the south into a roadside ditch.

## 5.0 Stormwater Management Planning and Practice Selection

The site layout and stormwater design for this project was completed while taking into consideration the potential impacts on the existing site and downstream hydrology. Stormwater runoff from the existing site predominately sheet flows to areas to the south of the site. The stormwater management system will replicate similar practices.

Stormwater from impervious areas on the site is designed to be treated with bioretention areas with underdrains and a wet pond. This design method was considered ideal on this site given the steep topography which eliminates the possibility of using a majority of other treatment practices. Bioretention areas are considered standard stormwater management practices with runoff reduction volume capacity and wet ponds are only considered standard stormwater management practices.

The total disturbance for the project will be on the order of 27.1± acres. The proposed redevelopment will result in an increase of impervious cover by 7.55± acres.

## 6.0 Post-Development Stormwater Analysis

The post-development conditions were analyzed using the HydroCAD computer modeling program.

Twelve (12) subcatchments were used to represent the post development drainage conditions of the site in the areas of the proposed development. Site improvements to the property will consist of a solar farm which will include 7.11± acres of solar panels, approximately 2,250± LF of

access road, a solar electrical equipment pad, and chain link fencing. Also included, as permanent elements of the development, are the on-site stormwater management areas. Stormwater management practices have been designed to provide storage, treatment, and attenuation of stormwater runoff from the proposed impervious surfaces on the site.

Stormwater runoff from the proposed impervious access road, solar panels, and solar electrical equipment pads will flow into vegetated swales which will convey flows to five (5) stormwater management areas, designed as bioretention areas and a wet pond.

Runoff from the undeveloped site perimeter, outside of the stormwater management areas, will sheet flow off site, which is similar to predevelopment drainage patterns. In areas with slopes greater than 5% where solar panels will be installed, overland flow dispersion devices will be installed on 100-foot intervals. The overland flow dispersion devices will maintain sheet flow patterns similar to predevelopment conditions.

The post-development ground cover Curve Numbers (CN) are listed in Table 3.

**Table 3: Post-Development Ground Cover**

Post-Development Ground Cover Description	Curve Number
Meadow, non-grazed, HSG D	78
Meadow, non-grazed, HSG C	71
Gravel Access Road	96
Improved Entrance Road, Equipment Pad	98
Woods, Fair HSG D	79
>70% Grass Cover, Good, HSG D	80

The weighted CN for the post-development conditions for the site is approximately 79. The HydroCAD model results for the post-development conditions are included within Attachment B. The contributing area to each stormwater management area is identified on Figure 3.

Table 4 presents a summary of the post-development stormwater peak discharge for the 1 year, 10 year and 100-year design storm events at the respective Design Points.

**Table 4: Post-Development Runoff Rates**

Storm Event	Design Point Discharge (cfs)					Total Discharge offsite (cfs)
	OFFA	OFFB	OFFC	OFFD	OFFE	
1-Year (2.19")	1.65	2.61	1.24	0.37	2.44	7.25
10-Year (3.63")	5.16	28.13	4.78	2.10	9.96	50.13
50-Year (5.18")	8.41	49.42	8.78	4.67	17.42	88.70
100-Year (6.05")	9.92	57.82	9.87	5.76	20.96	104.33

### **6.1 Stormwater Management Areas #1 through #4 – Bioretention Areas**

Stormwater Management Areas (SMA) #1 through #4 are designed as bioretention areas with underdrains. They will provide detention and treatment of stormwater runoff from the improved access road, solar panels, and equipment pad.

Stormwater runoff contributing to SMA #1 and #2 will sheet flow from the existing slope into forebays that will distribute into bioretention areas. Runoff contributing to SMA #3 and #4 will be collected in swales located adjacent to the roadway.

Stormwater runoff contributing to SMA #1 through #4 will receive pretreatment through the forebays that convey flows to the proposed SMAs. According to the Design Manual, a minimum pretreatment volume of 10% of the WQv must be provided.

### **6.2 Stormwater Management Area #5 – Wet Pond**

Stormwater Management Area (SMA) #5 is designed as a wet pond. It will provide the primary detention and treatment of stormwater runoff from the solar panels.

Stormwater runoff contributing to SMA #1 will be collected in vegetated swales located adjacent to the solar panels and will receive pretreatment through the sediment forebays within the wet pond. According to the Design Manual, a minimum pretreatment volume of 10% of the WQv must be provided.

### **6.3 Redevelopment Criteria**

Chapter 9 of the Design Manual states specific sizing criteria for water quantity, channel protection, and water quality volume as described below in the following sections.

#### **6.3.1 Water Quantity**

In accordance with Chapter 9 of the Design Manual, if the redevelopment results in no change to hydrology that increases the discharge rate from the project site, the 10-Year and 100-Year criteria do not apply.

The 1-Year, 10-Year, and 100-Year storm events were analyzed using HydroCAD under the post-development conditions shown in Figure 3. The following table presents the pre-development and post development discharge rates for discharges off the site. As indicated, the post development discharge rate is less than the predevelopment rate, and therefore, no additional water quantity controls are required.

**Table 5: Water Quantity Summary**

Storm Event	Predevelopment Runoff (CFS)	Post development Runoff (CFS)	Runoff Reduction (CFS)
1-Year (2.19")	20.41	7.25	13.16
10-Year (3.63")	70.73	50.13	20.60
50-Year (5.18")	119.29	88.70	30.59
100-Year (6.05")	141.81	104.33	37.48

### 6.3.2 Channel Protection

For redevelopment projects, channel protection is not required if there are no changes to hydrology that increase the discharge rate from the project site. But as shown in the HydroCAD analysis the bioretention areas and wet pond attenuate a 1-year 24-hour storm for at least 24 hours.

### 6.3.3 Water Quality (WQ<sub>v</sub>)

Chapter 9 of the Design Manual lists several options for providing water quality treatment on a redevelopment project. These options include the following:

1. Reduce the existing impervious cover by a minimum of 25% of the total disturbed, impervious area.
2. Treat at least 25% of the Water Quality Volume (WQ<sub>v</sub>) from the disturbed, impervious area through the implementation of standard stormwater management practices or by reduction through the implementation of green infrastructure techniques.
3. Propose the use of alternative SMPs to treat at least 75% of the WQ<sub>v</sub> from the disturbed impervious area, as well as any additional runoff from tributary areas that are not within the disturbed, impervious area.
4. Use a combination of impervious cover reduction and standard alternative SMPs that provide a weighted average of at least two of the above methods using the following formula: %WQ<sub>v</sub> treatment by Alternative Practice = (25 – (% IC Reduction + % WQ<sub>v</sub> treatment by Standard Practice + % Runoff Reduction))\*3

The proposed development uses Option 2 to meet the Water Quality Treatment requirements but the bioretention areas and wet pond are sized to treat 100% of all disturbed impervious areas on the site. The Design Manual allows for a runoff reduction equivalent to the water quality volume associated with this practice.

The runoff reduction for the bioretention area is on the order of 6,454 CF. Attachment A contains the WQ<sub>v</sub> and RR<sub>v</sub> calculations for the bioretention areas.

The proposed solar farm includes both redevelopment and new development activities. As such, the new development portions of the project have been designed in accordance with the sizing criteria in Chapter 4 of the Design Manual.

In general, small storm events and the initial runoff from larger storm events are an environmental concern as this stormwater runoff typically contains roadway pollutants and thermal energy stored by the asphalt. In accordance with the Design Manual, this initial runoff is designated as the Water Quality Volume (WQ<sub>v</sub>) and special attention is given to this volume of runoff to meet water quality objectives.

The water quality storage volume, WQ<sub>v</sub>, is calculated as follows:

$$WQ_v = \frac{P \cdot R_v \cdot A}{12}$$

Where: WQ<sub>v</sub> = water quality volume (acre-feet)

P = 90% rainfall event number

R<sub>v</sub> = 0.05+0.009(I), where I is percent impervious cover excluding 75% of redevelopment impervious area (Option 2 above)

A = site area (acres), impervious area used with I = 100%

Table 6 below lists the required water quality volume for each stormwater management area in the areas of new development.

**Table 6:** Required Water Quality Volume

SMA I.D.	P	R <sub>v</sub>	A (AC)	Required WQ <sub>v</sub> (cf)	Provided WQ <sub>v</sub> (cf)
SMA#1	1.1	0.36	4.85	6,970	6,970
SMA#2	1.1	0.38	4.15	6,291	6,291
SMA#3	1.1	0.36	0.58	835	835
SMA#4	1.1	0.36	11.49	16,381	16,381
SMA#5	1.1	0.38	0.88	1,326	1,326
TOTAL				31,803	31,803

The required treatment for the proposed impervious access road south of station 8+00 is on the order of 625 CF using redevelopment calculations with 0.21 acres of existing impervious area and 0.11 acres of new impervious area. Not taking account for the redevelopment of the access road north of station 8+00 the proposed treatment areas are treating 1,176 CF more that the require WQv if it was calculated with redevelopment in mind. Therefore, the overtreatment of the northern part of the access road accounts for the untreated areas south of station 8+00.

#### 6.3.4 Runoff Reduction Volume (RRv)

The Design Manual specifies that runoff shall be reduced by 100% of the site WQv using standard SMPs with RRv capacity and green infrastructure techniques. The proposed project area is approximately 27.1± acres with a total proposed impervious area on the order of 7.95± acres. The resulting WQv for the site coverage is computed as 31,803± CF.

Site constraints, including poor soils and steep topography prohibit the ability to meet 100% of the RRv reduction. The minimum RRv for the site has been calculated as 6,281 CF. See Attachment A for the minimum RRv calculations.

##### 6.3.4.1 Green Infrastructure Practices

The proposed impervious area on the site will be treated through a combination of SMA's #1 through #5. The SMA's have been designed to increase the time of concentration and reduce the peak discharge. The runoff reduction for the SMA's is on the order of 6,454 CF. Attachment A contains WQv and RRv calculations for this Green Infrastructure Practice. Attachment A contains the WQv and RRv calculations for this green infrastructure practice. Table 7 provides a summary of the runoff reduction provided.

**Table 7: Runoff Reduction Volume Summary**

Runoff Reduction Technique	RRv (cf)
B1 (Bioretention Area)	2,856
B2 (Bioretention Area)	2,678
B3 (Bioretention Area)	343
B4 (Bioretention Area)	576
<b>Total Site Reduction</b>	<b>6,454</b>
<b>Minimum RRv</b>	<b>6,281</b>
<b>% of Min. RRv</b>	<b>103%</b>

Many of the green infrastructure practices recommended in the Design Manual were not applied to the stormwater management design on this site due to either site restrictions or the use of more feasible green infrastructure or standard SMP techniques in place of more

restrictive and/or maintenance intensive practices. The following table discusses why the unused green infrastructure practices were not feasible.

**Table 8: Non-Feasible Green Infrastructure Practices**

<b>Green Infrastructure Practice</b>	<b>Reason use is not feasible</b>
Conservation of Natural Areas	Existing natural areas on site will be conserved to the greatest extent possible, solar facilities are considered temporary in nature, however the added reduction is minimal.
Porous Pavement	Porous Pavement is not economically feasible on this site.
Tree Planting/Tree box	Trees will be saved on the site as possible to conserve the natural areas. Trees will also be planted to maintain a buffer from the roadway and viewshed to the proposed site, though the resulting runoff reduction value for adding additional trees is minimal.
Disconnection of Rooftop Runoff	No structures are proposed within the project area
Stream Daylighting	No streams exist on the project site.
Rain Gardens	Rain gardens are not recommended for commercial applications as well as not economically feasible.
Green Roofs	Rooftops are not present on the site.
Stormwater Planters	The proposed practices were deemed more economically feasible and effective as opposed to stormwater planters. Additionally, they require less maintenance.
Rain Barrels/Cisterns	Rain Barrels/Cisterns would require the ability to use the water between storm events which is not feasible for this project type.

## 7.0 NYSDEC Solar Panel Construction Guidance Stormwater Analysis

Due to the increase in solar projects throughout New York State, the Department of Environmental Conservation (NYSDEC) released guidance for solar panel stormwater permitting and stormwater pollution prevention plans (SWPPP) in April 2018. The NYSDEC Solar Panel Construction Guidance (SPCG) classifies solar projects under two separate “Scenarios”. Scenario 1 Solar Projects are considered “...*Land clearing and grading for the purposes of creating vegetated open space...*”. These projects typically require a SWPPP that only addresses erosion and sediment controls. Solar projects are categorized as Scenario 1 if they are designed and constructed in accordance with a specific set of six criteria. Solar projects that aren’t designed and constructed to meet these six (6) criteria are classified as Scenario 2 and require a SWPPP that addresses post-construction stormwater management practices which are designed in accordance with the sizing criteria in the Designed Manual. Table 9 provides an analysis of the



six (6) criteria provided by the NYSDEC SPCG as they pertain to the Northern Gateway Renewables, LLC Solar Farm:

**Table 9: NYSDEC Solar Panel Criteria**

Scenario 1 Criteria	Proposed Solar Farm Design
1. Solar panels are constructed on post or rack systems and elevated off the ground surface.	Solar panels will be installed on mechanically driven posts with approximately 36 inches between the bottom of the panel and existing grade.
2. The panels are spaced apart so that rain water can flow off the down gradient side of the panel and continue to sheet flow across the ground surface*.	Panels are spaced 30± feet from center to center with 15.9± feet between the panel rows (adjacent edge of panel to adjacent edge of panel). The typical width of a solar panel rack is 14.1± feet. The panel spacing is the larger than the panel width, therefore, sheet flow is maintained.
3. For solar panels constructed on slopes, the individual rows of solar panels are generally installed along the contour so rain water sheet flows down slope*.	Panels are constructed generally along the contours to maintain sheet flow. In locations where panels are not along contours, and slopes are greater than 5%, overland flow dispersion devices are spaced at 100 ft apart are proposed to maintain sheet flow down slope in accordance with discussions with NYSDEC.
4. The ground surface below the panels consist of a well-established vegetative cover.	All ground surface below the panels will have well-established vegetative cover in accordance with the “Final Stabilization” noted in Appendix A of the SPDES Construction General Permit (see Section 4 of the SWPPP).
5. The project does not include the construction of any traditional impervious areas.	The proposed project does contain a solar equipment pad and a gravel road, both of which are considered impervious. <b>This project therefore falls under Scenario 2.</b>
6. Construction of the solar panels will not alter the hydrology from pre-to post development conditions.	Based on the analysis performed in this report, the project will create minor disturbance, and add impervious area however, the pre-to post development hydrology will be maintained.

Criteria 5 of the NYSDEC SPCG is not met as traditional impervious area will be added to the site, therefore, this project falls under Scenario 2 and will require post-construction stormwater management controls for impervious areas of the project (gravel access road and equipment pads). This interpretation is also included in the \*\*Notes- Item 5 portion of the NYSDEC SPCG.

\*The NYSDEC SPCG also references the Maryland Department of the Environment’s (MDE) “Stormwater Design Guidance - Solar Panel Installations” memo for further guidance on panel installation. The MDE’s memo provides guidance using two examples of solar panels to provide direction; Example 1 references solar panels which are installed on average slopes less than 5% and Example 2 references solar panels which are installed on average slopes between 5% and 10%.

---

### Example 1- Using Non-Rooftop Disconnection Where the Average Slope $\leq$ 5%

MDE states that in order for solar panels to qualify as non-rooftop disconnect, the disconnection length must be greater than or equal to the solar panel width. The proposed solar panel project uses a rack system with a width of 14.1± feet and a disconnection length of 15.9± feet. The spacing between the panel rows is greater than the width of the solar racks, therefore, the solar panels meet the MDE requirements for runoff treatment under non-rooftop disconnection.

### Example 2- Using Non-Rooftop Disconnection Where the Average Slope $\geq$ 5% but $\leq$ 10%

In this example, the MDE advises the use of level spreaders along the drip edge of the panels to maintain sheet flow and dissipate energy in addition to maintaining a disconnection length greater than or equal to the solar panel width. Areas where slopes are  $\geq$  5%, overland flow dispersion devices are proposed which are parallel to contours in  $\pm$ 100-foot intervals in accordance with the New York State Standards and Specifications for Erosion and Sediment Control (Blue Book) requirements for level spreaders and discussions with NYSDEC representatives regarding the application of the NYSDEC SPCG for use with tracker style systems.

In accordance with the aforementioned guidance, post-construction stormwater management is required for all new impervious areas on the project site. Therefore, SMA #1 through SMA #3 have been designed in accordance with the Design Manual to treat the proposed gravel access road and solar equipment pad. Since this project has been designed in accordance with Criteria 1 through Criteria 4 of the NYSDEC SPCG Criteria, the WQv and RRv requirements for the solar panels do not need to be addressed.

## **8.0 Summary**

Development of the proposed project site will alter the stormwater drainage characteristics of the site; impervious area will be added in the form of a compacted gravel access road, solar panels, and a solar equipment pad. Changes to the stormwater drainage characteristics of the site have been evaluated in accordance with the Design Manual. The proposed stormwater management system has been designed to comply with the recommendations in the Design Manual and the NYSDEC SPCG as it relates to maintaining sheet flow, providing water quality/runoff reduction/channel protection volume, overbank flood control and extreme flood control for new development projects.

stormwater management design includes the use of bioretention areas and attenuation ponds. Stormwater modeling results indicate the ability to reduce the overall post-development discharge rate from the site as summarized in Table 10.


**Table 10:** Reduction in Peak Discharge Rates

Peak Discharge Rates in cfs	1-Year Storm	10-Year Storm	50-Year Storm	100-Year Storm
Pre-Development	20.41	70.73	119.29	141.81
Post-Development	7.25	50.13	88.70	104.33
Overall Reduction (cfs)	13.16	20.60	30.59	37.48

Through the implementation of acceptable stormwater management practices, recommended by the NYS Stormwater Management Design Manual, the proposed project will not adversely affect adjacent or downstream properties.

Prepared by:

The Environmental Design Partnership, LLP



Benjamin Willson, Project Engineer

Reviewed by:



Stephanie Alessandrini, P.E.

## REFERENCES

HydroCAD version 10.0, Applied Microcomputer Systems, Chocura, New Hampshire.

NYSDEC, 1990. "Technical and Operational Guidance Series (5.1.8) Stormwater Management Guidelines for New Development", New York State Department of Environmental Conservation, Division of Water.

NYSDEC, 1992. "Reducing the Impacts of Stormwater Runoff from New Development", New York State Department of Environmental Conservation, Division of Water.

NYSDEC, 2015. "New York State Stormwater Management Design Manual", Center for Watershed Protection, Ellicott City, MD.

Rawls, W.J., Brakensiek, D.L., and Saxton, K. E., 1982. "Estimation of Soil Properties", Transactions of the American Society of Agricultural Engineers, Vol. 25, No. J, pp. 1316-1320.

S.C.S., 1982. "TR-20 Project Formulation-Hydrology, Technical Release No. 20", U.S. Department of Agriculture, Soil Conservation Service, Hydrology Unit Division of Engineering.

United States Department of Agriculture, Web Soil Survey. Retrieved from <https://websoilsurvey.sc.egov.usda.gov>

NYSDEC, 2018. "Solar Panel Construction Stormwater Permitting/ SWPPP Guidance", New York State Department of Environmental Conservation, Division of Water.

MDE,2000. "2000 Maryland Stormwater Design Manual, Volumes I and II". Maryland Department of the Environment

MDE. "Stormwater Design Guidance- Solar Panel Installations". Maryland Department of the Environment

## Figures

1. Site Location map
2. Pre-Development Drainage Map
3. Post Development Drainage Map


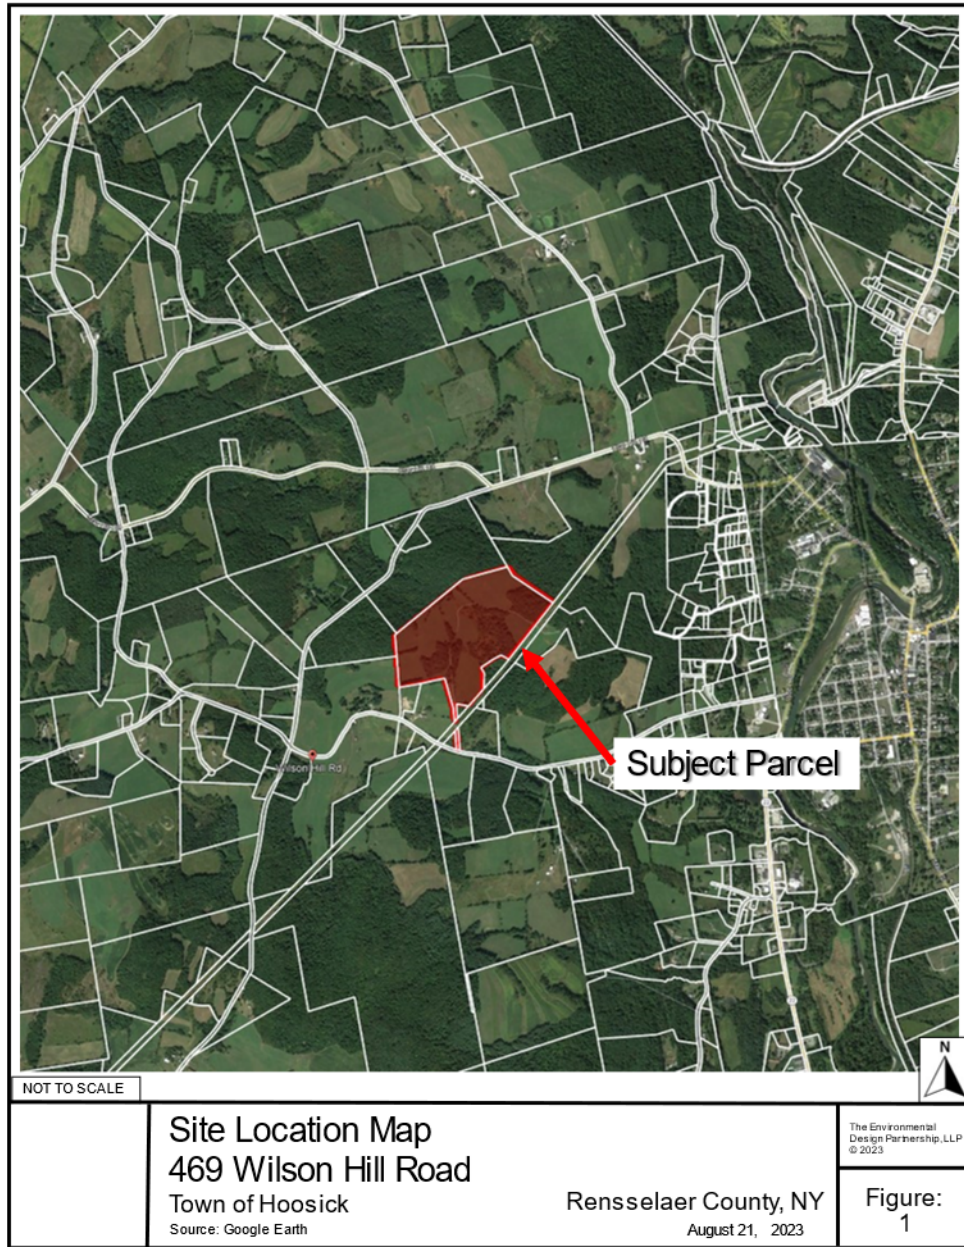


Figure 1: Site Location Map

MAP KEY	
	SUBCATCHMENT BOUNDARY
	SUBCATCHMENT I.D.
	STORMWATER DEVICE
	DESIGN POINT
	TC PATH

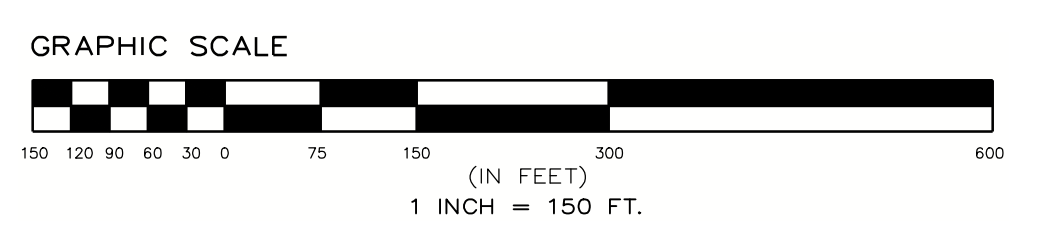


FOR MUNICIPAL APPROVAL ONLY - NOT INTENDED FOR CONSTRUCTION

C:\Users\NWilson\Environmental\Design\Partnership\SharePoint\Site - Documents\A\X\RENSSELAER\HOOICK\Wilson Hill Road\469 - Nexamp\_S30r\05-09\p\Tentative\FIGURES\2023-8-7\STORMWATER.dwg Feb 22, 2024 10:02:22AM

101 Summer Street, Boston, MA 02110  
Tel: (617) 431-1440 Fax: (978) 416-2525 Web: nexamp.com

ENVIRONMENTAL DESIGN PARTNERSHIP, LLP.  
300 Route 44E Clifton Park, New York 12065  
(518) 371-7621

Rev	Issued For	Date
A	PRELIM. PLAN SET	5/22/2023
B	INTERNAL COMMENTS	8/10/2023
C	INTERNAL COMMENTS	9/15/2023
D	ACCESS ROAD REVISIONS	10/27/2023
E	ACCESS ROAD REVISIONS	11/17/2023
F	INTERNAL REVISIONS	11/30/2023
G	REVISIONS PER TDE COMMENTS	1/29/2024
H	REVISIONS PER TDE COMMENTS	2/26/2024

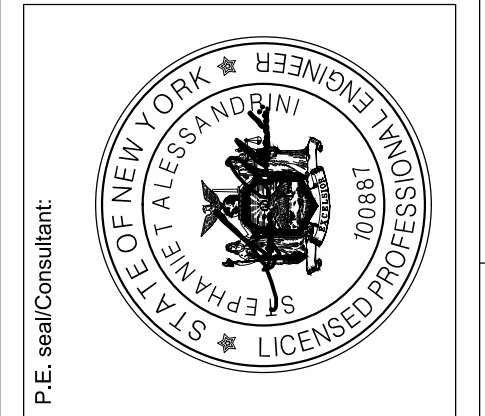

Project: **WILSON HILL SOLAR**  
469 Wilson Hill Road  
Hoodsick Falls, NY 12090

Drawing Title: **EXISTING DRAINAGE MAP**  
**NOT FOR CONSTRUCTION**  
Scale: As Shown Approved by: STA

Dwg No: **1 OF 2** Size: D Sheet Rev: **H**





Attachment A  
Water Quality Calculation  
Runoff Reduction Calculation

Is this project subject to Chapter 10 of the NYS Design Manual (i.e. WQv is equal to post-development 1 year runoff volume)?..... No

Design Point:	A		<i>Manually enter P, Total Area and Impervious Cover.</i>
P=	1.10	inch	

Breakdown of Subcatchments						
Catchment Number	Total Area (Acres)	Impervious Area (Acres)	Percent Impervious %	Rv	WQv (ft <sup>3</sup> )	Description
1	4.85	1.67	34%	0.36	6,970	Bioretention
2	4.15	1.52	37%	0.38	6,291	Bioretention
3	0.58	0.20	34%	0.36	835	Bioretention
4	11.49	3.92	34%	0.36	16,381	Wet Pond
5	0.88	0.32	36%	0.38	1,326	Bioretention
6						
7						
8						
9						
10						
Subtotal (1-30)	21.95	7.63	35%	0.36	<b>31,803</b>	<b>Subtotal 1</b>
<b>Total</b>	<b>21.95</b>	<b>7.63</b>	<b>35%</b>	<b>0.36</b>	<b>31,803</b>	<b>Initial WQv</b>

Identify Runoff Reduction Techniques By Area			
Technique	Total Contributing Area	Contributing Impervious Area	Notes
	(Acre)	(Acre)	
Conservation of Natural Areas	0.00	0.00	<i>minimum 10,000 sf</i>
Riparian Buffers	0.00	0.00	<i>maximum contributing length 75 feet to 150 feet</i>
Filter Strips	0.00	0.00	
Tree Planting	0.00	0.00	<i>Up to 100 sf directly connected impervious area may be subtracted per tree</i>
<b>Total</b>	<b>0.00</b>	<b>0.00</b>	

Recalculate WQv after application of Area Reduction Techniques					
	Total Area (Acres)	Impervious Area (Acres)	Percent Impervious %	Runoff Coefficient Rv	WQv (ft <sup>3</sup> )
"<<Initial WQv"	21.95	7.63	35%	0.36	31,803
Subtract Area	0.00	0.00			
WQv adjusted after Area Reductions	<b>21.95</b>	<b>7.63</b>	35%	0.36	31,803
Disconnection of Rooftops		0.00			
Adjusted WQv after Area Reduction and Rooftop Disconnect	21.95	7.63	35%	0.36	<b>31,803</b>
WQv reduced by Area Reduction techniques					0

Runoff Reduction Volume and Treated volumes						
	Runoff Reduction Techniques/Standard SMPs		Total Contributing Area	Total Contributing Impervious Area	WQv Reduced (RRv)	WQv Treated
			(acres)	(acres)	cf	cf
Area/Volume Reduction	Conservation of Natural Areas	RR-1	0.00	0.00		
	Sheetflow to Riparian Buffers/Filter Strips	RR-2	0.00	0.00		
	Tree Planting/Tree Pit	RR-3	0.00	0.00		
	Disconnection of Rooftop Runoff	RR-4		0.00		
	Vegetated Swale	RR-5	0.00	0.00	0	
	Rain Garden	RR-6	0.00	0.00	0	
	Stormwater Planter	RR-7	0.00	0.00	0	
	Rain Barrel/Cistern	RR-8	0.00	0.00	0	
	Porous Pavement	RR-9	0.00	0.00	0	
	Green Roof (Intensive & Extensive)	RR-10	0.00	0.00	0	
Standard SMPs w/RRV Capacity	Infiltration Trench	I-1	0.00	0.00	0	0
	Infiltration Basin	I-2	0.00	0.00	0	0
	Dry Well	I-3	0.00	0.00	0	0
	Underground Infiltration System	I-4				
	Bioretention & Infiltration Bioretention	F-5	10.46	3.71	6454	8968
	Dry swale	O-1	0.00	0.00	0	0
Standard SMPs	Micropool Extended Detention (P-1)	P-1				
	Wet Pond (P-2)	P-2	11.49	3.92		16381
	Wet Extended Detention (P-3)	P-3				
	Multiple Pond system (P-4)	P-4				
	Pocket Pond (p-5)	P-5				
	Surface Sand filter (F-1)	F-1				
	Underground Sand filter (F-2)	F-2				
	Perimeter Sand Filter (F-3)	F-3				
	Organic Filter (F-4)	F-4				
	Shallow Wetland (W-1)	W-1				
	Extended Detention Wetland (W-2)	W-2				
	Pond/Wetland System (W-3)	W-3				
	Pocket Wetland (W-4)	W-4				
Wet Swale (O-2)	O-2					
Totals by Area Reduction		→	0.00	0.00	0	
Totals by Volume Reduction		→	0.00	0.00	0	
Totals by Standard SMP w/RRV		→	10.46	3.71	6454	8968
Totals by Standard SMP		→	11.49	3.92		16381
Totals ( Area + Volume + all SMPs)		→	21.95	7.63	6,454	25,349

# Minimum RRv

**Enter the Soils Data for the site**

Soil Group	Acres	S
A		55%
B		40%
C	6.56	30%
D	<b>31.99</b>	20%
Total Area	38.55	

**Calculate the Minimum RRv**

S =	<b>0.22</b>	
Impervious =	7.63	<i>acre</i>
Precipitation	1.1	<i>in</i>
Rv	0.95	
<b>Minimum RRv</b>	<b>6,281</b>	<b><i>ft3</i></b>
	0.14	<i>af</i>

# Bioretention Worksheet

(For use on HSG C or D Soils with underdrains)

$$A_f = WQ_v * (d_f) / [k * (h_f + d_f) * (t_f)]$$

$A_f$	Required Surface Area (ft <sup>2</sup> )		The hydraulic conductivity [ft/day], can be varied depending on the properties of the soil media. Some reported conductivity values are: <b>Sand</b> - 3.5 ft/day (City of Austin 1988); <b>Peat</b> - 2.0 ft/day (Galli 1990); <b>Leaf Compost</b> - 8.7 ft/day (Claytor and Schueler, 1996); <b>Bioretention Soil</b> (0.5 ft/day (Claytor & Schueler, 1996))
$WQ_v$	Water Quality Volume (ft <sup>3</sup> )		
$d_f$	Depth of the Soil Medium (feet)	$k$	
$h_f$	Average height of water above the planter bed		
$t_f$	Volume Through the Filter Media (days)		

<b>Design Point:</b>	<b>A</b>						
<b>Enter Site Data For Drainage Area to be Treated by Practice</b>							
Catchment Number	Total Area (Acres)	Impervious Area (Acres)	Percent Impervious %	Rv	WQv (ft <sup>3</sup> )	Precipitation (in)	Description
1	4.85	1.67	0.34	0.36	6969.78	1.10	Bioretention
Enter Impervious Area Reduced by Disconnection of Rooftops		0.00	34%	0.36	6,970	<<WQv after adjusting for Disconnected Rooftops	
Enter the portion of the WQv that is not reduced for all practices routed to this practice.					0	ft <sup>3</sup>	
<b>Soil Information</b>							
Soil Group	D						
Soil Infiltration Rate	0.00	in/hour	Okay				
Using Underdrains?	Yes	Okay					
<b>Calculate the Minimum Filter Area</b>							
				Value	Units	Notes	
WQv				6,970	ft <sup>3</sup>		
Enter Depth of Soil Media				$d_f$	2.5	ft	2.5-4 ft
Enter Hydraulic Conductivity				$k$	0.5	ft/day	
Enter Average Height of Ponding				$h_f$	0.5	ft	6 inches max.
Enter Filter Time				$t_f$	2	days	
<b>Required Filter Area</b>				<b><math>A_f</math></b>	<b>5808</b>	<b>ft<sup>2</sup></b>	
<b>Determine Actual Bio-Retention Area</b>							
Filter Width	35	ft					
Filter Length	170	ft					
Filter Area	5950	ft <sup>2</sup>					
Actual Volume Provided	7140	ft <sup>3</sup>					
<b>Determine Runoff Reduction</b>							
Is the Bioretention contributing flow to another practice?			No	Select Practice			
RRv	2,856						
<b>RRv applied</b>	<b>2,856</b>	<b>ft<sup>3</sup></b>	<b>This is 40% of the storage provided or WQv whichever is less.</b>				
Volume Treated	4,114	ft <sup>3</sup>	This is the portion of the WQv that is not reduced in the practice.				
Volume Directed	0	ft <sup>3</sup>	This volume is directed another practice				
Sizing V	OK	Check to be sure Area provided ≥ $A_f$					

# Bioretention Worksheet

(For use on HSG C or D Soils with underdrains)

$$A_f = WQ_v * (d_f) / [k * (h_f + d_f)(t_f)]$$

$A_f$	Required Surface Area (ft <sup>2</sup> )		The hydraulic conductivity [ft/day], can be varied depending on the properties of the soil media. Some reported conductivity values are: <b>Sand</b> - 3.5 ft/day (City of Austin 1988); <b>Peat</b> - 2.0 ft/day (Galli 1990); <b>Leaf Compost</b> - 8.7 ft/day (Claytor and Schueler, 1996); <b>Bioretention Soil</b> (0.5 ft/day (Claytor & Schueler, 1996)
$WQ_v$	Water Quality Volume (ft <sup>3</sup> )		
$d_f$	Depth of the Soil Medium (feet)	$k$	
$h_f$	Average height of water above the planter bed		
$t_f$	Volume Through the Filter Media (days)		

<b>Design Point:</b>		<b>A</b>					
<b>Enter Site Data For Drainage Area to be Treated by Practice</b>							
Catchment Number	Total Area (Acres)	Impervious Area (Acres)	Percent Impervious %	Rv	WQv (ft <sup>3</sup> )	Precipitation (in)	Description
2	4.15	1.52	0.37	0.38	6290.97	1.10	Bioretention
Enter Impervious Area Reduced by Disconnection of Rooftops			37%	0.38	6,291	<<WQv after adjusting for Disconnected Rooftops	
Enter the portion of the WQv that is not reduced for all practices routed to this practice.						ft <sup>3</sup>	
<b>Soil Information</b>							
Soil Group		D					
Soil Infiltration Rate		0.00	in/hour	Okay			
Using Underdrains?		Yes		Okay			
<b>Calculate the Minimum Filter Area</b>							
				Value	Units	Notes	
WQv				6,291	ft <sup>3</sup>		
Enter Depth of Soil Media				$d_f$	2.5	ft	2.5-4 ft
Enter Hydraulic Conductivity				$k$	0.5	ft/day	
Enter Average Height of Ponding				$h_f$	0.5	ft	6 inches max.
Enter Filter Time				$t_f$	2	days	
<b>Required Filter Area</b>				<b><math>A_f</math></b>	<b>5242</b>	<b>ft<sup>2</sup></b>	
<b>Determine Actual Bio-Retention Area</b>							
Filter Width		36	ft				
Filter Length		155	ft				
Filter Area		5580	ft <sup>2</sup>				
Actual Volume Provided		6696	ft <sup>3</sup>				
<b>Determine Runoff Reduction</b>							
Is the Bioretention contributing flow to another practice?			No	Select Practice			
RRv		2,678					
<b>RRv applied</b>		<b>2,678</b>	<b>ft<sup>3</sup></b>	<b>This is 40% of the storage provided or WQv whichever is less.</b>			
Volume Treated		3,613	ft <sup>3</sup>	This is the portion of the WQv that is not reduced in the practice.			
Volume Directed		0	ft <sup>3</sup>	This volume is directed another practice			
Sizing V		OK		Check to be sure Area provided ≥ $A_f$			

# Bioretention Worksheet

*(For use on HSG C or D Soils with underdrains)*

$$A_f = WQ_v * (d_f) / [k * (h_f + d_f)(t_f)]$$

- |        |   |   |
|--------|---|---|
| $A_f$  | Required Surface Area (ft <sup>2</sup> )      | The hydraulic conductivity [ft/day], can be varied depending on the properties of the soil media. Some reported conductivity values are: <b>Sand</b> - 3.5 ft/day (City of Austin 1988); <b>Peat</b> - 2.0 ft/day (Galli 1990); |
| $WQ_v$ | Water Quality Volume (ft <sup>3</sup> )       |   |
| $d_f$  | Depth of the Soil Medium (feet)               | $k$   |
| $h_f$  | Average height of water above the planter bed | <b>Leaf Compost</b> - 8.7 ft/day (Claytor and Schueler, 1996); <b>Bioretention Soil</b> (0.5 ft/day (Claytor &  |
| $t_f$  | Volume Through the Filter Media (days)        |   |

<b>Design Point:</b>	<b>A</b>						
Enter Site Data For Drainage Area to be Treated by Practice							
Catchment Number	Total Area (Acres)	Impervious Area (Acres)	Percent Impervious %	R <sub>v</sub>	WQ <sub>v</sub> (ft <sup>3</sup> )	Precipitation (in)	Description
3	0.58	0.20	0.34	0.36	834.54	1.10	Bioretention
Enter Impervious Area Reduced by Disconnection of Rooftops		0.00	34%	0.36	835	<<WQ <sub>v</sub> after adjusting for Disconnected Rooftops	
Enter the portion of the WQ <sub>v</sub> that is not reduced for all practices routed to this practice.					0	ft <sup>3</sup>	
Soil Information							
Soil Group		D					
Soil Infiltration Rate		0.00	in/hour	<span style="color: red;">Okay</span>			
Using Underdrains?		Yes	<span style="color: red;">Okay</span>				
Calculate the Minimum Filter Area							
				Value	Units	Notes	
WQ <sub>v</sub>				835	ft <sup>3</sup>		
Enter Depth of Soil Media			$d_f$	2.5	ft	2.5-4 ft	
Enter Hydraulic Conductivity			$k$	0.5	ft/day		
Enter Average Height of Ponding			$h_f$	0.5	ft	6 inches max.	
Enter Filter Time			$t_f$	2	days		
<b>Required Filter Area</b>			<b><math>A_f</math></b>	<b>695</b>	<b>ft<sup>2</sup></b>		
Determine Actual Bio-Retention Area							
Filter Width		11	ft				
Filter Length		65	ft				
Filter Area		715	ft <sup>2</sup>				
Actual Volume Provided		858	ft <sup>3</sup>				
Determine Runoff Reduction							
Is the Bioretention contributing flow to another practice?			No	Select Practice			
RR <sub>v</sub>		343					
<b>RR<sub>v</sub> applied</b>		<b>343</b>	<b>ft<sup>3</sup></b>	<b><i>This is 40% of the storage provided or WQ<sub>v</sub> whichever is less.</i></b>			
Volume Treated		491	ft <sup>3</sup>	<i>This is the portion of the WQ<sub>v</sub> that is not reduced in the practice.</i>			
Volume Directed		0	ft <sup>3</sup>	This volume is directed another practice			
Sizing V		OK	<i>Check to be sure Area provided ≥ A<sub>f</sub></i>				

# Bioretention Worksheet

(For use on HSG C or D Soils with underdrains)


$$A_f = WQ_v * (d_f) / [k * (h_f + d_f)(t_f)]$$

<p><math>A_f</math> Required Surface Area (ft<sup>2</sup>)</p> <p><math>WQ_v</math> Water Quality Volume (ft<sup>3</sup>)</p> <p><math>d_f</math> Depth of the Soil Medium (feet)</p> <p><math>h_f</math> Average height of water above the planter bed</p> <p><math>t_f</math> Volume Through the Filter Media (days)</p>	<p><math>k</math> The hydraulic conductivity [ft/day], can be varied depending on the properties of the soil media. Some reported conductivity values are: <b>Sand</b> - 3.5 ft/day (City of Austin 1988); <b>Peat</b> - 2.0 ft/day (Galli 1990); <b>Leaf Compost</b> - 8.7 ft/day (Claytor and Schueler, 1996); <b>Bioretention Soil</b> (0.5 ft/day (Claytor &amp; Schueler, 1996))</p>
--	---

<b>Design Point:</b>	<b>A</b>						
<b>Enter Site Data For Drainage Area to be Treated by Practice</b>							
Catchment Number	Total Area (Acres)	Impervious Area (Acres)	Percent Impervious %	Rv	WQv (ft <sup>3</sup> )	Precipitation (in)	Description
5	0.88	0.32	0.36	0.38	1326.27	1.10	Bioretention
Enter Impervious Area Reduced by Disconnection of Rooftops		0.00	36%	0.38	1,326	<<WQv after adjusting for Disconnected Rooftops	
Enter the portion of the WQv that is not reduced for all practices routed to this practice.					0	ft <sup>3</sup>	
<b>Soil Information</b>							
Soil Group		D					
Soil Infiltration Rate		0.00	in/hour	<span style="color: red;">Okay</span>			
Using Underdrains?		Yes	<span style="color: red;">Okay</span>				
<b>Calculate the Minimum Filter Area</b>							
				Value	Units	Notes	
WQv				1,326	ft <sup>3</sup>		
Enter Depth of Soil Media			$d_f$	2.5	ft	2.5-4 ft	
Enter Hydraulic Conductivity			$k$	0.5	ft/day		
Enter Average Height of Ponding			$h_f$	0.5	ft	6 inches max.	
Enter Filter Time			$t_f$	2	days		
<b>Required Filter Area</b>			<b><math>A_f</math></b>	<b>1105</b>	<b>ft<sup>2</sup></b>		
<b>Determine Actual Bio-Retention Area</b>							
Filter Width		30	ft				
Filter Length		40	ft				
Filter Area		1200	ft <sup>2</sup>				
Actual Volume Provided		1440	ft <sup>3</sup>				
<b>Determine Runoff Reduction</b>							
Is the Bioretention contributing flow to another practice?			No	Select Practice			
RRv		576					
<b>RRv applied</b>		<b>576</b>	<b>ft<sup>3</sup></b>	<b>This is 40% of the storage provided or WQv whichever is less.</b>			
Volume Treated		750	ft <sup>3</sup>	This is the portion of the WQv that is not reduced in the practice.			
Volume Directed		0	ft <sup>3</sup>	This volume is directed another practice			
Sizing v		OK	Check to be sure Area provided ≥ $A_f$				



Attachment B  
Stormwater Modeling Calculations

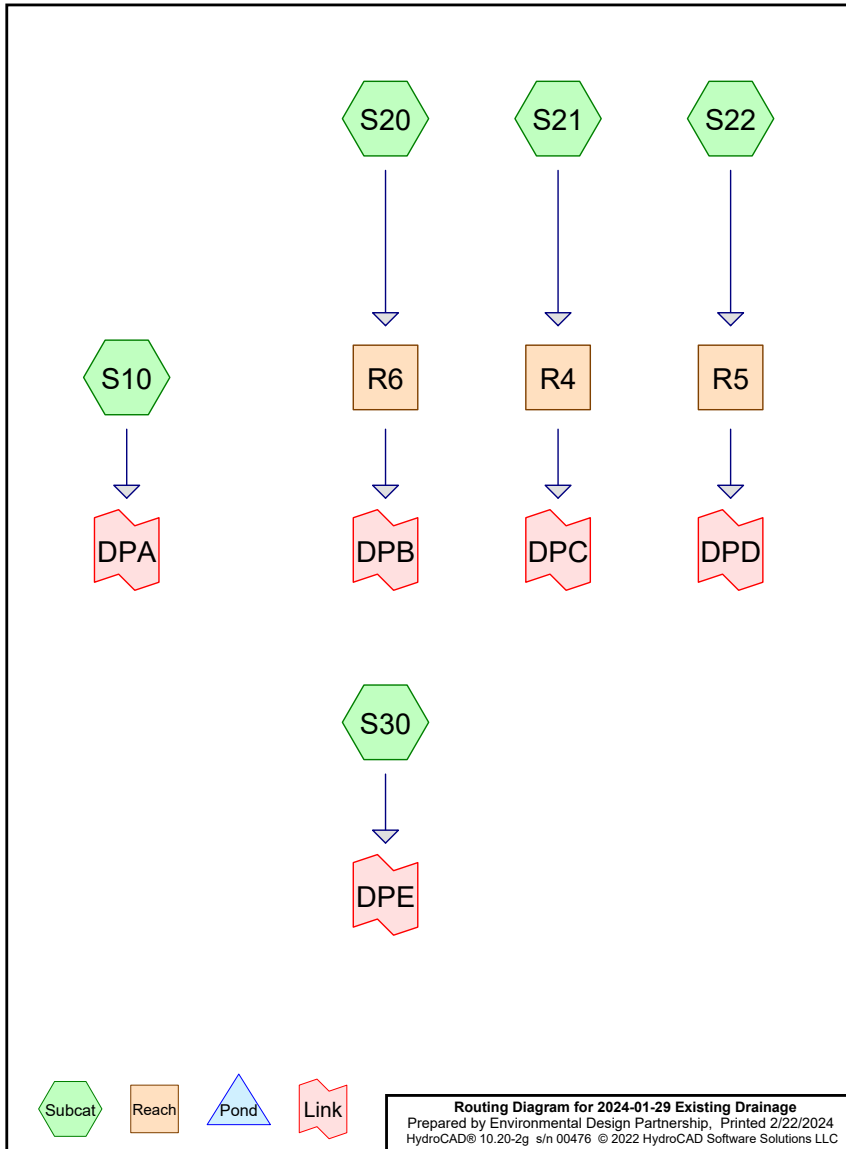

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Printed 2/22/2024

Page 2

**Rainfall Events Listing (selected events)**

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	1-YR	NRCC 24-hr	B	Default	24.00	1	2.25	2
2	10-YR	NRCC 24-hr	B	Default	24.00	1	3.95	2
3	50-YR	NRCC 24-hr	B	Default	24.00	1	5.35	2
4	100-YR	NRCC 24-hr	B	Default	24.00	1	5.98	2

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Printed 2/22/2024

Page 3

**Area Listing (selected nodes)**

Area (acres)	CN	Description (subcatchment-numbers)
0.165	96	Gravel surface, HSG C (S30)
0.365	96	Gravel surface, HSG D (S20, S21, S22)
4.650	71	Meadow, non-grazed, HSG C (S30)
21.760	78	Meadow, non-grazed, HSG D (S10, S20, S21, S22)
1.749	73	Woods, Fair, HSG C (S30)
9.862	79	Woods, Fair, HSG D (S10, S20, S21, S22)
<b>38.551</b>	<b>77</b>	<b>TOTAL AREA</b>

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Printed 2/22/2024

Page 4

**Soil Listing (selected nodes)**

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
6.564	HSG C	S30
31.987	HSG D	S10, S20, S21, S22
0.000	Other	
<b>38.551</b>		<b>TOTAL AREA</b>

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Printed 2/22/2024

Page 5

**Ground Covers (selected nodes)**

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.165	0.365	0.000	0.530	Gravel surface	S20, S21, S22, S30
0.000	0.000	4.650	21.760	0.000	26.410	Meadow, non-grazed	S10, S20, S21, S22, S30
0.000	0.000	1.749	9.862	0.000	11.611	Woods, Fair	S10, S20, S21, S22, S30
<b>0.000</b>	<b>0.000</b>	<b>6.564</b>	<b>31.987</b>	<b>0.000</b>	<b>38.551</b>	<b>TOTAL AREA</b>	

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/22/2024

Page 6

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points  
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
 Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>SubcatchmentS10:</b>	Runoff Area=11.450 ac 0.00% Impervious Runoff Depth=0.63" Flow Length=975' Tc=11.2 min CN=78 Runoff=7.92 cfs 0.602 af
<b>SubcatchmentS20:</b>	Runoff Area=16.243 ac 0.00% Impervious Runoff Depth=0.67" Flow Length=1,201' Tc=13.5 min CN=79 Runoff=11.17 cfs 0.913 af
<b>SubcatchmentS21:</b>	Runoff Area=2.737 ac 0.00% Impervious Runoff Depth=0.67" Flow Length=515' Tc=12.9 min CN=79 Runoff=1.93 cfs 0.154 af
<b>SubcatchmentS22:</b>	Runoff Area=1.557 ac 0.00% Impervious Runoff Depth=0.67" Flow Length=465' Tc=11.7 min CN=79 Runoff=1.14 cfs 0.088 af
<b>SubcatchmentS30:</b>	Runoff Area=6.564 ac 0.00% Impervious Runoff Depth=0.40" Flow Length=837' Tc=11.2 min CN=72 Runoff=2.50 cfs 0.221 af
<b>Reach R4:</b>	Avg. Flow Depth=0.02' Max Vel=1.48 fps Inflow=1.93 cfs 0.154 af n=0.035 L=495.0' S=0.1818 '/' Capacity=1,071.38 cfs Outflow=1.72 cfs 0.154 af
<b>Reach R5:</b>	Avg. Flow Depth=0.01' Max Vel=1.58 fps Inflow=1.14 cfs 0.088 af n=0.020 L=290.0' S=0.1207 '/' Capacity=1,527.56 cfs Outflow=1.09 cfs 0.088 af
<b>Reach R6:</b>	Avg. Flow Depth=0.06' Max Vel=3.12 fps Inflow=11.17 cfs 0.913 af n=0.022 L=1,606.0' S=0.0990 '/' Capacity=1,257.76 cfs Outflow=9.21 cfs 0.913 af
<b>Link DPA:</b>	Inflow=7.92 cfs 0.602 af Primary=7.92 cfs 0.602 af
<b>Link DPB:</b>	Inflow=9.21 cfs 0.913 af Primary=9.21 cfs 0.913 af
<b>Link DPC:</b>	Inflow=1.72 cfs 0.154 af Primary=1.72 cfs 0.154 af
<b>Link DPD:</b>	Inflow=1.09 cfs 0.088 af Primary=1.09 cfs 0.088 af
<b>Link DPE:</b>	Inflow=2.50 cfs 0.221 af Primary=2.50 cfs 0.221 af

**Total Runoff Area = 38.551 ac Runoff Volume = 1.978 af Average Runoff Depth = 0.62"**  
**100.00% Pervious = 38.551 ac 0.00% Impervious = 0.000 ac**

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/22/2024

Page 7

**Summary for Subcatchment S10:**

Runoff = 7.92 cfs @ 12.20 hrs, Volume= 0.602 af, Depth= 0.63"  
 Routed to Link DPA :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
8.383	78	Meadow, non-grazed, HSG D
3.067	79	Woods, Fair, HSG D
11.450	78	Weighted Average
11.450		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	100	0.1700	0.25		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
4.6	875	0.2080	3.19		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.2	975	Total			

**Summary for Subcatchment S20:**

Runoff = 11.17 cfs @ 12.23 hrs, Volume= 0.913 af, Depth= 0.67"  
 Routed to Reach R6 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
11.063	78	Meadow, non-grazed, HSG D
4.953	79	Woods, Fair, HSG D
0.227	96	Gravel surface, HSG D
16.243	79	Weighted Average
16.243		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.2	100	0.1400	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
0.6	98	0.2857	2.67		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
5.7	1,003	0.1751	2.93		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
13.5	1,201	Total			

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/22/2024

Page 8

**Summary for Subcatchment S21:**

Runoff = 1.93 cfs @ 12.22 hrs, Volume= 0.154 af, Depth= 0.67"  
 Routed to Reach R4 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
1.596	79	Woods, Fair, HSG D
0.082	96	Gravel surface, HSG D
1.059	78	Meadow, non-grazed, HSG D
2.737	79	Weighted Average
2.737		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.2	100	0.1600	0.16		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
2.7	415	0.2600	2.55		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
12.9	515	Total			

**Summary for Subcatchment S22:**

Runoff = 1.14 cfs @ 12.21 hrs, Volume= 0.088 af, Depth= 0.67"  
 Routed to Reach R5 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
0.246	79	Woods, Fair, HSG D
0.056	96	Gravel surface, HSG D
1.255	78	Meadow, non-grazed, HSG D
1.557	79	Weighted Average
1.557		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	100	0.1900	0.17		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
2.2	365	0.1600	2.80		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.7	465	Total			

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/22/2024

Page 9

**Summary for Subcatchment S30:**

Runoff = 2.50 cfs @ 12.21 hrs, Volume= 0.221 af, Depth= 0.40"  
 Routed to Link DPE :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
4.650	71	Meadow, non-grazed, HSG C
0.165	96	Gravel surface, HSG C
1.749	73	Woods, Fair, HSG C
6.564	72	Weighted Average
6.564		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	100	0.1500	0.24		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
1.3	192	0.1200	2.42		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
0.4	130	0.0923	4.89		<b>Shallow Concentrated Flow, SCF - GRAVEL</b> Unpaved Kv= 16.1 fps
2.5	415	0.1542	2.75		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.2	837	Total			

**Summary for Reach R4:**

Inflow Area = 2.737 ac, 0.00% Impervious, Inflow Depth = 0.67" for 1-YR event  
 Inflow = 1.93 cfs @ 12.22 hrs, Volume= 0.154 af  
 Outflow = 1.72 cfs @ 12.28 hrs, Volume= 0.154 af, Atten= 11%, Lag= 3.9 min  
 Routed to Link DPC :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.48 fps, Min. Travel Time= 5.6 min  
 Avg. Velocity = 0.86 fps, Avg. Travel Time= 9.6 min

Peak Storage= 574 cf @ 12.28 hrs  
 Average Depth at Peak Storage= 0.02' , Surface Width= 50.92'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,071.38 cfs

50.00' x 1.00' deep channel, n= 0.035 Earth, dense weeds  
 Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
 Length= 495.0' Slope= 0.1818 ' / '  
 Inlet Invert= 857.00', Outlet Invert= 767.00'

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/22/2024

Page 10

**Summary for Reach R5:**

Inflow Area = 1.557 ac, 0.00% Impervious, Inflow Depth = 0.67" for 1-YR event  
 Inflow = 1.14 cfs @ 12.21 hrs, Volume= 0.088 af  
 Outflow = 1.09 cfs @ 12.24 hrs, Volume= 0.088 af, Atten= 5%, Lag= 2.2 min  
 Routed to Link DPD :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.58 fps, Min. Travel Time= 3.1 min  
 Avg. Velocity = 1.20 fps, Avg. Travel Time= 4.0 min

Peak Storage= 201 cf @ 12.24 hrs  
 Average Depth at Peak Storage= 0.01' , Surface Width= 50.55'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,527.56 cfs

50.00' x 1.00' deep channel, n= 0.020 Corrugated PE, corrugated interior  
 Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
 Length= 290.0' Slope= 0.1207 ' / '  
 Inlet Invert= 822.00', Outlet Invert= 787.00'

**Summary for Reach R6:**

Inflow Area = 16.243 ac, 0.00% Impervious, Inflow Depth = 0.67" for 1-YR event  
 Inflow = 11.17 cfs @ 12.23 hrs, Volume= 0.913 af  
 Outflow = 9.21 cfs @ 12.32 hrs, Volume= 0.913 af, Atten= 18%, Lag= 5.4 min  
 Routed to Link DPB :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 3.12 fps, Min. Travel Time= 8.6 min  
 Avg. Velocity = 1.13 fps, Avg. Travel Time= 23.7 min

Peak Storage= 4,726 cf @ 12.32 hrs  
 Average Depth at Peak Storage= 0.06' , Surface Width= 52.30'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,257.76 cfs

**2024-01-29 Existing Drainage**

NRCC 24-hr B 1-YR Rainfall=2.25"

Prepared by Environmental Design Partnership

Printed 2/22/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 11

50.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 1,606.0' Slope= 0.0990 ' / '  
Inlet Invert= 895.00', Outlet Invert= 736.00'



**Summary for Link DPA:**

Inflow Area = 11.450 ac, 0.00% Impervious, Inflow Depth = 0.63" for 1-YR event  
Inflow = 7.92 cfs @ 12.20 hrs, Volume= 0.602 af  
Primary = 7.92 cfs @ 12.20 hrs, Volume= 0.602 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPB:**

Inflow Area = 16.243 ac, 0.00% Impervious, Inflow Depth = 0.67" for 1-YR event  
Inflow = 9.21 cfs @ 12.32 hrs, Volume= 0.913 af  
Primary = 9.21 cfs @ 12.32 hrs, Volume= 0.913 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPC:**

Inflow Area = 2.737 ac, 0.00% Impervious, Inflow Depth = 0.67" for 1-YR event  
Inflow = 1.72 cfs @ 12.28 hrs, Volume= 0.154 af  
Primary = 1.72 cfs @ 12.28 hrs, Volume= 0.154 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPD:**

Inflow Area = 1.557 ac, 0.00% Impervious, Inflow Depth = 0.67" for 1-YR event  
Inflow = 1.09 cfs @ 12.24 hrs, Volume= 0.088 af  
Primary = 1.09 cfs @ 12.24 hrs, Volume= 0.088 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2024-01-29 Existing Drainage**

NRCC 24-hr B 1-YR Rainfall=2.25"

Prepared by Environmental Design Partnership

Printed 2/22/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 12

**Summary for Link DPE:**

Inflow Area = 6.564 ac, 0.00% Impervious, Inflow Depth = 0.40" for 1-YR event  
Inflow = 2.50 cfs @ 12.21 hrs, Volume= 0.221 af  
Primary = 2.50 cfs @ 12.21 hrs, Volume= 0.221 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/22/2024

Page 13

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

**SubcatchmentS10:** Runoff Area=11.450 ac 0.00% Impervious Runoff Depth=1.85"  
Flow Length=975' Tc=11.2 min CN=78 Runoff=24.66 cfs 1.763 af

**SubcatchmentS20:** Runoff Area=16.243 ac 0.00% Impervious Runoff Depth=1.92"  
Flow Length=1,201' Tc=13.5 min CN=79 Runoff=33.82 cfs 2.603 af

**SubcatchmentS21:** Runoff Area=2.737 ac 0.00% Impervious Runoff Depth=1.92"  
Flow Length=515' Tc=12.9 min CN=79 Runoff=5.82 cfs 0.439 af

**SubcatchmentS22:** Runoff Area=1.557 ac 0.00% Impervious Runoff Depth=1.92"  
Flow Length=465' Tc=11.7 min CN=79 Runoff=3.43 cfs 0.250 af

**SubcatchmentS30:** Runoff Area=6.564 ac 0.00% Impervious Runoff Depth=1.43"  
Flow Length=837' Tc=11.2 min CN=72 Runoff=10.70 cfs 0.780 af

**Reach R4:** Avg. Flow Depth=0.05' Max Vel=2.33 fps Inflow=5.82 cfs 0.439 af  
n=0.035 L=495.0' S=0.1818 '/' Capacity=1,071.38 cfs Outflow=5.54 cfs 0.439 af

**Reach R5:** Avg. Flow Depth=0.03' Max Vel=2.37 fps Inflow=3.43 cfs 0.250 af  
n=0.020 L=290.0' S=0.1207 '/' Capacity=1,527.56 cfs Outflow=3.35 cfs 0.250 af

**Reach R6:** Avg. Flow Depth=0.12' Max Vel=4.95 fps Inflow=33.82 cfs 2.603 af  
n=0.022 L=1,606.0' S=0.0990 '/' Capacity=1,257.76 cfs Outflow=30.68 cfs 2.603 af

**Link DPA:** Inflow=24.66 cfs 1.763 af  
Primary=24.66 cfs 1.763 af

**Link DPB:** Inflow=30.68 cfs 2.603 af  
Primary=30.68 cfs 2.603 af

**Link DPC:** Inflow=5.54 cfs 0.439 af  
Primary=5.54 cfs 0.439 af

**Link DPD:** Inflow=3.35 cfs 0.250 af  
Primary=3.35 cfs 0.250 af

**Link DPE:** Inflow=10.70 cfs 0.780 af  
Primary=10.70 cfs 0.780 af

**Total Runoff Area = 38.551 ac Runoff Volume = 5.833 af Average Runoff Depth = 1.82"**  
**100.00% Pervious = 38.551 ac 0.00% Impervious = 0.000 ac**

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/22/2024

Page 14

**Summary for Subcatchment S10:**

Runoff = 24.66 cfs @ 12.19 hrs, Volume= 1.763 af, Depth= 1.85"  
Routed to Link DPA :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
8.383	78	Meadow, non-grazed, HSG D
3.067	79	Woods, Fair, HSG D
11.450	78	Weighted Average
11.450		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	100	0.1700	0.25		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
4.6	875	0.2080	3.19		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.2	975				Total

**Summary for Subcatchment S20:**

Runoff = 33.82 cfs @ 12.22 hrs, Volume= 2.603 af, Depth= 1.92"  
Routed to Reach R6 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
11.063	78	Meadow, non-grazed, HSG D
4.953	79	Woods, Fair, HSG D
0.227	96	Gravel surface, HSG D
16.243	79	Weighted Average
16.243		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.2	100	0.1400	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
0.6	98	0.2857	2.67		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
5.7	1,003	0.1751	2.93		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
13.5	1,201				Total



**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/22/2024

Page 15

**Summary for Subcatchment S21:**

Runoff = 5.82 cfs @ 12.21 hrs, Volume= 0.439 af, Depth= 1.92"  
 Routed to Reach R4 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
1.596	79	Woods, Fair, HSG D
0.082	96	Gravel surface, HSG D
1.059	78	Meadow, non-grazed, HSG D
2.737	79	Weighted Average
2.737		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.2	100	0.1600	0.16		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
2.7	415	0.2600	2.55		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
12.9	515	Total			

**Summary for Subcatchment S22:**

Runoff = 3.43 cfs @ 12.20 hrs, Volume= 0.250 af, Depth= 1.92"  
 Routed to Reach R5 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
0.246	79	Woods, Fair, HSG D
0.056	96	Gravel surface, HSG D
1.255	78	Meadow, non-grazed, HSG D
1.557	79	Weighted Average
1.557		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	100	0.1900	0.17		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
2.2	365	0.1600	2.80		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.7	465	Total			

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/22/2024

Page 16

**Summary for Subcatchment S30:**

Runoff = 10.70 cfs @ 12.20 hrs, Volume= 0.780 af, Depth= 1.43"  
 Routed to Link DPE :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
4.650	71	Meadow, non-grazed, HSG C
0.165	96	Gravel surface, HSG C
1.749	73	Woods, Fair, HSG C
6.564	72	Weighted Average
6.564		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	100	0.1500	0.24		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
1.3	192	0.1200	2.42		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
0.4	130	0.0923	4.89		<b>Shallow Concentrated Flow, SCF - GRAVEL</b> Unpaved Kv= 16.1 fps
2.5	415	0.1542	2.75		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.2	837	Total			

**Summary for Reach R4:**

Inflow Area = 2.737 ac, 0.00% Impervious, Inflow Depth = 1.92" for 10-YR event  
 Inflow = 5.82 cfs @ 12.21 hrs, Volume= 0.439 af  
 Outflow = 5.54 cfs @ 12.25 hrs, Volume= 0.439 af, Atten= 5%, Lag= 2.4 min  
 Routed to Link DPC :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.33 fps, Min. Travel Time= 3.5 min  
 Avg. Velocity = 0.90 fps, Avg. Travel Time= 9.1 min

Peak Storage= 1,176 cf @ 12.25 hrs  
 Average Depth at Peak Storage= 0.05' , Surface Width= 51.87'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,071.38 cfs

50.00' x 1.00' deep channel, n= 0.035 Earth, dense weeds  
 Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
 Length= 495.0' Slope= 0.1818 ' / '  
 Inlet Invert= 857.00', Outlet Invert= 767.00'

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/22/2024

Page 17

**Summary for Reach R5:**

Inflow Area = 1.557 ac, 0.00% Impervious, Inflow Depth = 1.92" for 10-YR event  
 Inflow = 3.43 cfs @ 12.20 hrs, Volume= 0.250 af  
 Outflow = 3.35 cfs @ 12.22 hrs, Volume= 0.250 af, Atten= 2%, Lag= 1.3 min  
 Routed to Link DPD :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.37 fps, Min. Travel Time= 2.0 min  
 Avg. Velocity = 1.23 fps, Avg. Travel Time= 3.9 min

Peak Storage= 408 cf @ 12.22 hrs  
 Average Depth at Peak Storage= 0.03' , Surface Width= 51.11'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,527.56 cfs

50.00' x 1.00' deep channel, n= 0.020 Corrugated PE, corrugated interior  
 Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
 Length= 290.0' Slope= 0.1207 ' / '  
 Inlet Invert= 822.00', Outlet Invert= 787.00'

**Summary for Reach R6:**

Inflow Area = 16.243 ac, 0.00% Impervious, Inflow Depth = 1.92" for 10-YR event  
 Inflow = 33.82 cfs @ 12.22 hrs, Volume= 2.603 af  
 Outflow = 30.68 cfs @ 12.28 hrs, Volume= 2.603 af, Atten= 9%, Lag= 3.4 min  
 Routed to Link DPB :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 4.95 fps, Min. Travel Time= 5.4 min  
 Avg. Velocity = 1.38 fps, Avg. Travel Time= 19.4 min

Peak Storage= 9,920 cf @ 12.28 hrs  
 Average Depth at Peak Storage= 0.12' , Surface Width= 54.72'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,257.76 cfs

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/22/2024

Page 18

50.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
 Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
 Length= 1,606.0' Slope= 0.0990 ' / '  
 Inlet Invert= 895.00', Outlet Invert= 736.00'

**Summary for Link DPA:**

Inflow Area = 11.450 ac, 0.00% Impervious, Inflow Depth = 1.85" for 10-YR event  
 Inflow = 24.66 cfs @ 12.19 hrs, Volume= 1.763 af  
 Primary = 24.66 cfs @ 12.19 hrs, Volume= 1.763 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPB:**

Inflow Area = 16.243 ac, 0.00% Impervious, Inflow Depth = 1.92" for 10-YR event  
 Inflow = 30.68 cfs @ 12.28 hrs, Volume= 2.603 af  
 Primary = 30.68 cfs @ 12.28 hrs, Volume= 2.603 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPC:**

Inflow Area = 2.737 ac, 0.00% Impervious, Inflow Depth = 1.92" for 10-YR event  
 Inflow = 5.54 cfs @ 12.25 hrs, Volume= 0.439 af  
 Primary = 5.54 cfs @ 12.25 hrs, Volume= 0.439 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPD:**

Inflow Area = 1.557 ac, 0.00% Impervious, Inflow Depth = 1.92" for 10-YR event  
 Inflow = 3.35 cfs @ 12.22 hrs, Volume= 0.250 af  
 Primary = 3.35 cfs @ 12.22 hrs, Volume= 0.250 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/22/2024

Page 19

**Summary for Link DPE:**

Inflow Area = 6.564 ac, 0.00% Impervious, Inflow Depth = 1.43" for 10-YR event  
 Inflow = 10.70 cfs @ 12.20 hrs, Volume= 0.780 af  
 Primary = 10.70 cfs @ 12.20 hrs, Volume= 0.780 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/22/2024

Page 20

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points  
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
 Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

**SubcatchmentS10:** Runoff Area=11.450 ac 0.00% Impervious Runoff Depth=3.01"  
 Flow Length=975' Tc=11.2 min CN=78 Runoff=40.17 cfs 2.873 af

**SubcatchmentS20:** Runoff Area=16.243 ac 0.00% Impervious Runoff Depth=3.11"  
 Flow Length=1,201' Tc=13.5 min CN=79 Runoff=54.56 cfs 4.203 af

**SubcatchmentS21:** Runoff Area=2.737 ac 0.00% Impervious Runoff Depth=3.11"  
 Flow Length=515' Tc=12.9 min CN=79 Runoff=9.39 cfs 0.708 af

**SubcatchmentS22:** Runoff Area=1.557 ac 0.00% Impervious Runoff Depth=3.11"  
 Flow Length=465' Tc=11.7 min CN=79 Runoff=5.53 cfs 0.403 af

**SubcatchmentS30:** Runoff Area=6.564 ac 0.00% Impervious Runoff Depth=2.47"  
 Flow Length=837' Tc=11.2 min CN=72 Runoff=18.90 cfs 1.351 af

**Reach R4:** Avg. Flow Depth=0.06' Max Vel=2.82 fps Inflow=9.39 cfs 0.708 af  
 n=0.035 L=495.0' S=0.1818 '/ Capacity=1,071.38 cfs Outflow=9.05 cfs 0.708 af

**Reach R5:** Avg. Flow Depth=0.04' Max Vel=2.87 fps Inflow=5.53 cfs 0.403 af  
 n=0.020 L=290.0' S=0.1207 '/ Capacity=1,527.56 cfs Outflow=5.44 cfs 0.403 af

**Reach R6:** Avg. Flow Depth=0.16' Max Vel=6.00 fps Inflow=54.56 cfs 4.203 af  
 n=0.022 L=1,606.0' S=0.0990 '/ Capacity=1,257.76 cfs Outflow=50.98 cfs 4.203 af

**Link DPA:** Inflow=40.17 cfs 2.873 af  
 Primary=40.17 cfs 2.873 af

**Link DPB:** Inflow=50.98 cfs 4.203 af  
 Primary=50.98 cfs 4.203 af

**Link DPC:** Inflow=9.05 cfs 0.708 af  
 Primary=9.05 cfs 0.708 af

**Link DPD:** Inflow=5.44 cfs 0.403 af  
 Primary=5.44 cfs 0.403 af

**Link DPE:** Inflow=18.90 cfs 1.351 af  
 Primary=18.90 cfs 1.351 af

**Total Runoff Area = 38.551 ac Runoff Volume = 9.539 af Average Runoff Depth = 2.97"**  
**100.00% Pervious = 38.551 ac 0.00% Impervious = 0.000 ac**

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/22/2024

Page 21

**Summary for Subcatchment S10:**

Runoff = 40.17 cfs @ 12.19 hrs, Volume= 2.873 af, Depth= 3.01"  
 Routed to Link DPA :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
8.383	78	Meadow, non-grazed, HSG D
3.067	79	Woods, Fair, HSG D
11.450	78	Weighted Average
11.450		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	100	0.1700	0.25		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
4.6	875	0.2080	3.19		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.2	975	Total			

**Summary for Subcatchment S20:**

Runoff = 54.56 cfs @ 12.22 hrs, Volume= 4.203 af, Depth= 3.11"  
 Routed to Reach R6 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
11.063	78	Meadow, non-grazed, HSG D
4.953	79	Woods, Fair, HSG D
0.227	96	Gravel surface, HSG D
16.243	79	Weighted Average
16.243		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.2	100	0.1400	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
0.6	98	0.2857	2.67		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
5.7	1,003	0.1751	2.93		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
13.5	1,201	Total			

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/22/2024

Page 22

**Summary for Subcatchment S21:**

Runoff = 9.39 cfs @ 12.21 hrs, Volume= 0.708 af, Depth= 3.11"  
 Routed to Reach R4 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
1.596	79	Woods, Fair, HSG D
0.082	96	Gravel surface, HSG D
1.059	78	Meadow, non-grazed, HSG D
2.737	79	Weighted Average
2.737		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.2	100	0.1600	0.16		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
2.7	415	0.2600	2.55		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
12.9	515	Total			

**Summary for Subcatchment S22:**

Runoff = 5.53 cfs @ 12.20 hrs, Volume= 0.403 af, Depth= 3.11"  
 Routed to Reach R5 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
0.246	79	Woods, Fair, HSG D
0.056	96	Gravel surface, HSG D
1.255	78	Meadow, non-grazed, HSG D
1.557	79	Weighted Average
1.557		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	100	0.1900	0.17		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
2.2	365	0.1600	2.80		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.7	465	Total			

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/22/2024

Page 23

**Summary for Subcatchment S30:**

Runoff = 18.90 cfs @ 12.19 hrs, Volume= 1.351 af, Depth= 2.47"  
 Routed to Link DPE :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
4.650	71	Meadow, non-grazed, HSG C
0.165	96	Gravel surface, HSG C
1.749	73	Woods, Fair, HSG C
6.564	72	Weighted Average
6.564		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	100	0.1500	0.24		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
1.3	192	0.1200	2.42		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
0.4	130	0.0923	4.89		<b>Shallow Concentrated Flow, SCF - GRAVEL</b> Unpaved Kv= 16.1 fps
2.5	415	0.1542	2.75		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.2	837	Total			

**Summary for Reach R4:**

Inflow Area = 2.737 ac, 0.00% Impervious, Inflow Depth = 3.11" for 50-YR event  
 Inflow = 9.39 cfs @ 12.21 hrs, Volume= 0.708 af  
 Outflow = 9.05 cfs @ 12.24 hrs, Volume= 0.708 af, Atten= 4%, Lag= 2.1 min  
 Routed to Link DPC :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.82 fps, Min. Travel Time= 2.9 min  
 Avg. Velocity = 0.94 fps, Avg. Travel Time= 8.8 min

Peak Storage= 1,590 cf @ 12.24 hrs  
 Average Depth at Peak Storage= 0.06' , Surface Width= 52.51'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,071.38 cfs

50.00' x 1.00' deep channel, n= 0.035 Earth, dense weeds  
 Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
 Length= 495.0' Slope= 0.1818 ' / '  
 Inlet Invert= 857.00', Outlet Invert= 767.00'

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/22/2024

Page 24

**Summary for Reach R5:**

Inflow Area = 1.557 ac, 0.00% Impervious, Inflow Depth = 3.11" for 50-YR event  
 Inflow = 5.53 cfs @ 12.20 hrs, Volume= 0.403 af  
 Outflow = 5.44 cfs @ 12.21 hrs, Volume= 0.403 af, Atten= 1%, Lag= 1.1 min  
 Routed to Link DPD :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.87 fps, Min. Travel Time= 1.7 min  
 Avg. Velocity = 1.25 fps, Avg. Travel Time= 3.9 min

Peak Storage= 549 cf @ 12.21 hrs  
 Average Depth at Peak Storage= 0.04' , Surface Width= 51.49'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,527.56 cfs

50.00' x 1.00' deep channel, n= 0.020 Corrugated PE, corrugated interior  
 Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
 Length= 290.0' Slope= 0.1207 ' / '  
 Inlet Invert= 822.00', Outlet Invert= 787.00'

**Summary for Reach R6:**

Inflow Area = 16.243 ac, 0.00% Impervious, Inflow Depth = 3.11" for 50-YR event  
 Inflow = 54.56 cfs @ 12.22 hrs, Volume= 4.203 af  
 Outflow = 50.98 cfs @ 12.26 hrs, Volume= 4.203 af, Atten= 7%, Lag= 2.9 min  
 Routed to Link DPB :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 6.00 fps, Min. Travel Time= 4.5 min  
 Avg. Velocity = 1.55 fps, Avg. Travel Time= 17.2 min

Peak Storage= 13,621 cf @ 12.26 hrs  
 Average Depth at Peak Storage= 0.16' , Surface Width= 56.38'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,257.76 cfs

**2024-01-29 Existing Drainage**

NRCC 24-hr B 50-YR Rainfall=5.35"

Prepared by Environmental Design Partnership

Printed 2/22/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 25

50.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 1,606.0' Slope= 0.0990 ' / '  
Inlet Invert= 895.00', Outlet Invert= 736.00'



**Summary for Link DPA:**

Inflow Area = 11.450 ac, 0.00% Impervious, Inflow Depth = 3.01" for 50-YR event  
Inflow = 40.17 cfs @ 12.19 hrs, Volume= 2.873 af  
Primary = 40.17 cfs @ 12.19 hrs, Volume= 2.873 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPB:**

Inflow Area = 16.243 ac, 0.00% Impervious, Inflow Depth = 3.11" for 50-YR event  
Inflow = 50.98 cfs @ 12.26 hrs, Volume= 4.203 af  
Primary = 50.98 cfs @ 12.26 hrs, Volume= 4.203 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPC:**

Inflow Area = 2.737 ac, 0.00% Impervious, Inflow Depth = 3.11" for 50-YR event  
Inflow = 9.05 cfs @ 12.24 hrs, Volume= 0.708 af  
Primary = 9.05 cfs @ 12.24 hrs, Volume= 0.708 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPD:**

Inflow Area = 1.557 ac, 0.00% Impervious, Inflow Depth = 3.11" for 50-YR event  
Inflow = 5.44 cfs @ 12.21 hrs, Volume= 0.403 af  
Primary = 5.44 cfs @ 12.21 hrs, Volume= 0.403 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2024-01-29 Existing Drainage**

NRCC 24-hr B 50-YR Rainfall=5.35"

Prepared by Environmental Design Partnership

Printed 2/22/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 26

**Summary for Link DPE:**

Inflow Area = 6.564 ac, 0.00% Impervious, Inflow Depth = 2.47" for 50-YR event  
Inflow = 18.90 cfs @ 12.19 hrs, Volume= 1.351 af  
Primary = 18.90 cfs @ 12.19 hrs, Volume= 1.351 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2024-01-29 Existing Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/22/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 27

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

**SubcatchmentS10:** Runoff Area=11.450 ac 0.00% Impervious Runoff Depth=3.56"  
Flow Length=975' Tc=11.2 min CN=78 Runoff=47.36 cfs 3.398 af**SubcatchmentS20:** Runoff Area=16.243 ac 0.00% Impervious Runoff Depth=3.66"  
Flow Length=1,201' Tc=13.5 min CN=79 Runoff=64.15 cfs 4.957 af**SubcatchmentS21:** Runoff Area=2.737 ac 0.00% Impervious Runoff Depth=3.66"  
Flow Length=515' Tc=12.9 min CN=79 Runoff=11.03 cfs 0.835 af**SubcatchmentS22:** Runoff Area=1.557 ac 0.00% Impervious Runoff Depth=3.66"  
Flow Length=465' Tc=11.7 min CN=79 Runoff=6.49 cfs 0.475 af**SubcatchmentS30:** Runoff Area=6.564 ac 0.00% Impervious Runoff Depth=2.98"  
Flow Length=837' Tc=11.2 min CN=72 Runoff=22.81 cfs 1.628 af**Reach R4:** Avg. Flow Depth=0.07' Max Vel=3.00 fps Inflow=11.03 cfs 0.835 af  
n=0.035 L=495.0' S=0.1818 '/ Capacity=1,071.38 cfs Outflow=10.66 cfs 0.835 af**Reach R5:** Avg. Flow Depth=0.04' Max Vel=3.05 fps Inflow=6.49 cfs 0.475 af  
n=0.020 L=290.0' S=0.1207 '/ Capacity=1,527.56 cfs Outflow=6.40 cfs 0.475 af**Reach R6:** Avg. Flow Depth=0.18' Max Vel=6.39 fps Inflow=64.15 cfs 4.957 af  
n=0.022 L=1,606.0' S=0.0990 '/ Capacity=1,257.76 cfs Outflow=60.34 cfs 4.957 af**Link DPA:** Inflow=47.36 cfs 3.398 af  
Primary=47.36 cfs 3.398 af**Link DPB:** Inflow=60.34 cfs 4.957 af  
Primary=60.34 cfs 4.957 af**Link DPC:** Inflow=10.66 cfs 0.835 af  
Primary=10.66 cfs 0.835 af**Link DPD:** Inflow=6.40 cfs 0.475 af  
Primary=6.40 cfs 0.475 af**Link DPE:** Inflow=22.81 cfs 1.628 af  
Primary=22.81 cfs 1.628 af**Total Runoff Area = 38.551 ac Runoff Volume = 11.293 af Average Runoff Depth = 3.52"**  
**100.00% Pervious = 38.551 ac 0.00% Impervious = 0.000 ac****2024-01-29 Existing Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/22/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 28

**Summary for Subcatchment S10:**Runoff = 47.36 cfs @ 12.19 hrs, Volume= 3.398 af, Depth= 3.56"  
Routed to Link DPA :Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
8.383	78	Meadow, non-grazed, HSG D
3.067	79	Woods, Fair, HSG D
11.450	78	Weighted Average
11.450		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	100	0.1700	0.25		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
4.6	875	0.2080	3.19		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.2	975				Total

**Summary for Subcatchment S20:**Runoff = 64.15 cfs @ 12.22 hrs, Volume= 4.957 af, Depth= 3.66"  
Routed to Reach R6 :Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
11.063	78	Meadow, non-grazed, HSG D
4.953	79	Woods, Fair, HSG D
0.227	96	Gravel surface, HSG D
16.243	79	Weighted Average
16.243		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.2	100	0.1400	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
0.6	98	0.2857	2.67		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
5.7	1,003	0.1751	2.93		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
13.5	1,201				Total

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/22/2024

Page 29

**Summary for Subcatchment S21:**

Runoff = 11.03 cfs @ 12.21 hrs, Volume= 0.835 af, Depth= 3.66"  
Routed to Reach R4 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
1.596	79	Woods, Fair, HSG D
0.082	96	Gravel surface, HSG D
1.059	78	Meadow, non-grazed, HSG D
2.737	79	Weighted Average
2.737		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.2	100	0.1600	0.16		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
2.7	415	0.2600	2.55		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
12.9	515				Total

**Summary for Subcatchment S22:**

Runoff = 6.49 cfs @ 12.20 hrs, Volume= 0.475 af, Depth= 3.66"  
Routed to Reach R5 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
0.246	79	Woods, Fair, HSG D
0.056	96	Gravel surface, HSG D
1.255	78	Meadow, non-grazed, HSG D
1.557	79	Weighted Average
1.557		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	100	0.1900	0.17		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
2.2	365	0.1600	2.80		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.7	465				Total

**2024-01-29 Existing Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/22/2024

Page 30

**Summary for Subcatchment S30:**

Runoff = 22.81 cfs @ 12.19 hrs, Volume= 1.628 af, Depth= 2.98"  
Routed to Link DPE :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
4.650	71	Meadow, non-grazed, HSG C
0.165	96	Gravel surface, HSG C
1.749	73	Woods, Fair, HSG C
6.564	72	Weighted Average
6.564		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	100	0.1500	0.24		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
1.3	192	0.1200	2.42		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
0.4	130	0.0923	4.89		<b>Shallow Concentrated Flow, SCF - GRAVEL</b> Unpaved Kv= 16.1 fps
2.5	415	0.1542	2.75		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
11.2	837				Total

**Summary for Reach R4:**

Inflow Area = 2.737 ac, 0.00% Impervious, Inflow Depth = 3.66" for 100-YR event  
Inflow = 11.03 cfs @ 12.21 hrs, Volume= 0.835 af  
Outflow = 10.66 cfs @ 12.24 hrs, Volume= 0.835 af, Atten= 3%, Lag= 1.9 min  
Routed to Link DPC :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Max. Velocity= 3.00 fps, Min. Travel Time= 2.8 min  
Avg. Velocity = 0.95 fps, Avg. Travel Time= 8.7 min

Peak Storage= 1,759 cf @ 12.24 hrs  
Average Depth at Peak Storage= 0.07' , Surface Width= 52.77'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,071.38 cfs

50.00' x 1.00' deep channel, n= 0.035 Earth, dense weeds  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 495.0' Slope= 0.1818 ' / '  
Inlet Invert= 857.00', Outlet Invert= 767.00'



**2024-01-29 Existing Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/22/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 31



**Summary for Reach R5:**

Inflow Area = 1.557 ac, 0.00% Impervious, Inflow Depth = 3.66" for 100-YR event  
 Inflow = 6.49 cfs @ 12.20 hrs, Volume= 0.475 af  
 Outflow = 6.40 cfs @ 12.21 hrs, Volume= 0.475 af, Atten= 1%, Lag= 1.0 min  
 Routed to Link DPD :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 3.05 fps, Min. Travel Time= 1.6 min  
 Avg. Velocity = 1.26 fps, Avg. Travel Time= 3.8 min

Peak Storage= 608 cf @ 12.21 hrs  
 Average Depth at Peak Storage= 0.04' , Surface Width= 51.65'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,527.56 cfs

50.00' x 1.00' deep channel, n= 0.020 Corrugated PE, corrugated interior  
 Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
 Length= 290.0' Slope= 0.1207 ' / '  
 Inlet Invert= 822.00', Outlet Invert= 787.00'



**Summary for Reach R6:**

Inflow Area = 16.243 ac, 0.00% Impervious, Inflow Depth = 3.66" for 100-YR event  
 Inflow = 64.15 cfs @ 12.22 hrs, Volume= 4.957 af  
 Outflow = 60.34 cfs @ 12.26 hrs, Volume= 4.957 af, Atten= 6%, Lag= 2.8 min  
 Routed to Link DPB :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 6.39 fps, Min. Travel Time= 4.2 min  
 Avg. Velocity = 1.62 fps, Avg. Travel Time= 16.6 min

Peak Storage= 15,140 cf @ 12.26 hrs  
 Average Depth at Peak Storage= 0.18' , Surface Width= 57.05'  
 Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,257.76 cfs

**2024-01-29 Existing Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/22/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 32

50.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
 Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
 Length= 1,606.0' Slope= 0.0990 ' / '  
 Inlet Invert= 895.00', Outlet Invert= 736.00'



**Summary for Link DPA:**

Inflow Area = 11.450 ac, 0.00% Impervious, Inflow Depth = 3.56" for 100-YR event  
 Inflow = 47.36 cfs @ 12.19 hrs, Volume= 3.398 af  
 Primary = 47.36 cfs @ 12.19 hrs, Volume= 3.398 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPB:**

Inflow Area = 16.243 ac, 0.00% Impervious, Inflow Depth = 3.66" for 100-YR event  
 Inflow = 60.34 cfs @ 12.26 hrs, Volume= 4.957 af  
 Primary = 60.34 cfs @ 12.26 hrs, Volume= 4.957 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPC:**

Inflow Area = 2.737 ac, 0.00% Impervious, Inflow Depth = 3.66" for 100-YR event  
 Inflow = 10.66 cfs @ 12.24 hrs, Volume= 0.835 af  
 Primary = 10.66 cfs @ 12.24 hrs, Volume= 0.835 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link DPD:**

Inflow Area = 1.557 ac, 0.00% Impervious, Inflow Depth = 3.66" for 100-YR event  
 Inflow = 6.40 cfs @ 12.21 hrs, Volume= 0.475 af  
 Primary = 6.40 cfs @ 12.21 hrs, Volume= 0.475 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2024-01-29 Existing Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/22/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 33

**Summary for Link DPE:**

Inflow Area = 6.564 ac, 0.00% Impervious, Inflow Depth = 2.98" for 100-YR event  
Inflow = 22.81 cfs @ 12.19 hrs, Volume= 1.628 af  
Primary = 22.81 cfs @ 12.19 hrs, Volume= 1.628 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 2L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership


HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Printed 2/23/2024

Page 2

**Rainfall Events Listing (selected events)**

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	1-YR	NRCC 24-hr	B	Default	24.00	1	2.25	2
2	10-YR	NRCC 24-hr	B	Default	24.00	1	3.95	2
3	50-YR	NRCC 24-hr	B	Default	24.00	1	5.35	2
4	100-YR	NRCC 24-hr	B	Default	24.00	1	5.98	2

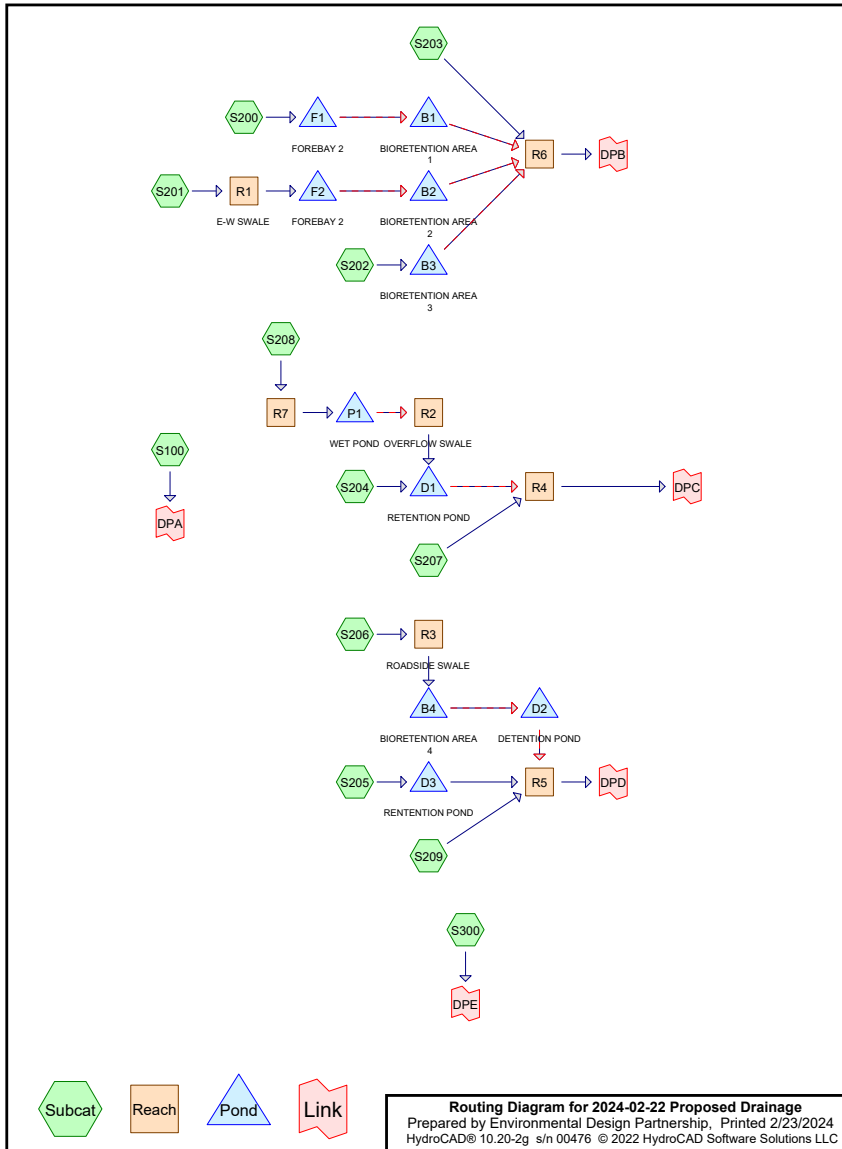

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Printed 2/23/2024

Page 3

**Area Listing (selected nodes)**

Area (acres)	CN	Description (subcatchment-numbers)
9.415	80	>75% Grass cover, Good, HSG D (S200, S201, S203, S208)
0.110	96	Gravel surface, HSG D (S203)
4.927	71	Meadow, non-grazed, HSG C (S300)
11.625	78	Meadow, non-grazed, HSG D (S100, S200, S201, S202, S203, S204, S205, S206, S207, S208, S209)
0.327	98	Paved parking, HSG C (S300)
0.523	98	Paved parking, HSG D (S202, S206)
7.107	98	SOLAR PANELS (S200, S201, S208)
1.260	73	Woods, Fair, HSG C (S300)
3.257	79	Woods, Fair, HSG D (S100, S200, S201, S203, S207, S208, S209)
<b>38.551</b>	<b>82</b>	<b>TOTAL AREA</b>

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Printed 2/23/2024

Page 4

**Soil Listing (selected nodes)**

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
6.514	HSG C	S300
24.930	HSG D	S100, S200, S201, S202, S203, S204, S205, S206, S207, S208, S209
7.107	Other	S200, S201, S208
<b>38.551</b>		<b>TOTAL AREA</b>

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Printed 2/23/2024

Page 5

**Ground Covers (selected nodes)**

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.000	9.415	0.000	9.415	>75% Grass cover, Good	S200, S201, S203, S208
0.000	0.000	0.000	0.110	0.000	0.110	Gravel surface	S203
0.000	0.000	4.927	11.625	0.000	16.552	Meadow, non-grazed	S100, S200, S201, S202, S203, S204, S205, S206, S207, S208, S209, S300
0.000	0.000	0.327	0.523	0.000	0.850	Paved parking	S202, S206, S300
0.000	0.000	0.000	0.000	7.107	7.107	SOLAR PANELS	S200, S201, S208
0.000	0.000	1.260	3.257	0.000	4.517	Woods, Fair	S100, S200, S201, S203, S207, S208, S209, S300
<b>0.000</b>	<b>0.000</b>	<b>6.514</b>	<b>24.930</b>	<b>7.107</b>	<b>38.551</b>	<b>TOTAL AREA</b>	

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Printed 2/23/2024

Page 6

**Pipe Listing (selected nodes)**

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Width (inches)	Diam/Height (inches)	Inside-Fill (inches)
1	B1	900.50	899.00	50.0	0.0300	0.020	0.0	8.0	0.0
2	B2	900.50	899.00	50.0	0.0300	0.020	0.0	8.0	0.0
3	B3	895.50	895.00	60.0	0.0083	0.020	0.0	8.0	0.0
4	B4	835.50	834.00	25.0	0.0600	0.020	0.0	8.0	0.0
5	D1	864.00	863.00	50.0	0.0200	0.020	0.0	15.0	0.0
6	D2	833.90	833.00	30.0	0.0300	0.020	0.0	10.0	0.0
7	D3	838.00	837.00	100.0	0.0100	0.020	0.0	12.0	0.0
8	P1	893.90	892.00	70.0	0.0271	0.020	0.0	18.0	0.0

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 7

Time span=0.00-36.00 hrs, dt=0.02 hrs, 1801 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>SubcatchmentS100:</b>	Runoff Area=2.376 ac 0.00% Impervious Runoff Depth=0.63" Flow Length=775' Tc=11.3 min CN=78 Runoff=1.65 cfs 0.125 af
<b>SubcatchmentS200:</b>	Runoff Area=4.851 ac 34.30% Impervious Runoff Depth=1.04" Flow Length=1,171' Tc=13.3 min CN=86 Runoff=5.53 cfs 0.421 af
<b>SubcatchmentS201:</b>	Runoff Area=4.342 ac 35.08% Impervious Runoff Depth=1.04" Flow Length=636' Tc=9.7 min CN=86 Runoff=5.63 cfs 0.377 af
<b>SubcatchmentS202:</b>	Runoff Area=0.583 ac 34.82% Impervious Runoff Depth=0.98" Flow Length=319' Tc=2.7 min CN=85 Runoff=0.94 cfs 0.048 af
<b>SubcatchmentS203:</b>	Runoff Area=5.029 ac 0.00% Impervious Runoff Depth=0.67" Flow Length=1,218' Tc=16.3 min CN=79 Runoff=3.21 cfs 0.283 af
<b>SubcatchmentS204:</b>	Runoff Area=0.687 ac 0.00% Impervious Runoff Depth=0.63" Flow Length=200' Tc=7.4 min CN=78 Runoff=0.56 cfs 0.036 af
<b>SubcatchmentS205:</b>	Runoff Area=0.484 ac 0.00% Impervious Runoff Depth=0.63" Flow Length=450' Tc=9.0 min CN=78 Runoff=0.37 cfs 0.025 af
<b>SubcatchmentS206:</b>	Runoff Area=0.883 ac 36.24% Impervious Runoff Depth=0.98" Tc=6.0 min CN=85 Runoff=1.26 cfs 0.072 af
<b>SubcatchmentS207:</b>	Runoff Area=0.847 ac 0.00% Impervious Runoff Depth=0.67" Flow Length=180' Tc=8.1 min CN=79 Runoff=0.73 cfs 0.048 af
<b>SubcatchmentS208:</b>	Runoff Area=11.490 ac 34.12% Impervious Runoff Depth=1.04" Flow Length=670' Tc=10.3 min CN=86 Runoff=14.58 cfs 0.998 af
<b>SubcatchmentS209:</b>	Runoff Area=0.465 ac 0.00% Impervious Runoff Depth=0.63" Tc=6.0 min CN=78 Runoff=0.41 cfs 0.024 af
<b>SubcatchmentS300:</b>	Runoff Area=6.514 ac 5.02% Impervious Runoff Depth=0.44" Flow Length=1,800' Tc=15.0 min CN=73 Runoff=2.44 cfs 0.238 af
<b>Reach R1: E-W SWALE</b>	Avg. Flow Depth=0.33' Max Vel=8.63 fps Inflow=5.63 cfs 0.377 af n=0.022 L=485.0' S=0.1299 '/' Capacity=65.06 cfs Outflow=5.59 cfs 0.377 af
<b>Reach R2: OVERFLOW SWALE</b>	Avg. Flow Depth=0.04' Max Vel=3.49 fps Inflow=0.31 cfs 0.576 af n=0.022 L=120.0' S=0.1958 '/' Capacity=507.22 cfs Outflow=0.31 cfs 0.576 af
<b>Reach R3: ROADSIDE SWALE</b>	Avg. Flow Depth=0.18' Max Vel=4.05 fps Inflow=1.26 cfs 0.072 af n=0.030 L=825.0' S=0.1018 '/' Capacity=42.24 cfs Outflow=1.12 cfs 0.072 af
<b>Reach R4:</b>	Avg. Flow Depth=0.02' Max Vel=1.29 fps Inflow=1.41 cfs 0.658 af n=0.035 L=360.0' S=0.1778 '/' Capacity=1,059.41 cfs Outflow=1.24 cfs 0.656 af

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 8

<b>Reach R5:</b>	Avg. Flow Depth=0.01' Max Vel=1.37 fps Inflow=0.42 cfs 0.102 af n=0.020 L=220.0' S=0.1591 '/' Capacity=1,753.82 cfs Outflow=0.37 cfs 0.102 af
<b>Reach R6:</b>	Avg. Flow Depth=0.03' Max Vel=1.92 fps Inflow=3.62 cfs 0.823 af n=0.022 L=1,606.0' S=0.0990 '/' Capacity=1,257.76 cfs Outflow=2.61 cfs 0.818 af
<b>Reach R7:</b>	Avg. Flow Depth=0.47' Max Vel=8.94 fps Inflow=14.58 cfs 0.998 af n=0.022 L=330.0' S=0.0788 '/' Capacity=321.73 cfs Outflow=14.52 cfs 0.998 af
<b>Pond B1: BIORETENTIONAREA 1</b>	Peak Elev=903.55' Storage=3,464 cf Inflow=2.24 cfs 0.251 af Primary=0.08 cfs 0.146 af Secondary=0.49 cfs 0.102 af Outflow=0.57 cfs 0.248 af
<b>Pond B2: BIORETENTIONAREA 2</b>	Peak Elev=903.56' Storage=3,265 cf Inflow=2.92 cfs 0.247 af Primary=0.07 cfs 0.136 af Secondary=0.64 cfs 0.108 af Outflow=0.71 cfs 0.245 af
<b>Pond B3: BIORETENTIONAREA 3</b>	Peak Elev=898.61' Storage=639 cf Inflow=0.94 cfs 0.048 af Primary=0.01 cfs 0.026 af Secondary=0.44 cfs 0.022 af Outflow=0.46 cfs 0.048 af
<b>Pond B4: BIORETENTIONAREA 4</b>	Peak Elev=838.54' Storage=1,602 cf Inflow=1.12 cfs 0.072 af Primary=0.02 cfs 0.040 af Secondary=0.13 cfs 0.016 af Outflow=0.15 cfs 0.056 af
<b>Pond D1: RETENTION POND</b>	Peak Elev=864.40' Storage=117 cf Inflow=0.74 cfs 0.612 af Primary=0.70 cfs 0.611 af Secondary=0.00 cfs 0.000 af Outflow=0.70 cfs 0.611 af
<b>Pond D2: DETENTION POND</b>	Peak Elev=834.68' Storage=216 cf Inflow=0.15 cfs 0.056 af Primary=0.08 cfs 0.056 af Secondary=0.00 cfs 0.000 af Outflow=0.08 cfs 0.056 af
<b>Pond D3: RETENTION POND</b>	Peak Elev=838.26' Storage=280 cf Inflow=0.37 cfs 0.025 af 12.0' Round Culvert n=0.020 L=100.0' S=0.0100 '/' Outflow=0.20 cfs 0.021 af
<b>Pond F1: FOREBAY 2</b>	Peak Elev=903.63' Storage=7,900 cf Inflow=5.53 cfs 0.421 af Outflow=2.24 cfs 0.251 af
<b>Pond F2: FOREBAY 2</b>	Peak Elev=903.65' Storage=6,162 cf Inflow=5.59 cfs 0.377 af Outflow=2.92 cfs 0.247 af
<b>Pond P1: WET POND</b>	Peak Elev=895.85' Storage=49,442 cf Inflow=14.52 cfs 0.998 af Primary=0.31 cfs 0.576 af Secondary=0.00 cfs 0.000 af Outflow=0.31 cfs 0.576 af
<b>Link DPA:</b>	Inflow=1.65 cfs 0.125 af Primary=1.65 cfs 0.125 af
<b>Link DPB:</b>	Inflow=2.61 cfs 0.818 af Primary=2.61 cfs 0.818 af
<b>Link DPC:</b>	Inflow=1.24 cfs 0.656 af Primary=1.24 cfs 0.656 af
<b>Link DPD:</b>	Inflow=0.37 cfs 0.102 af Primary=0.37 cfs 0.102 af

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 9

**Link DPE:**Inflow=2.44 cfs 0.238 af  
Primary=2.44 cfs 0.238 af**Total Runoff Area = 38.551 ac Runoff Volume = 2.696 af Average Runoff Depth = 0.84"**  
**79.36% Pervious = 30.594 ac 20.64% Impervious = 7.957 ac****2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 10

**Summary for Subcatchment S100:**Runoff = 1.65 cfs @ 12.20 hrs, Volume= 0.125 af, Depth= 0.63"  
Routed to Link DPA :Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
0.763	79	Woods, Fair, HSG D
1.613	78	Meadow, non-grazed, HSG D
2.376	78	Weighted Average
2.376		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.7	50	0.2800	0.18		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
3.1	50	0.2800	0.27		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
3.2	635	0.2272	3.34		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
0.3	40	0.2272	2.38		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
11.3	775				Total

**Summary for Subcatchment S200:**Runoff = 5.53 cfs @ 12.22 hrs, Volume= 0.421 af, Depth= 1.04"  
Routed to Pond F1 : FOREBAY 2Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
0.013	79	Woods, Fair, HSG D
0.992	78	Meadow, non-grazed, HSG D
1.664	98	SOLAR PANELS
2.182	80	>75% Grass cover, Good, HSG D
4.851	86	Weighted Average
3.187		65.70% Pervious Area
1.664		34.30% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	100	0.1500	0.24		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
6.3	1,071	0.1634	2.83		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
13.3	1,171				Total

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 11

**Summary for Subcatchment S201:**

Runoff = 5.63 cfs @ 12.17 hrs, Volume= 0.377 af, Depth= 1.04"  
Routed to Reach R1 : E-W SWALE

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
0.014	79	Woods, Fair, HSG D
1.056	78	Meadow, non-grazed, HSG D
1.523	98	SOLAR PANELS
1.749	80	>75% Grass cover, Good, HSG D
4.342	86	Weighted Average
2.819		64.92% Pervious Area
1.523		35.08% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8	100	0.1600	0.25		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
2.9	536	0.1900	3.05		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
9.7	636	Total			

**Summary for Subcatchment S202:**

Runoff = 0.94 cfs @ 12.10 hrs, Volume= 0.048 af, Depth= 0.98"  
Routed to Pond B3 : BIORETENTION AREA 3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
0.380	78	Meadow, non-grazed, HSG D
0.203	98	Paved parking, HSG D
0.583	85	Weighted Average
0.380		65.18% Pervious Area
0.203		34.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0	100	0.1500	0.84		<b>Sheet Flow, SF - GRAVEL</b> Fallow n= 0.050 P2= 2.68"
0.7	219	0.1100	4.97		<b>Shallow Concentrated Flow, SCF - CHANNEL</b> Grassed Waterway Kv= 15.0 fps
2.7	319	Total			

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 12

**Summary for Subcatchment S203:**

Runoff = 3.21 cfs @ 12.26 hrs, Volume= 0.283 af, Depth= 0.67"  
Routed to Reach R6 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
3.148	78	Meadow, non-grazed, HSG D
1.685	79	Woods, Fair, HSG D
0.110	96	Gravel surface, HSG D
0.086	80	>75% Grass cover, Good, HSG D
5.029	79	Weighted Average
5.029		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	100	0.1900	0.17		<b>Sheet Flow, SF - MEADOW</b> Woods: Light underbrush n= 0.400 P2= 2.68"
6.8	1,118	0.1512	2.72		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
16.3	1,218	Total			

**Summary for Subcatchment S204:**

Runoff = 0.56 cfs @ 12.15 hrs, Volume= 0.036 af, Depth= 0.63"  
Routed to Pond D1 : RETENTION POND

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
0.687	78	Meadow, non-grazed, HSG D
0.687		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8	100	0.1600	0.25		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
0.6	100	0.1500	2.71		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
7.4	200	Total			



**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 13

**Summary for Subcatchment S205:**

Runoff = 0.37 cfs @ 12.17 hrs, Volume= 0.025 af, Depth= 0.63"  
 Routed to Pond D3 : RENTENTION POND

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
0.484	78	Meadow, non-grazed, HSG D
0.484		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	100	0.1700	0.25		<b>Sheet Flow, SF - WOODS</b> Grass: Dense n= 0.240 P2= 2.68"
2.4	350	0.1200	2.42		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
9.0	450				Total

**Summary for Subcatchment S206:**

Runoff = 1.26 cfs @ 12.13 hrs, Volume= 0.072 af, Depth= 0.98"  
 Routed to Reach R3 : ROADSIDE SWALE

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
0.320	98	Paved parking, HSG D
0.563	78	Meadow, non-grazed, HSG D
0.883	85	Weighted Average
0.563		63.76% Pervious Area
0.320		36.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, MIN</b>

**Summary for Subcatchment S207:**

Runoff = 0.73 cfs @ 12.16 hrs, Volume= 0.048 af, Depth= 0.67"  
 Routed to Reach R4 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 1-YR Rainfall=2.25"

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 14

Area (ac)	CN	Description
0.683	79	Woods, Fair, HSG D
0.164	78	Meadow, non-grazed, HSG D
0.847	79	Weighted Average
0.847		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	30	0.5000	0.30		<b>Sheet Flow, SF</b> Grass: Dense n= 0.240 P2= 2.68"
6.0	70	0.3000	0.20		<b>Sheet Flow, SF WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
0.5	80	0.3000	2.74		<b>Shallow Concentrated Flow, SCF</b> Woodland Kv= 5.0 fps
8.1	180				Total

**Summary for Subcatchment S208:**

Runoff = 14.58 cfs @ 12.18 hrs, Volume= 0.998 af, Depth= 1.04"  
 Routed to Reach R7 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
0.087	79	Woods, Fair, HSG D
2.085	78	Meadow, non-grazed, HSG D
3.920	98	SOLAR PANELS
5.398	80	>75% Grass cover, Good, HSG D
11.490	86	Weighted Average
7.570		65.88% Pervious Area
3.920		34.12% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.4	100	0.1300	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
2.9	570	0.2235	3.31		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
10.3	670				Total

**Summary for Subcatchment S209:**

Runoff = 0.41 cfs @ 12.14 hrs, Volume= 0.024 af, Depth= 0.63"  
 Routed to Reach R5 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 1-YR Rainfall=2.25"

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024  
Page 15

Area (ac)	CN	Description
0.012	79	Woods, Fair, HSG D
0.453	78	Meadow, non-grazed, HSG D
0.465	78	Weighted Average
0.465		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, MIN

**Summary for Subcatchment S300:**

Runoff = 2.44 cfs @ 12.26 hrs, Volume= 0.238 af, Depth= 0.44"  
Routed to Link DPE :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 1-YR Rainfall=2.25"

Area (ac)	CN	Description
0.327	98	Paved parking, HSG C
4.927	71	Meadow, non-grazed, HSG C
1.260	73	Woods, Fair, HSG C
6.514	73	Weighted Average
6.187		94.98% Pervious Area
0.327		5.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.2	100	0.1400	0.23		Sheet Flow, SF - MEADOW Grass: Dense n= 0.240 P2= 2.68"
7.8	1,700	0.0588	3.64		Shallow Concentrated Flow, SCF - MEADOW Grassed Waterway Kv= 15.0 fps
15.0	1,800	Total			

**Summary for Reach R1: E-W SWALE**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 1.04" for 1-YR event  
Inflow = 5.63 cfs @ 12.17 hrs, Volume= 0.377 af  
Outflow = 5.59 cfs @ 12.19 hrs, Volume= 0.377 af, Atten= 1%, Lag= 0.7 min  
Routed to Pond F2 : FOREBAY 2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 8.63 fps, Min. Travel Time= 0.9 min  
Avg. Velocity = 2.94 fps, Avg. Travel Time= 2.8 min

Peak Storage= 314 cf @ 12.19 hrs  
Average Depth at Peak Storage= 0.33' , Surface Width= 2.96'  
Bank-Full Depth= 1.00' Flow Area= 4.0 sf, Capacity= 65.06 cfs

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024  
Page 16

1.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 3.0 ' / ' Top Width= 7.00'  
Length= 485.0' Slope= 0.1299 ' / '  
Inlet Invert= 968.00', Outlet Invert= 905.00'



**Summary for Reach R2: OVERFLOW SWALE**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth > 0.60" for 1-YR event  
Inflow = 0.31 cfs @ 18.22 hrs, Volume= 0.576 af  
Outflow = 0.31 cfs @ 18.22 hrs, Volume= 0.576 af, Atten= 0%, Lag= 0.3 min  
Routed to Pond D1 : RETENTION POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 3.49 fps, Min. Travel Time= 0.6 min  
Avg. Velocity = 3.31 fps, Avg. Travel Time= 0.6 min

Peak Storage= 11 cf @ 18.22 hrs  
Average Depth at Peak Storage= 0.04' , Surface Width= 2.25'  
Bank-Full Depth= 2.00' Flow Area= 16.0 sf, Capacity= 507.22 cfs

2.00' x 2.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 3.0 ' / ' Top Width= 14.00'  
Length= 120.0' Slope= 0.1958 ' / '  
Inlet Invert= 893.50', Outlet Invert= 870.00'



**Summary for Reach R3: ROADSIDE SWALE**

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth = 0.98" for 1-YR event  
Inflow = 1.26 cfs @ 12.13 hrs, Volume= 0.072 af  
Outflow = 1.12 cfs @ 12.16 hrs, Volume= 0.072 af, Atten= 11%, Lag= 1.8 min  
Routed to Pond B4 : BIORETENTION AREA 4

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 4.05 fps, Min. Travel Time= 3.4 min  
Avg. Velocity = 1.26 fps, Avg. Travel Time= 10.9 min

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 17

Peak Storage= 229 cf @ 12.16 hrs  
Average Depth at Peak Storage= 0.18' , Surface Width= 2.08'  
Bank-Full Depth= 1.00' Flow Area= 4.0 sf, Capacity= 42.24 cfs

1.00' x 1.00' deep channel, n= 0.030 Earth, grassed & winding  
Side Slope Z-value= 3.0 ' / ' Top Width= 7.00'  
Length= 825.0' Slope= 0.1018 ' / '  
Inlet Invert= 924.00' , Outlet Invert= 840.00'



**Summary for Reach R4:**

Inflow Area = 13.024 ac, 30.10% Impervious, Inflow Depth > 0.61" for 1-YR event  
Inflow = 1.41 cfs @ 12.17 hrs, Volume= 0.658 af  
Outflow = 1.24 cfs @ 12.22 hrs, Volume= 0.656 af, Atten= 12%, Lag= 3.0 min  
Routed to Link DPC :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 1.29 fps, Min. Travel Time= 4.7 min  
Avg. Velocity = 0.84 fps, Avg. Travel Time= 7.2 min

Peak Storage= 347 cf @ 12.22 hrs  
Average Depth at Peak Storage= 0.02' , Surface Width= 50.76'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,059.41 cfs

50.00' x 1.00' deep channel, n= 0.035 Earth, dense weeds  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 360.0' Slope= 0.1778 ' / '  
Inlet Invert= 831.00' , Outlet Invert= 767.00'



**Summary for Reach R5:**

Inflow Area = 1.832 ac, 17.47% Impervious, Inflow Depth > 0.67" for 1-YR event  
Inflow = 0.42 cfs @ 12.14 hrs, Volume= 0.102 af  
Outflow = 0.37 cfs @ 12.18 hrs, Volume= 0.102 af, Atten= 12%, Lag= 2.3 min  
Routed to Link DPD :

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 18

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 1.37 fps, Min. Travel Time= 2.7 min  
Avg. Velocity = 1.37 fps, Avg. Travel Time= 2.7 min

Peak Storage= 59 cf @ 12.18 hrs  
Average Depth at Peak Storage= 0.01' , Surface Width= 50.21'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,753.82 cfs

50.00' x 1.00' deep channel, n= 0.020 Corrugated PE, corrugated interior  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 220.0' Slope= 0.1591 ' / '  
Inlet Invert= 822.00' , Outlet Invert= 787.00'



**Summary for Reach R6:**

Inflow Area = 14.805 ac, 22.90% Impervious, Inflow Depth > 0.67" for 1-YR event  
Inflow = 3.62 cfs @ 12.26 hrs, Volume= 0.823 af  
Outflow = 2.61 cfs @ 12.41 hrs, Volume= 0.818 af, Atten= 28%, Lag= 9.1 min  
Routed to Link DPB :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 1.92 fps, Min. Travel Time= 13.9 min  
Avg. Velocity = 1.05 fps, Avg. Travel Time= 25.4 min

Peak Storage= 2,177 cf @ 12.41 hrs  
Average Depth at Peak Storage= 0.03' , Surface Width= 51.07'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,257.76 cfs

50.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 1,606.0' Slope= 0.0990 ' / '  
Inlet Invert= 895.00' , Outlet Invert= 736.00'



**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 19

**Summary for Reach R7:**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth = 1.04" for 1-YR event  
 Inflow = 14.58 cfs @ 12.18 hrs, Volume= 0.998 af  
 Outflow = 14.52 cfs @ 12.19 hrs, Volume= 0.998 af, Atten= 0%, Lag= 0.4 min  
 Routed to Pond P1 : WET POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Max. Velocity= 8.94 fps, Min. Travel Time= 0.6 min  
 Avg. Velocity = 2.97 fps, Avg. Travel Time= 1.9 min

Peak Storage= 535 cf @ 12.19 hrs  
 Average Depth at Peak Storage= 0.47' , Surface Width= 4.84'  
 Bank-Full Depth= 2.00' Flow Area= 16.0 sf, Capacity= 321.73 cfs

2.00' x 2.00' deep channel, n= 0.022 Earth, clean & straight  
 Side Slope Z-value= 3.0 ' / ' Top Width= 14.00'  
 Length= 330.0' Slope= 0.0788 ' / '  
 Inlet Invert= 924.00', Outlet Invert= 898.00'



**Summary for Pond B1: BIORETENTION AREA 1**

Inflow Area = 4.851 ac, 34.30% Impervious, Inflow Depth = 0.62" for 1-YR event  
 Inflow = 2.24 cfs @ 12.48 hrs, Volume= 0.251 af  
 Outflow = 0.57 cfs @ 13.39 hrs, Volume= 0.248 af, Atten= 74%, Lag= 54.4 min  
 Primary = 0.08 cfs @ 13.39 hrs, Volume= 0.146 af

Routed to Reach R6 :  
 Secondary = 0.49 cfs @ 13.39 hrs, Volume= 0.102 af  
 Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 903.55' @ 13.39 hrs Surf.Area= 6,666 sf Storage= 3,464 cf

Plug-Flow detention time= 308.1 min calculated for 0.248 af (99% of inflow)  
 Center-of-Mass det. time= 302.0 min ( 1,237.3 - 935.3 )

Volume	Invert	Avail.Storage	Storage Description			
#1	903.00'	14,542 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
903.00	5,991	427.0	0	0	5,991	
905.00	8,631	465.0	14,542	14,542	8,832	

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 20

Device	Routing	Invert	Outlet Devices
#1	Primary	900.50'	<b>8.0" Round Culvert</b> L= 50.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 900.50' / 899.00' S= 0.0300 ' / ' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf
#2	Secondary	903.50'	<b>20.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Device 1	903.00'	<b>0.500 in/hr Exfiltration over Surface area</b>

**Primary OutFlow** Max=0.08 cfs @ 13.39 hrs HW=903.55' TW=895.02' (Dynamic Tailwater)  
 ↳1=Culvert (Passes 0.08 cfs of 1.97 cfs potential flow)  
 ↳3=Exfiltration (Exfiltration Controls 0.08 cfs)

**Secondary OutFlow** Max=0.49 cfs @ 13.39 hrs HW=903.55' TW=895.02' (Dynamic Tailwater)  
 ↳2=Broad-Crested Rectangular Weir(Weir Controls 0.49 cfs @ 0.52 fps)

**Summary for Pond B2: BIORETENTION AREA 2**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 0.68" for 1-YR event  
 Inflow = 2.92 cfs @ 12.34 hrs, Volume= 0.247 af  
 Outflow = 0.71 cfs @ 13.02 hrs, Volume= 0.245 af, Atten= 76%, Lag= 40.9 min  
 Primary = 0.07 cfs @ 13.02 hrs, Volume= 0.136 af

Routed to Reach R6 :  
 Secondary = 0.64 cfs @ 13.02 hrs, Volume= 0.108 af  
 Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 903.56' @ 13.02 hrs Surf.Area= 6,192 sf Storage= 3,265 cf

Plug-Flow detention time= 293.5 min calculated for 0.245 af (99% of inflow)  
 Center-of-Mass det. time= 288.1 min ( 1,203.9 - 915.8 )

Volume	Invert	Avail.Storage	Storage Description			
#1	903.00'	13,497 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
903.00	5,550	421.0	0	0	5,550	
905.00	8,023	459.0	13,497	13,497	8,353	

Device	Routing	Invert	Outlet Devices
#1	Primary	900.50'	<b>8.0" Round Culvert</b> L= 50.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 900.50' / 899.00' S= 0.0300 ' / ' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf
#2	Secondary	903.50'	<b>20.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 21

Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66  
2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

#3 Device 1 903.00' **0.500 in/hr Exfiltration over Surface area**

**Primary OutFlow** Max=0.07 cfs @ 13.02 hrs HW=903.56' TW=895.02' (Dynamic Tailwater)

↳**1=Culvert** (Passes 0.07 cfs of 1.97 cfs potential flow)

↳**3=Exfiltration** (Exfiltration Controls 0.07 cfs)

**Secondary OutFlow** Max=0.64 cfs @ 13.02 hrs HW=903.56' TW=895.02' (Dynamic Tailwater)

↳**2=Broad-Crested Rectangular Weir**(Weir Controls 0.64 cfs @ 0.56 fps)

**Summary for Pond B3: BIORETENTION AREA 3**

Inflow Area = 0.583 ac, 34.82% Impervious, Inflow Depth = 0.98" for 1-YR event  
Inflow = 0.94 cfs @ 12.10 hrs, Volume= 0.048 af  
Outflow = 0.46 cfs @ 12.16 hrs, Volume= 0.048 af, Atten= 51%, Lag= 3.8 min  
Primary = 0.01 cfs @ 12.16 hrs, Volume= 0.026 af

Routed to Reach R6 :

Secondary = 0.44 cfs @ 12.16 hrs, Volume= 0.022 af

Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

Peak Elev= 898.61' @ 12.16 hrs Surf.Area= 1,289 sf Storage= 639 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)

Center-of-Mass det. time= 250.5 min ( 1,089.1 - 838.6 )

Volume	Invert	Avail.Storage	Storage Description
#1	898.00'	3,200 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
898.00	800	0	0
900.00	2,400	3,200	3,200

Device	Routing	Invert	Outlet Devices
#1	Device 3	898.00'	<b>0.500 in/hr Exfiltration over Surface area</b>
#2	Secondary	898.50'	<b>5.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Primary	895.50'	<b>8.0" Round Culvert</b> L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 895.50' / 895.00' S= 0.0083 '/ Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 22

**Primary OutFlow** Max=0.01 cfs @ 12.16 hrs HW=898.61' TW=895.01' (Dynamic Tailwater)

↳**3=Culvert** (Passes 0.01 cfs of 1.56 cfs potential flow)

↳**1=Exfiltration** (Exfiltration Controls 0.01 cfs)

**Secondary OutFlow** Max=0.44 cfs @ 12.16 hrs HW=898.61' TW=895.01' (Dynamic Tailwater)

↳**2=Broad-Crested Rectangular Weir**(Weir Controls 0.44 cfs @ 0.79 fps)

**Summary for Pond B4: BIORETENTION AREA 4**

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth = 0.98" for 1-YR event  
Inflow = 1.12 cfs @ 12.16 hrs, Volume= 0.072 af  
Outflow = 0.15 cfs @ 12.87 hrs, Volume= 0.056 af, Atten= 86%, Lag= 42.5 min  
Primary = 0.02 cfs @ 12.87 hrs, Volume= 0.040 af  
Routed to Pond D2 : DETENTION POND  
Secondary = 0.13 cfs @ 12.87 hrs, Volume= 0.016 af  
Routed to Pond D2 : DETENTION POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

Peak Elev= 838.54' @ 12.87 hrs Surf.Area= 1,887 sf Storage= 1,602 cf

Plug-Flow detention time= 481.3 min calculated for 0.056 af (78% of inflow)

Center-of-Mass det. time= 393.2 min ( 1,242.1 - 848.9 )

Volume	Invert	Avail.Storage	Storage Description
#1	837.00'	5,303 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
837.00	15	0	0
838.00	1,417	716	716
840.00	3,170	4,587	5,303

Device	Routing	Invert	Outlet Devices
#1	Device 3	837.00'	<b>0.500 in/hr Exfiltration over Surface area</b>
#2	Secondary	838.50'	<b>8.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Primary	835.50'	<b>8.0" Round Culvert</b> L= 25.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 835.50' / 834.00' S= 0.0600 '/ Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf

**Primary OutFlow** Max=0.02 cfs @ 12.87 hrs HW=838.54' TW=834.39' (Dynamic Tailwater)

↳**3=Culvert** (Passes 0.02 cfs of 2.18 cfs potential flow)

↳**1=Exfiltration** (Exfiltration Controls 0.02 cfs)

**Secondary OutFlow** Max=0.13 cfs @ 12.87 hrs HW=838.54' TW=834.39' (Dynamic Tailwater)

↳**2=Broad-Crested Rectangular Weir**(Weir Controls 0.13 cfs @ 0.46 fps)

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 23

**Summary for Pond D1: RETENTION POND**

Inflow Area = 12.177 ac, 32.19% Impervious, Inflow Depth > 0.60" for 1-YR event  
 Inflow = 0.74 cfs @ 12.16 hrs, Volume= 0.612 af  
 Outflow = 0.70 cfs @ 12.19 hrs, Volume= 0.611 af, Atten= 5%, Lag= 1.7 min  
 Primary = 0.70 cfs @ 12.19 hrs, Volume= 0.611 af

Routed to Reach R4 :  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Reach R4 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 864.40' @ 12.19 hrs Surf.Area= 357 sf Storage= 117 cf

Plug-Flow detention time= 3.9 min calculated for 0.610 af (100% of inflow)  
 Center-of-Mass det. time= 2.1 min ( 1,389.1 - 1,387.0 )

Volume	Invert	Avail.Storage	Storage Description			
#1	864.00'	12,104 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
864.00	230	80.0	0	0	230	
866.00	1,140	145.0	1,255	1,255	1,415	
868.00	2,560	210.0	3,606	4,860	3,286	
870.00	4,800	270.0	7,244	12,104	5,627	

Device	Routing	Invert	Outlet Devices									
#1	Primary	864.00'	<b>15.0" Round Culvert</b> L= 50.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 864.00' / 863.00' S= 0.0200 '/' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 1.23 sf									
#2	Secondary	868.75'	<b>10.0' long x 6.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.37 2.51 2.70 2.68 2.68 2.67 2.65 2.65 2.65 2.65 2.66 2.66 2.67 2.69 2.72 2.76 2.83									

**Primary OutFlow** Max=0.70 cfs @ 12.19 hrs HW=864.40' TW=831.02' (Dynamic Tailwater)  
 ↳1=Culvert (Barrel Controls 0.70 cfs @ 3.09 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=864.00' TW=831.00' (Dynamic Tailwater)  
 ↳2=Broad-Crested Rectangular Weir ( Controls 0.00 cfs)

**Summary for Pond D2: DETENTION POND****2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 24

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth > 0.77" for 1-YR event  
 Inflow = 0.15 cfs @ 12.87 hrs, Volume= 0.056 af  
 Outflow = 0.08 cfs @ 13.69 hrs, Volume= 0.056 af, Atten= 48%, Lag= 49.0 min  
 Primary = 0.08 cfs @ 13.69 hrs, Volume= 0.056 af  
 Routed to Reach R5 :  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Reach R5 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 834.68' @ 13.69 hrs Surf.Area= 504 sf Storage= 216 cf

Plug-Flow detention time= 24.7 min calculated for 0.056 af (99% of inflow)  
 Center-of-Mass det. time= 17.6 min ( 1,259.7 - 1,242.1 )

Volume	Invert	Avail.Storage	Storage Description			
#1	834.00'	6,977 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
834.00	160	85.0	0	0	160	
836.00	1,710	225.0	1,595	1,595	3,628	
838.00	3,810	285.0	5,382	6,977	6,115	

Device	Routing	Invert	Outlet Devices									
#1	Secondary	836.75'	<b>10.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32									
#2	Device 4	834.00'	<b>2.0" Vert. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads									
#3	Device 4	836.00'	<b>10.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads									
#4	Primary	833.90'	<b>10.0" Round Culvert</b> L= 30.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 833.90' / 833.00' S= 0.0300 '/' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.55 sf									

**Primary OutFlow** Max=0.08 cfs @ 13.69 hrs HW=834.68' TW=822.00' (Dynamic Tailwater)  
 ↳4=Culvert (Passes 0.08 cfs of 1.26 cfs potential flow)  
 ↳2=Orifice/Grate (Orifice Controls 0.08 cfs @ 3.73 fps)  
 ↳3=Orifice/Grate ( Controls 0.00 cfs)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=834.00' TW=822.00' (Dynamic Tailwater)  
 ↳1=Broad-Crested Rectangular Weir ( Controls 0.00 cfs)

**Summary for Pond D3: RETENTION POND**

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 1-YR Rainfall=2.25"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 25

Inflow Area = 0.484 ac, 0.00% Impervious, Inflow Depth = 0.63" for 1-YR event  
 Inflow = 0.37 cfs @ 12.17 hrs, Volume= 0.025 af  
 Outflow = 0.20 cfs @ 12.32 hrs, Volume= 0.021 af, Atten= 47%, Lag= 8.9 min  
 Primary = 0.20 cfs @ 12.32 hrs, Volume= 0.021 af  
 Routed to Reach R5 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 838.26' @ 12.32 hrs Surf.Area= 418 sf Storage= 280 cf

Plug-Flow detention time= 126.9 min calculated for 0.021 af (83% of inflow)  
 Center-of-Mass det. time= 51.5 min ( 923.0 - 871.5 )

Volume	Invert	Avail.Storage	Storage Description
#1	837.00'	1,625 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
837.00	60	0	0
838.00	310	185	185
840.00	1,130	1,440	1,625

Device	Routing	Invert	Outlet Devices
#1	Primary	838.00'	<b>12.0" Round Culvert</b> L= 100.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 838.00' / 837.00' S= 0.0100 ' / Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.20 cfs @ 12.32 hrs HW=838.26' TW=822.01' (Dynamic Tailwater)  
 ↳1=Culvert (Barrel Controls 0.20 cfs @ 1.79 fps)

**Summary for Pond F1: FOREBAY 2**

Inflow Area = 4.851 ac, 34.30% Impervious, Inflow Depth = 1.04" for 1-YR event  
 Inflow = 5.53 cfs @ 12.22 hrs, Volume= 0.421 af  
 Outflow = 2.24 cfs @ 12.48 hrs, Volume= 0.251 af, Atten= 60%, Lag= 16.1 min  
 Primary = 2.24 cfs @ 12.48 hrs, Volume= 0.251 af  
 Routed to Pond B1 : BIORETENTION AREA 1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 903.63' @ 12.48 hrs Surf.Area= 3,885 sf Storage= 7,900 cf

Plug-Flow detention time= 202.2 min calculated for 0.251 af (60% of inflow)  
 Center-of-Mass det. time= 90.8 min ( 935.3 - 844.5 )

Volume	Invert	Avail.Storage	Storage Description
#1	899.00'	14,382 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 1-YR Rainfall=2.25"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 26

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
899.00	218	86.0	0	0	218
901.00	1,277	230.0	1,348	1,348	3,853
903.00	3,198	372.0	4,331	5,679	10,682
905.00	5,618	426.0	8,703	14,382	14,203

Device	Routing	Invert	Outlet Devices
#1	Primary	903.50'	<b>20.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32

**Primary OutFlow** Max=2.23 cfs @ 12.48 hrs HW=903.63' TW=903.10' (Dynamic Tailwater)  
 ↳1=Broad-Crested Rectangular Weir (Weir Controls 2.23 cfs @ 0.87 fps)

**Summary for Pond F2: FOREBAY 2**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 1.04" for 1-YR event  
 Inflow = 5.59 cfs @ 12.19 hrs, Volume= 0.377 af  
 Outflow = 2.92 cfs @ 12.34 hrs, Volume= 0.247 af, Atten= 48%, Lag= 9.2 min  
 Primary = 2.92 cfs @ 12.34 hrs, Volume= 0.247 af  
 Routed to Pond B2 : BIORETENTION AREA 2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 903.65' @ 12.34 hrs Surf.Area= 3,279 sf Storage= 6,162 cf

Plug-Flow detention time= 179.2 min calculated for 0.247 af (65% of inflow)  
 Center-of-Mass det. time= 72.8 min ( 915.8 - 843.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	899.00'	11,697 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
899.00	98	53.0	0	0	98
901.00	930	189.0	887	887	2,728
903.00	2,575	324.0	3,368	4,255	8,263
905.00	5,000	439.0	7,442	11,697	15,287

Device	Routing	Invert	Outlet Devices
#1	Primary	903.50'	<b>20.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32

**Primary OutFlow** Max=2.91 cfs @ 12.34 hrs HW=903.65' TW=903.10' (Dynamic Tailwater)  
 ↳1=Broad-Crested Rectangular Weir (Weir Controls 2.91 cfs @ 0.95 fps)

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 27

**Summary for Pond P1: WET POND**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth = 1.04" for 1-YR event  
 Inflow = 14.52 cfs @ 12.19 hrs, Volume= 0.998 af  
 Outflow = 0.31 cfs @ 18.22 hrs, Volume= 0.576 af, Atten= 98%, Lag= 361.6 min  
 Primary = 0.31 cfs @ 18.22 hrs, Volume= 0.576 af  
 Routed to Reach R2 : OVERFLOW SWALE  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Reach R2 : OVERFLOW SWALE

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Starting Elev= 894.00' Surf.Area= 12,390 sf Storage= 18,141 cf  
 Peak Elev= 895.85' @ 18.22 hrs Surf.Area= 21,951 sf Storage= 49,442 cf (31,302 cf above start)  
 Flood Elev= 900.00' Surf.Area= 35,579 sf Storage= 168,762 cf (150,621 cf above start)

Plug-Flow detention time= 1,234.7 min calculated for 0.160 af (16% of inflow)  
 Center-of-Mass det. time= 576.2 min ( 1,419.1 - 843.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	891.00'	168,762 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet) Cum.Store (cubic-feet) Wet.Area (sq-ft)
891.00	2,741	349.0	0 0 2,741
892.00	3,525	397.0	3,125 3,125 5,615
894.00	12,390	626.0	15,016 18,141 24,285
896.00	22,863	877.0	34,722 52,863 54,344
898.00	28,845	1,061.0	51,592 104,455 82,786
900.00	35,579	1,100.0	64,306 168,762 89,833

Device	Routing	Invert	Outlet Devices
#1	Secondary	898.75'	<b>10.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#2	Device 5	894.00'	<b>3.0" Vert. Low Flow Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 5	895.90'	<b>12.0" Horiz. Stand Pipe</b> C= 0.600 Limited to weir flow at low heads
#4	Device 5	898.50'	<b>1.0" x 4.0" Horiz. Orifice/Grate X 13.00 columns</b> X 5 rows C= 0.600 in 30.0" x 30.0" Grate (29% open area)
#5	Primary	893.90'	<b>18.0" Round Culvert</b> L= 70.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 893.90' / 892.00' S= 0.0271 '"/ Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 1.77 sf

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 28

**Primary OutFlow** Max=0.31 cfs @ 18.22 hrs HW=895.85' TW=893.54' (Dynamic Tailwater)  
 ↳ **5=Culvert** (Passes 0.31 cfs of 9.31 cfs potential flow)  
 ↳ **2=Low Flow Orifice** (Orifice Controls 0.31 cfs @ 6.32 fps)  
 ↳ **3=Stand Pipe** ( Controls 0.00 cfs)  
 ↳ **4=Orifice/Grate** ( Controls 0.00 cfs)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=894.00' TW=893.50' (Dynamic Tailwater)  
 ↳ **1=Broad-Crested Rectangular Weir** ( Controls 0.00 cfs)

**Summary for Link DPA:**

Inflow Area = 2.376 ac, 0.00% Impervious, Inflow Depth = 0.63" for 1-YR event  
 Inflow = 1.65 cfs @ 12.20 hrs, Volume= 0.125 af  
 Primary = 1.65 cfs @ 12.20 hrs, Volume= 0.125 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPB:**

Inflow Area = 14.805 ac, 22.90% Impervious, Inflow Depth > 0.66" for 1-YR event  
 Inflow = 2.61 cfs @ 12.41 hrs, Volume= 0.818 af  
 Primary = 2.61 cfs @ 12.41 hrs, Volume= 0.818 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPC:**

Inflow Area = 13.024 ac, 30.10% Impervious, Inflow Depth > 0.60" for 1-YR event  
 Inflow = 1.24 cfs @ 12.22 hrs, Volume= 0.656 af  
 Primary = 1.24 cfs @ 12.22 hrs, Volume= 0.656 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPD:**

Inflow Area = 1.832 ac, 17.47% Impervious, Inflow Depth > 0.67" for 1-YR event  
 Inflow = 0.37 cfs @ 12.18 hrs, Volume= 0.102 af  
 Primary = 0.37 cfs @ 12.18 hrs, Volume= 0.102 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs



**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 1-YR Rainfall=2.25"

Printed 2/23/2024

Page 29

**Summary for Link DPE:**

Inflow Area = 6.514 ac, 5.02% Impervious, Inflow Depth = 0.44" for 1-YR event  
 Inflow = 2.44 cfs @ 12.26 hrs, Volume= 0.238 af  
 Primary = 2.44 cfs @ 12.26 hrs, Volume= 0.238 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/23/2024

Page 30

Time span=0.00-36.00 hrs, dt=0.02 hrs, 1801 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

**SubcatchmentS100:** Runoff Area=2.376 ac 0.00% Impervious Runoff Depth=1.85"  
Flow Length=775' Tc=11.3 min CN=78 Runoff=5.16 cfs 0.366 af

**SubcatchmentS200:** Runoff Area=4.851 ac 34.30% Impervious Runoff Depth=2.50"  
Flow Length=1,171' Tc=13.3 min CN=86 Runoff=13.21 cfs 1.011 af

**SubcatchmentS201:** Runoff Area=4.342 ac 35.08% Impervious Runoff Depth=2.50"  
Flow Length=636' Tc=9.7 min CN=86 Runoff=13.38 cfs 0.905 af

**SubcatchmentS202:** Runoff Area=0.583 ac 34.82% Impervious Runoff Depth=2.41"  
Flow Length=319' Tc=2.7 min CN=85 Runoff=2.24 cfs 0.117 af

**SubcatchmentS203:** Runoff Area=5.029 ac 0.00% Impervious Runoff Depth=1.92"  
Flow Length=1,218' Tc=16.3 min CN=79 Runoff=9.70 cfs 0.806 af

**SubcatchmentS204:** Runoff Area=0.687 ac 0.00% Impervious Runoff Depth=1.85"  
Flow Length=200' Tc=7.4 min CN=78 Runoff=1.74 cfs 0.106 af

**SubcatchmentS205:** Runoff Area=0.484 ac 0.00% Impervious Runoff Depth=1.85"  
Flow Length=450' Tc=9.0 min CN=78 Runoff=1.15 cfs 0.075 af

**SubcatchmentS206:** Runoff Area=0.883 ac 36.24% Impervious Runoff Depth=2.41"  
Tc=6.0 min CN=85 Runoff=3.05 cfs 0.178 af

**SubcatchmentS207:** Runoff Area=0.847 ac 0.00% Impervious Runoff Depth=1.92"  
Flow Length=180' Tc=8.1 min CN=79 Runoff=2.17 cfs 0.136 af

**SubcatchmentS208:** Runoff Area=11.490 ac 34.12% Impervious Runoff Depth=2.50"  
Flow Length=670' Tc=10.3 min CN=86 Runoff=34.65 cfs 2.395 af

**SubcatchmentS209:** Runoff Area=0.465 ac 0.00% Impervious Runoff Depth=1.85"  
Tc=6.0 min CN=78 Runoff=1.25 cfs 0.072 af

**SubcatchmentS300:** Runoff Area=6.514 ac 5.02% Impervious Runoff Depth=1.49"  
Flow Length=1,800' Tc=15.0 min CN=73 Runoff=9.96 cfs 0.810 af

**Reach R1: E-W SWALE** Avg. Flow Depth=0.49' Max Vel=10.85 fps Inflow=13.38 cfs 0.905 af  
n=0.022 L=485.0' S=0.1299 '/' Capacity=65.06 cfs Outflow=13.31 cfs 0.905 af

**Reach R2: OVERFLOW SWALE** Avg. Flow Depth=0.19' Max Vel=8.53 fps Inflow=4.16 cfs 1.909 af  
n=0.022 L=120.0' S=0.1958 '/' Capacity=507.22 cfs Outflow=4.16 cfs 1.908 af

**Reach R3: ROADSIDE SWALE** Avg. Flow Depth=0.29' Max Vel=5.24 fps Inflow=3.05 cfs 0.178 af  
n=0.030 L=825.0' S=0.1018 '/' Capacity=42.24 cfs Outflow=2.83 cfs 0.178 af

**Reach R4:** Avg. Flow Depth=0.04' Max Vel=2.19 fps Inflow=4.79 cfs 2.148 af  
n=0.035 L=360.0' S=0.1778 '/' Capacity=1,059.41 cfs Outflow=4.78 cfs 2.146 af

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 31

**Reach R5:** Avg. Flow Depth=0.02' Max Vel=2.15 fps Inflow=2.16 cfs 0.302 af  
n=0.020 L=220.0' S=0.1591 '/' Capacity=1,753.82 cfs Outflow=2.10 cfs 0.302 af

**Reach R6:** Avg. Flow Depth=0.11' Max Vel=4.81 fps Inflow=31.64 cfs 2.531 af  
n=0.022 L=1,606.0' S=0.0990 '/' Capacity=1,257.76 cfs Outflow=28.13 cfs 2.525 af

**Reach R7:** Avg. Flow Depth=0.73' Max Vel=11.32 fps Inflow=34.65 cfs 2.395 af  
n=0.022 L=330.0' S=0.0788 '/' Capacity=321.73 cfs Outflow=34.57 cfs 2.395 af

**Pond B1: BIORETENTIONAREA 1** Peak Elev=903.86' Storage=5,590 cf Inflow=11.73 cfs 0.841 af  
Primary=0.08 cfs 0.149 af Secondary=10.70 cfs 0.687 af Outflow=10.79 cfs 0.837 af

**Pond B2: BIORETENTIONAREA 2** Peak Elev=903.86' Storage=5,232 cf Inflow=12.13 cfs 0.775 af  
Primary=0.08 cfs 0.139 af Secondary=11.07 cfs 0.632 af Outflow=11.15 cfs 0.771 af

**Pond B3: BIORETENTIONAREA 3** Peak Elev=898.80' Storage=895 cf Inflow=2.24 cfs 0.117 af  
Primary=0.02 cfs 0.029 af Secondary=2.01 cfs 0.088 af Outflow=2.03 cfs 0.117 af

**Pond B4: BIORETENTIONAREA 4** Peak Elev=838.76' Storage=2,037 cf Inflow=2.83 cfs 0.178 af  
Primary=0.02 cfs 0.043 af Secondary=2.51 cfs 0.117 af Outflow=2.53 cfs 0.161 af

**Pond D1: RETENTIONPOND** Peak Elev=865.17' Storage=508 cf Inflow=4.37 cfs 2.014 af  
Primary=4.37 cfs 2.013 af Secondary=0.00 cfs 0.000 af Outflow=4.37 cfs 2.013 af

**Pond D2: DETENTIONPOND** Peak Elev=836.18' Storage=1,915 cf Inflow=2.53 cfs 0.161 af  
Primary=0.80 cfs 0.160 af Secondary=0.00 cfs 0.000 af Outflow=0.80 cfs 0.160 af

**Pond D3: RENTENTIONPOND** Peak Elev=838.62' Storage=458 cf Inflow=1.15 cfs 0.075 af  
12.0" Round Culvert n=0.020 L=100.0' S=0.0100 '/' Outflow=1.02 cfs 0.070 af

**Pond F1: FOREBAY 2** Peak Elev=903.97' Storage=9,277 cf Inflow=13.21 cfs 1.011 af  
Outflow=11.73 cfs 0.841 af

**Pond F2: FOREBAY 2** Peak Elev=903.97' Storage=7,277 cf Inflow=13.31 cfs 0.905 af  
Outflow=12.13 cfs 0.775 af

**Pond P1: WET POND** Peak Elev=896.89' Storage=74,389 cf Inflow=34.57 cfs 2.395 af  
Primary=4.16 cfs 1.909 af Secondary=0.00 cfs 0.000 af Outflow=4.16 cfs 1.909 af

**Link DPA:** Inflow=5.16 cfs 0.366 af  
Primary=5.16 cfs 0.366 af

**Link DPB:** Inflow=28.13 cfs 2.525 af  
Primary=28.13 cfs 2.525 af

**Link DPC:** Inflow=4.78 cfs 2.146 af  
Primary=4.78 cfs 2.146 af

**Link DPD:** Inflow=2.10 cfs 0.302 af  
Primary=2.10 cfs 0.302 af

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 32

**Link DPE:** Inflow=9.96 cfs 0.810 af  
Primary=9.96 cfs 0.810 af

**Total Runoff Area = 38.551 ac Runoff Volume = 6.975 af Average Runoff Depth = 2.17"**  
**79.36% Pervious = 30.594 ac 20.64% Impervious = 7.957 ac**

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/23/2024

Page 33

**Summary for Subcatchment S100:**

Runoff = 5.16 cfs @ 12.19 hrs, Volume= 0.366 af, Depth= 1.85"  
 Routed to Link DPA :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
0.763	79	Woods, Fair, HSG D
1.613	78	Meadow, non-grazed, HSG D
2.376	78	Weighted Average
2.376		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.7	50	0.2800	0.18		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
3.1	50	0.2800	0.27		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
3.2	635	0.2272	3.34		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
0.3	40	0.2272	2.38		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
11.3	775				Total

**Summary for Subcatchment S200:**

Runoff = 13.21 cfs @ 12.21 hrs, Volume= 1.011 af, Depth= 2.50"  
 Routed to Pond F1 : FOREBAY 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
0.013	79	Woods, Fair, HSG D
0.992	78	Meadow, non-grazed, HSG D
1.664	98	SOLAR PANELS
2.182	80	>75% Grass cover, Good, HSG D
4.851	86	Weighted Average
3.187		65.70% Pervious Area
1.664		34.30% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	100	0.1500	0.24		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
6.3	1,071	0.1634	2.83		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
13.3	1,171				Total

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/23/2024

Page 34

**Summary for Subcatchment S201:**

Runoff = 13.38 cfs @ 12.17 hrs, Volume= 0.905 af, Depth= 2.50"  
 Routed to Reach R1 : E-W SWALE

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
0.014	79	Woods, Fair, HSG D
1.056	78	Meadow, non-grazed, HSG D
1.523	98	SOLAR PANELS
1.749	80	>75% Grass cover, Good, HSG D
4.342	86	Weighted Average
2.819		64.92% Pervious Area
1.523		35.08% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8	100	0.1600	0.25		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
2.9	536	0.1900	3.05		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
9.7	636				Total

**Summary for Subcatchment S202:**

Runoff = 2.24 cfs @ 12.10 hrs, Volume= 0.117 af, Depth= 2.41"  
 Routed to Pond B3 : BIORETENTION AREA 3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
0.380	78	Meadow, non-grazed, HSG D
0.203	98	Paved parking, HSG D
0.583	85	Weighted Average
0.380		65.18% Pervious Area
0.203		34.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0	100	0.1500	0.84		<b>Sheet Flow, SF - GRAVEL</b> Fallow n= 0.050 P2= 2.68"
0.7	219	0.1100	4.97		<b>Shallow Concentrated Flow, SCF - CHANNEL</b> Grassed Waterway Kv= 15.0 fps
2.7	319				Total

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/23/2024

Page 35

**Summary for Subcatchment S203:**

Runoff = 9.70 cfs @ 12.25 hrs, Volume= 0.806 af, Depth= 1.92"  
 Routed to Reach R6 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
3.148	78	Meadow, non-grazed, HSG D
1.685	79	Woods, Fair, HSG D
0.110	96	Gravel surface, HSG D
0.086	80	>75% Grass cover, Good, HSG D
5.029	79	Weighted Average
5.029		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	100	0.1900	0.17		<b>Sheet Flow, SF - MEADOW</b>
					Woods: Light underbrush n= 0.400 P2= 2.68"
6.8	1,118	0.1512	2.72		<b>Shallow Concentrated Flow, SCF - MEADOW</b>
					Short Grass Pasture Kv= 7.0 fps
16.3	1,218	Total			

**Summary for Subcatchment S204:**

Runoff = 1.74 cfs @ 12.15 hrs, Volume= 0.106 af, Depth= 1.85"  
 Routed to Pond D1 : RETENTION POND

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
0.687	78	Meadow, non-grazed, HSG D
0.687		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8	100	0.1600	0.25		<b>Sheet Flow, SF - MEADOW</b>
					Grass: Dense n= 0.240 P2= 2.68"
0.6	100	0.1500	2.71		<b>Shallow Concentrated Flow, SCF - MEADOW</b>
					Short Grass Pasture Kv= 7.0 fps
7.4	200	Total			

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/23/2024

Page 36

**Summary for Subcatchment S205:**

Runoff = 1.15 cfs @ 12.17 hrs, Volume= 0.075 af, Depth= 1.85"  
 Routed to Pond D3 : RETENTION POND

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
0.484	78	Meadow, non-grazed, HSG D
0.484		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	100	0.1700	0.25		<b>Sheet Flow, SF - WOODS</b>
					Grass: Dense n= 0.240 P2= 2.68"
2.4	350	0.1200	2.42		<b>Shallow Concentrated Flow, SCF - MEADOW</b>
					Short Grass Pasture Kv= 7.0 fps
9.0	450	Total			

**Summary for Subcatchment S206:**

Runoff = 3.05 cfs @ 12.13 hrs, Volume= 0.178 af, Depth= 2.41"  
 Routed to Reach R3 : ROADSIDE SWALE

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
0.320	98	Paved parking, HSG D
0.563	78	Meadow, non-grazed, HSG D
0.883	85	Weighted Average
0.563		63.76% Pervious Area
0.320		36.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, MIN</b>

**Summary for Subcatchment S207:**

Runoff = 2.17 cfs @ 12.16 hrs, Volume= 0.136 af, Depth= 1.92"  
 Routed to Reach R4 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 10-YR Rainfall=3.95"

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 37

Area (ac)	CN	Description
0.683	79	Woods, Fair, HSG D
0.164	78	Meadow, non-grazed, HSG D
0.847	79	Weighted Average
0.847		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	30	0.5000	0.30		<b>Sheet Flow, SF</b> Grass: Dense n= 0.240 P2= 2.68"
6.0	70	0.3000	0.20		<b>Sheet Flow, SF WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
0.5	80	0.3000	2.74		<b>Shallow Concentrated Flow, SCF</b> Woodland Kv= 5.0 fps
8.1	180	Total			

**Summary for Subcatchment S208:**

Runoff = 34.65 cfs @ 12.18 hrs, Volume= 2.395 af, Depth= 2.50"  
Routed to Reach R7 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
0.087	79	Woods, Fair, HSG D
2.085	78	Meadow, non-grazed, HSG D
* 3.920	98	SOLAR PANELS
5.398	80	>75% Grass cover, Good, HSG D
11.490	86	Weighted Average
7.570		65.88% Pervious Area
3.920		34.12% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.4	100	0.1300	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
2.9	570	0.2235	3.31		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
10.3	670	Total			

**Summary for Subcatchment S209:**

Runoff = 1.25 cfs @ 12.13 hrs, Volume= 0.072 af, Depth= 1.85"  
Routed to Reach R5 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 10-YR Rainfall=3.95"

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 38

Area (ac)	CN	Description
0.012	79	Woods, Fair, HSG D
0.453	78	Meadow, non-grazed, HSG D
0.465	78	Weighted Average
0.465		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, MIN</b>

**Summary for Subcatchment S300:**

Runoff = 9.96 cfs @ 12.24 hrs, Volume= 0.810 af, Depth= 1.49"  
Routed to Link DPE :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 10-YR Rainfall=3.95"

Area (ac)	CN	Description
0.327	98	Paved parking, HSG C
4.927	71	Meadow, non-grazed, HSG C
1.260	73	Woods, Fair, HSG C
6.514	73	Weighted Average
6.187		94.98% Pervious Area
0.327		5.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.2	100	0.1400	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
7.8	1,700	0.0588	3.64		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Grassed Waterway Kv= 15.0 fps
15.0	1,800	Total			

**Summary for Reach R1: E-W SWALE**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 2.50" for 10-YR event  
Inflow = 13.38 cfs @ 12.17 hrs, Volume= 0.905 af  
Outflow = 13.31 cfs @ 12.18 hrs, Volume= 0.905 af, Atten= 1%, Lag= 0.6 min  
Routed to Pond F2 : FOREBAY 2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 10.85 fps, Min. Travel Time= 0.7 min  
Avg. Velocity= 3.59 fps, Avg. Travel Time= 2.3 min

Peak Storage= 595 cf @ 12.18 hrs  
Average Depth at Peak Storage= 0.49' , Surface Width= 3.97'  
Bank-Full Depth= 1.00' Flow Area= 4.0 sf, Capacity= 65.06 cfs

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership


HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/23/2024

Page 39

1.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 3.0 '/ Top Width= 7.00'  
Length= 485.0' Slope= 0.1299 '/  
Inlet Invert= 968.00', Outlet Invert= 905.00'

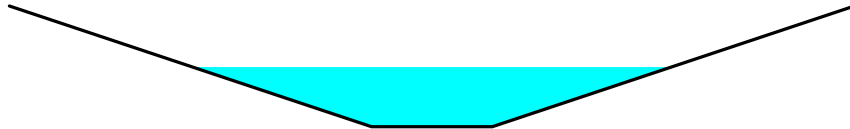

**Summary for Reach R2: OVERFLOW SWALE**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth > 1.99" for 10-YR event  
Inflow = 4.16 cfs @ 12.96 hrs, Volume= 1.909 af  
Outflow = 4.16 cfs @ 12.96 hrs, Volume= 1.908 af, Atten= 0%, Lag= 0.2 min  
Routed to Pond D1 : RETENTION POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 8.53 fps, Min. Travel Time= 0.2 min  
Avg. Velocity = 4.24 fps, Avg. Travel Time= 0.5 min

Peak Storage= 58 cf @ 12.96 hrs  
Average Depth at Peak Storage= 0.19' , Surface Width= 3.14'  
Bank-Full Depth= 2.00' Flow Area= 16.0 sf, Capacity= 507.22 cfs

2.00' x 2.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 3.0 '/ Top Width= 14.00'  
Length= 120.0' Slope= 0.1958 '/  
Inlet Invert= 893.50', Outlet Invert= 870.00'



**Summary for Reach R3: ROADSIDE SWALE**

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth = 2.41" for 10-YR event  
Inflow = 3.05 cfs @ 12.13 hrs, Volume= 0.178 af  
Outflow = 2.83 cfs @ 12.16 hrs, Volume= 0.178 af, Atten= 7%, Lag= 1.5 min  
Routed to Pond B4 : BIORETENTION AREA 4

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 5.24 fps, Min. Travel Time= 2.6 min  
Avg. Velocity = 1.56 fps, Avg. Travel Time= 8.8 min

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/23/2024

Page 40

Peak Storage= 446 cf @ 12.16 hrs  
Average Depth at Peak Storage= 0.29' , Surface Width= 2.74'  
Bank-Full Depth= 1.00' Flow Area= 4.0 sf, Capacity= 42.24 cfs

1.00' x 1.00' deep channel, n= 0.030 Earth, grassed & winding  
Side Slope Z-value= 3.0 '/ Top Width= 7.00'  
Length= 825.0' Slope= 0.1018 '/  
Inlet Invert= 924.00', Outlet Invert= 840.00'



**Summary for Reach R4:**

Inflow Area = 13.024 ac, 30.10% Impervious, Inflow Depth > 1.98" for 10-YR event  
Inflow = 4.79 cfs @ 12.56 hrs, Volume= 2.148 af  
Outflow = 4.78 cfs @ 12.58 hrs, Volume= 2.146 af, Atten= 0%, Lag= 1.2 min  
Routed to Link DPC :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 2.19 fps, Min. Travel Time= 2.7 min  
Avg. Velocity = 1.08 fps, Avg. Travel Time= 5.6 min

Peak Storage= 788 cf @ 12.58 hrs  
Average Depth at Peak Storage= 0.04' , Surface Width= 51.72'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,059.41 cfs

50.00' x 1.00' deep channel, n= 0.035 Earth, dense weeds  
Side Slope Z-value= 20.0 '/ Top Width= 90.00'  
Length= 360.0' Slope= 0.1778 '/  
Inlet Invert= 831.00', Outlet Invert= 767.00'



**Summary for Reach R5:**

Inflow Area = 1.832 ac, 17.47% Impervious, Inflow Depth > 1.98" for 10-YR event  
Inflow = 2.16 cfs @ 12.15 hrs, Volume= 0.302 af  
Outflow = 2.10 cfs @ 12.17 hrs, Volume= 0.302 af, Atten= 3%, Lag= 1.3 min  
Routed to Link DPD :

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/23/2024  
Page 41

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 2.15 fps, Min. Travel Time= 1.7 min  
Avg. Velocity = 1.39 fps, Avg. Travel Time= 2.6 min

Peak Storage= 215 cf @ 12.17 hrs  
Average Depth at Peak Storage= 0.02' , Surface Width= 50.78'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,753.82 cfs

50.00' x 1.00' deep channel, n= 0.020 Corrugated PE, corrugated interior  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 220.0' Slope= 0.1591 ' / '  
Inlet Invert= 822.00', Outlet Invert= 787.00'



**Summary for Reach R6:**

Inflow Area = 14.805 ac, 22.90% Impervious, Inflow Depth > 2.05" for 10-YR event  
Inflow = 31.64 cfs @ 12.27 hrs, Volume= 2.531 af  
Outflow = 28.13 cfs @ 12.34 hrs, Volume= 2.525 af, Atten= 11%, Lag= 4.2 min  
Routed to Link DPB :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 4.81 fps, Min. Travel Time= 5.6 min  
Avg. Velocity = 1.23 fps, Avg. Travel Time= 21.8 min

Peak Storage= 9,400 cf @ 12.34 hrs  
Average Depth at Peak Storage= 0.11' , Surface Width= 54.48'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,257.76 cfs

50.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 1,606.0' Slope= 0.0990 ' / '  
Inlet Invert= 895.00', Outlet Invert= 736.00'



**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 10-YR Rainfall=3.95"

Printed 2/23/2024  
Page 42

**Summary for Reach R7:**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth = 2.50" for 10-YR event  
Inflow = 34.65 cfs @ 12.18 hrs, Volume= 2.395 af  
Outflow = 34.57 cfs @ 12.18 hrs, Volume= 2.395 af, Atten= 0%, Lag= 0.4 min  
Routed to Pond P1 : WET POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 11.32 fps, Min. Travel Time= 0.5 min  
Avg. Velocity = 3.65 fps, Avg. Travel Time= 1.5 min

Peak Storage= 1,007 cf @ 12.18 hrs  
Average Depth at Peak Storage= 0.73' , Surface Width= 6.37'  
Bank-Full Depth= 2.00' Flow Area= 16.0 sf, Capacity= 321.73 cfs

2.00' x 2.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 3.0 ' / ' Top Width= 14.00'  
Length= 330.0' Slope= 0.0788 ' / '  
Inlet Invert= 924.00', Outlet Invert= 898.00'



**Summary for Pond B1: BIORETENTION AREA 1**

Inflow Area = 4.851 ac, 34.30% Impervious, Inflow Depth = 2.08" for 10-YR event  
Inflow = 11.73 cfs @ 12.24 hrs, Volume= 0.841 af  
Outflow = 10.79 cfs @ 12.30 hrs, Volume= 0.837 af, Atten= 8%, Lag= 4.0 min  
Primary = 0.08 cfs @ 12.30 hrs, Volume= 0.149 af  
Routed to Reach R6 :  
Secondary = 10.70 cfs @ 12.30 hrs, Volume= 0.687 af  
Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Peak Elev= 903.86' @ 12.30 hrs Surf.Area= 7,064 sf Storage= 5,590 cf

Plug-Flow detention time= 98.5 min calculated for 0.836 af (99% of inflow)  
Center-of-Mass det. time= 95.7 min ( 952.3 - 856.6 )

Volume #1	Invert	Avail.Storage	Storage Description		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
903.00	5,991	427.0	0	0	5,991
905.00	8,631	465.0	14,542	14,542	8,832

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 43

Device	Routing	Invert	Outlet Devices
#1	Primary	900.50'	<b>8.0" Round Culvert</b> L= 50.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 900.50' / 899.00' S= 0.0300 ' S= 0.0300 ' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf
#2	Secondary	903.50'	<b>20.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Device 1	903.00'	<b>0.500 in/hr Exfiltration over Surface area</b>

**Primary OutFlow** Max=0.08 cfs @ 12.30 hrs HW=903.86' TW=895.11' (Dynamic Tailwater)

↳1=Culvert (Passes 0.08 cfs of 2.04 cfs potential flow)

↳3=Exfiltration (Exfiltration Controls 0.08 cfs)

**Secondary OutFlow** Max=10.69 cfs @ 12.30 hrs HW=903.86' TW=895.11' (Dynamic Tailwater)

↳2=Broad-Crested Rectangular Weir (Weir Controls 10.69 cfs @ 1.50 fps)

**Summary for Pond B2: BIORETENTION AREA 2**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 2.14" for 10-YR event  
 Inflow = 12.13 cfs @ 12.20 hrs, Volume= 0.775 af  
 Outflow = 11.15 cfs @ 12.24 hrs, Volume= 0.771 af, Atten= 8%, Lag= 2.6 min  
 Primary = 0.08 cfs @ 12.24 hrs, Volume= 0.139 af  
 Routed to Reach R6 :  
 Secondary = 11.07 cfs @ 12.24 hrs, Volume= 0.632 af  
 Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 903.86' @ 12.24 hrs Surf.Area= 6,564 sf Storage= 5,232 cf

Plug-Flow detention time= 99.1 min calculated for 0.771 af (99% of inflow)  
 Center-of-Mass det. time= 96.5 min ( 946.5 - 850.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	903.00'	13,497 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)
903.00	5,550	421.0	0
905.00	8,023	459.0	13,497
			Cum.Store (cubic-feet)
			0
			13,497
			Wet.Area (sq-ft)
			5,550
			8,353

Device	Routing	Invert	Outlet Devices
#1	Primary	900.50'	<b>8.0" Round Culvert</b> L= 50.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 900.50' / 899.00' S= 0.0300 ' S= 0.0300 ' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf
#2	Secondary	903.50'	<b>20.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 44

Device	Routing	Invert	Outlet Devices
#3	Device 1	903.00'	<b>0.500 in/hr Exfiltration over Surface area</b> Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

**Primary OutFlow** Max=0.08 cfs @ 12.24 hrs HW=903.86' TW=895.09' (Dynamic Tailwater)

↳1=Culvert (Passes 0.08 cfs of 2.04 cfs potential flow)

↳3=Exfiltration (Exfiltration Controls 0.08 cfs)

**Secondary OutFlow** Max=11.03 cfs @ 12.24 hrs HW=903.86' TW=895.09' (Dynamic Tailwater)

↳2=Broad-Crested Rectangular Weir (Weir Controls 11.03 cfs @ 1.52 fps)

**Summary for Pond B3: BIORETENTION AREA 3**

Inflow Area = 0.583 ac, 34.82% Impervious, Inflow Depth = 2.41" for 10-YR event  
 Inflow = 2.24 cfs @ 12.10 hrs, Volume= 0.117 af  
 Outflow = 2.03 cfs @ 12.12 hrs, Volume= 0.117 af, Atten= 10%, Lag= 1.4 min  
 Primary = 0.02 cfs @ 12.12 hrs, Volume= 0.029 af  
 Routed to Reach R6 :  
 Secondary = 2.01 cfs @ 12.12 hrs, Volume= 0.088 af  
 Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 898.80' @ 12.12 hrs Surf.Area= 1,439 sf Storage= 895 cf

Plug-Flow detention time= 114.2 min calculated for 0.117 af (100% of inflow)  
 Center-of-Mass det. time= 113.4 min ( 927.1 - 813.7 )

Volume	Invert	Avail.Storage	Storage Description
#1	898.00'	3,200 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
898.00	800	0	0
900.00	2,400	3,200	3,200

Device	Routing	Invert	Outlet Devices
#1	Device 3	898.00'	<b>0.500 in/hr Exfiltration over Surface area</b>
#2	Secondary	898.50'	<b>5.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Primary	895.50'	<b>8.0" Round Culvert</b> L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 895.50' / 895.00' S= 0.0083 ' S= 0.0083 ' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf



**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 45

**Primary OutFlow** Max=0.02 cfs @ 12.12 hrs HW=898.80' TW=895.04' (Dynamic Tailwater)

↳ **3=Culvert** (Passes 0.02 cfs of 1.60 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.02 cfs)

**Secondary OutFlow** Max=2.01 cfs @ 12.12 hrs HW=898.80' TW=895.04' (Dynamic Tailwater)

↳ **2=Broad-Crested Rectangular Weir** (Weir Controls 2.01 cfs @ 1.34 fps)

**Summary for Pond B4: BIORETENTION AREA 4**

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth = 2.41" for 10-YR event  
Inflow = 2.83 cfs @ 12.16 hrs, Volume= 0.178 af  
Outflow = 2.53 cfs @ 12.19 hrs, Volume= 0.161 af, Atten= 11%, Lag= 2.3 min  
Primary = 0.02 cfs @ 12.19 hrs, Volume= 0.043 af

Routed to Pond D2 : DETENTION POND

Secondary = 2.51 cfs @ 12.19 hrs, Volume= 0.117 af

Routed to Pond D2 : DETENTION POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Peak Elev= 838.76' @ 12.19 hrs Surf.Area= 2,079 sf Storage= 2,037 cf

Plug-Flow detention time= 194.4 min calculated for 0.161 af (90% of inflow)  
Center-of-Mass det. time= 145.5 min ( 967.7 - 822.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	837.00'	5,303 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
837.00	15	0	0
838.00	1,417	716	716
840.00	3,170	4,587	5,303

Device	Routing	Invert	Outlet Devices
#1	Device 3	837.00'	<b>0.500 in/hr Exfiltration over Surface area</b>
#2	Secondary	838.50'	<b>8.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Primary	835.50'	<b>8.0" Round Culvert</b> L= 25.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 835.50' / 834.00' S= 0.0600 ' / Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf

**Primary OutFlow** Max=0.02 cfs @ 12.19 hrs HW=838.75' TW=835.39' (Dynamic Tailwater)

↳ **3=Culvert** (Passes 0.02 cfs of 2.27 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.02 cfs)

**Secondary OutFlow** Max=2.49 cfs @ 12.19 hrs HW=838.75' TW=835.39' (Dynamic Tailwater)

↳ **2=Broad-Crested Rectangular Weir** (Weir Controls 2.49 cfs @ 1.22 fps)

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 46

**Summary for Pond D1: RETENTION POND**

Inflow Area = 12.177 ac, 32.19% Impervious, Inflow Depth > 1.98" for 10-YR event  
Inflow = 4.37 cfs @ 12.81 hrs, Volume= 2.014 af  
Outflow = 4.37 cfs @ 12.85 hrs, Volume= 2.013 af, Atten= 0%, Lag= 2.3 min  
Primary = 4.37 cfs @ 12.85 hrs, Volume= 2.013 af

Routed to Reach R4 :

Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routed to Reach R4 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Peak Elev= 865.17' @ 12.85 hrs Surf.Area= 678 sf Storage= 508 cf

Plug-Flow detention time= 2.4 min calculated for 2.011 af (100% of inflow)  
Center-of-Mass det. time= 1.6 min ( 1,054.1 - 1,052.5 )

Volume	Invert	Avail.Storage	Storage Description
#1	864.00'	12,104 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
864.00	230	80.0	0	0	230
866.00	1,140	145.0	1,255	1,255	1,415
868.00	2,560	210.0	3,606	4,860	3,286
870.00	4,800	270.0	7,244	12,104	5,627

Device	Routing	Invert	Outlet Devices
#1	Primary	864.00'	<b>15.0" Round Culvert</b> L= 50.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 864.00' / 863.00' S= 0.0200 ' / Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 1.23 sf
#2	Secondary	868.75'	<b>10.0' long x 6.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.37 2.51 2.70 2.68 2.68 2.67 2.65 2.65 2.65 2.65 2.66 2.66 2.67 2.69 2.72 2.76 2.83

**Primary OutFlow** Max=4.37 cfs @ 12.85 hrs HW=865.17' TW=831.04' (Dynamic Tailwater)

↳ **1=Culvert** (Barrel Controls 4.37 cfs @ 4.74 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=864.00' TW=831.00' (Dynamic Tailwater)

↳ **2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

**Summary for Pond D2: DETENTION POND**

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 47

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth > 2.18" for 10-YR event  
 Inflow = 2.53 cfs @ 12.19 hrs, Volume= 0.161 af  
 Outflow = 0.80 cfs @ 12.48 hrs, Volume= 0.160 af, Atten= 68%, Lag= 17.2 min  
 Primary = 0.80 cfs @ 12.48 hrs, Volume= 0.160 af  
 Routed to Reach R5 :  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Reach R5 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 836.18' @ 12.48 hrs Surf.Area= 1,864 sf Storage= 1,915 cf

Plug-Flow detention time= 87.9 min calculated for 0.160 af (100% of inflow)  
 Center-of-Mass det. time= 84.6 min ( 1,052.3 - 967.7 )

Volume	Invert	Avail.Storage	Storage Description			
#1	834.00'	6,977 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
834.00	160	85.0	0	0	160	
836.00	1,710	225.0	1,595	1,595	3,628	
838.00	3,810	285.0	5,382	6,977	6,115	

Device	Routing	Invert	Outlet Devices											
#1	Secondary	836.75'	<b>10.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32											
#2	Device 4	834.00'	<b>2.0" Vert. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads											
#3	Device 4	836.00'	<b>10.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads											
#4	Primary	833.90'	<b>10.0" Round Culvert</b> L= 30.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 833.90' / 833.00' S= 0.0300'/' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.55 sf											

**Primary OutFlow** Max=0.80 cfs @ 12.48 hrs HW=836.18' TW=822.02' (Dynamic Tailwater)  
 4=Culvert (Passes 0.80 cfs of 2.83 cfs potential flow)  
 2=Orifice/Grate (Orifice Controls 0.15 cfs @ 6.97 fps)  
 3=Orifice/Grate (Weir Controls 0.65 cfs @ 1.38 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=834.00' TW=822.00' (Dynamic Tailwater)  
 1=Broad-Crested Rectangular Weir( Controls 0.00 cfs)

**Summary for Pond D3: RENTENTION POND**

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 48

Inflow Area = 0.484 ac, 0.00% Impervious, Inflow Depth = 1.85" for 10-YR event  
 Inflow = 1.15 cfs @ 12.17 hrs, Volume= 0.075 af  
 Outflow = 1.02 cfs @ 12.21 hrs, Volume= 0.070 af, Atten= 12%, Lag= 2.6 min  
 Primary = 1.02 cfs @ 12.21 hrs, Volume= 0.070 af  
 Routed to Reach R5 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 838.62' @ 12.21 hrs Surf.Area= 566 sf Storage= 458 cf

Plug-Flow detention time= 53.0 min calculated for 0.070 af (94% of inflow)  
 Center-of-Mass det. time= 21.7 min ( 861.6 - 839.9 )

Volume	Invert	Avail.Storage	Storage Description	
#1	837.00'	1,625 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	
837.00	60	0	0	
838.00	310	185	185	
840.00	1,130	1,440	1,625	

Device	Routing	Invert	Outlet Devices
#1	Primary	838.00'	<b>12.0" Round Culvert</b> L= 100.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 838.00' / 837.00' S= 0.0100'/' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.01 cfs @ 12.21 hrs HW=838.62' TW=822.02' (Dynamic Tailwater)  
 1=Culvert (Barrel Controls 1.01 cfs @ 2.81 fps)

**Summary for Pond F1: FOREBAY 2**

Inflow Area = 4.851 ac, 34.30% Impervious, Inflow Depth = 2.50" for 10-YR event  
 Inflow = 13.21 cfs @ 12.21 hrs, Volume= 1.011 af  
 Outflow = 11.73 cfs @ 12.24 hrs, Volume= 0.841 af, Atten= 11%, Lag= 1.4 min  
 Primary = 11.73 cfs @ 12.24 hrs, Volume= 0.841 af  
 Routed to Pond B1 : BIORETENTION AREA 1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 903.97' @ 12.29 hrs Surf.Area= 4,282 sf Storage= 9,277 cf

Plug-Flow detention time= 107.5 min calculated for 0.841 af (83% of inflow)  
 Center-of-Mass det. time= 36.3 min ( 856.6 - 820.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	899.00'	14,382 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 49

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
899.00	218	86.0	0	0	218
901.00	1,277	230.0	1,348	1,348	3,853
903.00	3,198	372.0	4,331	5,679	10,682
905.00	5,618	426.0	8,703	14,382	14,203

Device	Routing	Invert	Outlet Devices
#1	Primary	903.50'	<b>20.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32

Primary OutFlow Max=10.70 cfs @ 12.24 hrs HW=903.94' TW=903.81' (Dynamic Tailwater)

1=Broad-Crested Rectangular Weir (Weir Controls 10.70 cfs @ 1.22 fps)

**Summary for Pond F2: FOREBAY 2**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 2.50" for 10-YR event  
 Inflow = 13.31 cfs @ 12.18 hrs, Volume= 0.905 af  
 Outflow = 12.13 cfs @ 12.20 hrs, Volume= 0.775 af, Atten= 9%, Lag= 1.3 min  
 Primary = 12.13 cfs @ 12.20 hrs, Volume= 0.775 af  
 Routed to Pond B2 : BIORETENTION AREA 2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 903.97' @ 12.23 hrs Surf.Area= 3,657 sf Storage= 7,277 cf

Plug-Flow detention time= 96.0 min calculated for 0.774 af (86% of inflow)  
 Center-of-Mass det. time= 31.6 min ( 850.0 - 818.4 )

Volume	Invert	Avail.Storage	Storage Description
#1	899.00'	11,697 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
899.00	98	53.0	0	0	98
901.00	930	189.0	887	887	2,728
903.00	2,575	324.0	3,368	4,255	8,263
905.00	5,000	439.0	7,442	11,697	15,287

Device	Routing	Invert	Outlet Devices
#1	Primary	903.50'	<b>20.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32

Primary OutFlow Max=11.25 cfs @ 12.20 hrs HW=903.96' TW=903.84' (Dynamic Tailwater)

1=Broad-Crested Rectangular Weir (Weir Controls 11.25 cfs @ 1.21 fps)

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 50

**Summary for Pond P1: WET POND**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth = 2.50" for 10-YR event  
 Inflow = 34.57 cfs @ 12.18 hrs, Volume= 2.395 af  
 Outflow = 4.16 cfs @ 12.96 hrs, Volume= 1.909 af, Atten= 88%, Lag= 46.4 min  
 Primary = 4.16 cfs @ 12.96 hrs, Volume= 1.909 af  
 Routed to Reach R2 : OVERFLOW SWALE  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Reach R2 : OVERFLOW SWALE

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Starting Elev= 894.00' Surf.Area= 12,390 sf Storage= 18,141 cf  
 Peak Elev= 896.89' @ 12.96 hrs Surf.Area= 25,444 sf Storage= 74,389 cf (56,248 cf above start)  
 Flood Elev= 900.00' Surf.Area= 35,579 sf Storage= 168,762 cf (150,621 cf above start)

Plug-Flow detention time= 430.6 min calculated for 1.491 af (62% of inflow)  
 Center-of-Mass det. time= 245.6 min ( 1,064.1 - 818.5 )

Volume	Invert	Avail.Storage	Storage Description
#1	891.00'	168,762 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
891.00	2,741	349.0	0	0	2,741
892.00	3,525	397.0	3,125	3,125	5,615
894.00	12,390	626.0	15,016	18,141	24,285
896.00	22,863	877.0	34,722	52,863	54,344
898.00	28,845	1,061.0	51,592	104,455	82,786
900.00	35,579	1,100.0	64,306	168,762	89,833

Device	Routing	Invert	Outlet Devices
#1	Secondary	898.75'	<b>10.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#2	Device 5	894.00'	<b>3.0" Vert. Low Flow Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 5	895.90'	<b>12.0" Horiz. Stand Pipe</b> C= 0.600 Limited to weir flow at low heads
#4	Device 5	898.50'	<b>1.0" x 4.0" Horiz. Orifice/Grate X 13.00 columns</b> X 5 rows C= 0.600 in 30.0" x 30.0" Grate (29% open area)
#5	Primary	893.90'	<b>18.0" Round Culvert</b> L= 70.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 893.90' / 892.00' S= 0.0271 ' S= 0.0271 ' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 1.77 sf

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 51

**Primary OutFlow** Max=4.16 cfs @ 12.96 hrs HW=896.89' TW=893.69' (Dynamic Tailwater)

↳ **5=Culvert** (Passes 4.16 cfs of 11.92 cfs potential flow)

↳ **2=Low Flow Orifice** (Orifice Controls 0.39 cfs @ 8.01 fps)

↳ **3=Stand Pipe** (Orifice Controls 3.77 cfs @ 4.79 fps)

↳ **4=Orifice/Grate** ( Controls 0.00 cfs)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=894.00' TW=893.50' (Dynamic Tailwater)

↳ **1=Broad-Crested Rectangular Weir** ( Controls 0.00 cfs)

**Summary for Link DPA:**

Inflow Area = 2.376 ac, 0.00% Impervious, Inflow Depth = 1.85" for 10-YR event  
Inflow = 5.16 cfs @ 12.19 hrs, Volume= 0.366 af  
Primary = 5.16 cfs @ 12.19 hrs, Volume= 0.366 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPB:**

Inflow Area = 14.805 ac, 22.90% Impervious, Inflow Depth > 2.05" for 10-YR event  
Inflow = 28.13 cfs @ 12.34 hrs, Volume= 2.525 af  
Primary = 28.13 cfs @ 12.34 hrs, Volume= 2.525 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPC:**

Inflow Area = 13.024 ac, 30.10% Impervious, Inflow Depth > 1.98" for 10-YR event  
Inflow = 4.78 cfs @ 12.58 hrs, Volume= 2.146 af  
Primary = 4.78 cfs @ 12.58 hrs, Volume= 2.146 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPD:**

Inflow Area = 1.832 ac, 17.47% Impervious, Inflow Depth > 1.98" for 10-YR event  
Inflow = 2.10 cfs @ 12.17 hrs, Volume= 0.302 af  
Primary = 2.10 cfs @ 12.17 hrs, Volume= 0.302 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 10-YR Rainfall=3.95"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 52

**Summary for Link DPE:**

Inflow Area = 6.514 ac, 5.02% Impervious, Inflow Depth = 1.49" for 10-YR event  
Inflow = 9.96 cfs @ 12.24 hrs, Volume= 0.810 af  
Primary = 9.96 cfs @ 12.24 hrs, Volume= 0.810 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 53

Time span=0.00-36.00 hrs, dt=0.02 hrs, 1801 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>SubcatchmentS100:</b>	Runoff Area=2.376 ac 0.00% Impervious Runoff Depth=3.01" Flow Length=775' Tc=11.3 min CN=78 Runoff=8.41 cfs 0.596 af
<b>SubcatchmentS200:</b>	Runoff Area=4.851 ac 34.30% Impervious Runoff Depth=3.79" Flow Length=1,171' Tc=13.3 min CN=86 Runoff=19.75 cfs 1.534 af
<b>SubcatchmentS201:</b>	Runoff Area=4.342 ac 35.08% Impervious Runoff Depth=3.79" Flow Length=636' Tc=9.7 min CN=86 Runoff=19.96 cfs 1.373 af
<b>SubcatchmentS202:</b>	Runoff Area=0.583 ac 34.82% Impervious Runoff Depth=3.69" Flow Length=319' Tc=2.7 min CN=85 Runoff=3.36 cfs 0.179 af
<b>SubcatchmentS203:</b>	Runoff Area=5.029 ac 0.00% Impervious Runoff Depth=3.11" Flow Length=1,218' Tc=16.3 min CN=79 Runoff=15.68 cfs 1.301 af
<b>SubcatchmentS204:</b>	Runoff Area=0.687 ac 0.00% Impervious Runoff Depth=3.01" Flow Length=200' Tc=7.4 min CN=78 Runoff=2.82 cfs 0.172 af
<b>SubcatchmentS205:</b>	Runoff Area=0.484 ac 0.00% Impervious Runoff Depth=3.01" Flow Length=450' Tc=9.0 min CN=78 Runoff=1.88 cfs 0.121 af
<b>SubcatchmentS206:</b>	Runoff Area=0.883 ac 36.24% Impervious Runoff Depth=3.69" Tc=6.0 min CN=85 Runoff=4.58 cfs 0.272 af
<b>SubcatchmentS207:</b>	Runoff Area=0.847 ac 0.00% Impervious Runoff Depth=3.11" Flow Length=180' Tc=8.1 min CN=79 Runoff=3.48 cfs 0.219 af
<b>SubcatchmentS208:</b>	Runoff Area=11.490 ac 34.12% Impervious Runoff Depth=3.79" Flow Length=670' Tc=10.3 min CN=86 Runoff=51.70 cfs 3.634 af
<b>SubcatchmentS209:</b>	Runoff Area=0.465 ac 0.00% Impervious Runoff Depth=3.01" Tc=6.0 min CN=78 Runoff=2.02 cfs 0.117 af
<b>SubcatchmentS300:</b>	Runoff Area=6.514 ac 5.02% Impervious Runoff Depth=2.56" Flow Length=1,800' Tc=15.0 min CN=73 Runoff=17.42 cfs 1.389 af
<b>Reach R1: E-W SWALE</b>	Avg. Flow Depth=0.59' Max Vel=12.03 fps Inflow=19.96 cfs 1.373 af n=0.022 L=485.0' S=0.1299 '/' Capacity=65.06 cfs Outflow=19.87 cfs 1.373 af
<b>Reach R2: OVERFLOW SWALE</b>	Avg. Flow Depth=0.23' Max Vel=9.55 fps Inflow=5.98 cfs 3.137 af n=0.022 L=120.0' S=0.1958 '/' Capacity=507.22 cfs Outflow=5.98 cfs 3.137 af
<b>Reach R3: ROADSIDE SWALE</b>	Avg. Flow Depth=0.36' Max Vel=5.86 fps Inflow=4.58 cfs 0.272 af n=0.030 L=825.0' S=0.1018 '/' Capacity=42.24 cfs Outflow=4.30 cfs 0.272 af
<b>Reach R4:</b>	Avg. Flow Depth=0.06' Max Vel=2.77 fps Inflow=8.95 cfs 3.527 af n=0.035 L=360.0' S=0.1778 '/' Capacity=1,059.41 cfs Outflow=8.78 cfs 3.524 af

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 54

<b>Reach R5:</b>	Avg. Flow Depth=0.03' Max Vel=2.94 fps Inflow=4.70 cfs 0.488 af n=0.020 L=220.0' S=0.1591 '/' Capacity=1,753.82 cfs Outflow=4.67 cfs 0.488 af
<b>Reach R6:</b>	Avg. Flow Depth=0.16' Max Vel=5.94 fps Inflow=52.45 cfs 4.078 af n=0.022 L=1,606.0' S=0.0990 '/' Capacity=1,257.76 cfs Outflow=49.42 cfs 4.073 af
<b>Reach R7:</b>	Avg. Flow Depth=0.88' Max Vel=12.59 fps Inflow=51.70 cfs 3.634 af n=0.022 L=330.0' S=0.0788 '/' Capacity=321.73 cfs Outflow=51.60 cfs 3.634 af
<b>Pond B1: BIORETENTIONAREA 1</b>	Peak Elev=903.99' Storage=6,553 cf Inflow=18.72 cfs 1.364 af Primary=0.08 cfs 0.153 af Secondary=18.00 cfs 1.206 af Outflow=18.09 cfs 1.359 af
<b>Pond B2: BIORETENTIONAREA 2</b>	Peak Elev=903.99' Storage=6,064 cf Inflow=18.79 cfs 1.243 af Primary=0.08 cfs 0.143 af Secondary=17.90 cfs 1.096 af Outflow=17.98 cfs 1.239 af
<b>Pond B3: BIORETENTIONAREA 3</b>	Peak Elev=898.89' Storage=1,029 cf Inflow=3.36 cfs 0.179 af Primary=0.02 cfs 0.031 af Secondary=3.09 cfs 0.148 af Outflow=3.11 cfs 0.179 af
<b>Pond B4: BIORETENTIONAREA 4</b>	Peak Elev=838.84' Storage=2,222 cf Inflow=4.30 cfs 0.272 af Primary=0.02 cfs 0.045 af Secondary=4.01 cfs 0.210 af Outflow=4.03 cfs 0.255 af
<b>Pond D1: RETENTION POND</b>	Peak Elev=866.00' Storage=1,256 cf Inflow=6.59 cfs 3.309 af Primary=6.31 cfs 3.308 af Secondary=0.00 cfs 0.000 af Outflow=6.31 cfs 3.308 af
<b>Pond D2: DETENTION POND</b>	Peak Elev=836.57' Storage=2,714 cf Inflow=4.03 cfs 0.255 af Primary=2.15 cfs 0.254 af Secondary=0.00 cfs 0.000 af Outflow=2.15 cfs 0.254 af
<b>Pond D3: RETENTION POND</b>	Peak Elev=838.84' Storage=590 cf Inflow=1.88 cfs 0.121 af 12.0' Round Culvert n=0.020 L=100.0' S=0.0100 '/' Outflow=1.65 cfs 0.117 af
<b>Pond F1: FOREBAY 2</b>	Peak Elev=904.14' Storage=10,057 cf Inflow=19.75 cfs 1.534 af Outflow=18.72 cfs 1.364 af
<b>Pond F2: FOREBAY 2</b>	Peak Elev=904.14' Storage=7,897 cf Inflow=19.87 cfs 1.373 af Outflow=18.79 cfs 1.243 af
<b>Pond P1: WET POND</b>	Peak Elev=898.02' Storage=105,167 cf Inflow=51.60 cfs 3.634 af Primary=5.98 cfs 3.137 af Secondary=0.00 cfs 0.000 af Outflow=5.98 cfs 3.137 af
<b>Link DPA:</b>	Inflow=8.41 cfs 0.596 af Primary=8.41 cfs 0.596 af
<b>Link DPB:</b>	Inflow=49.42 cfs 4.073 af Primary=49.42 cfs 4.073 af
<b>Link DPC:</b>	Inflow=8.78 cfs 3.524 af Primary=8.78 cfs 3.524 af
<b>Link DPD:</b>	Inflow=4.67 cfs 0.488 af Primary=4.67 cfs 0.488 af

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 55

**Link DPE:**Inflow=17.42 cfs 1.389 af  
Primary=17.42 cfs 1.389 af**Total Runoff Area = 38.551 ac Runoff Volume = 10.908 af Average Runoff Depth = 3.40"**  
**79.36% Pervious = 30.594 ac 20.64% Impervious = 7.957 ac****2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 56

**Summary for Subcatchment S100:**Runoff = 8.41 cfs @ 12.19 hrs, Volume= 0.596 af, Depth= 3.01"  
Routed to Link DPA :Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
0.763	79	Woods, Fair, HSG D
1.613	78	Meadow, non-grazed, HSG D
2.376	78	Weighted Average
2.376		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.7	50	0.2800	0.18		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
3.1	50	0.2800	0.27		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
3.2	635	0.2272	3.34		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
0.3	40	0.2272	2.38		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
11.3	775				Total

**Summary for Subcatchment S200:**Runoff = 19.75 cfs @ 12.21 hrs, Volume= 1.534 af, Depth= 3.79"  
Routed to Pond F1 : FOREBAY 2Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
0.013	79	Woods, Fair, HSG D
0.992	78	Meadow, non-grazed, HSG D
1.664	98	SOLAR PANELS
2.182	80	>75% Grass cover, Good, HSG D
4.851	86	Weighted Average
3.187		65.70% Pervious Area
1.664		34.30% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	100	0.1500	0.24		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
6.3	1,071	0.1634	2.83		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
13.3	1,171				Total

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024  
Page 57

**Summary for Subcatchment S201:**

Runoff = 19.96 cfs @ 12.17 hrs, Volume= 1.373 af, Depth= 3.79"  
Routed to Reach R1 : E-W SWALE

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
0.014	79	Woods, Fair, HSG D
1.056	78	Meadow, non-grazed, HSG D
1.523	98	SOLAR PANELS
1.749	80	>75% Grass cover, Good, HSG D
4.342	86	Weighted Average
2.819		64.92% Pervious Area
1.523		35.08% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8	100	0.1600	0.25		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
2.9	536	0.1900	3.05		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
9.7	636				Total

**Summary for Subcatchment S202:**

Runoff = 3.36 cfs @ 12.10 hrs, Volume= 0.179 af, Depth= 3.69"  
Routed to Pond B3 : BIORETENTION AREA 3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
0.380	78	Meadow, non-grazed, HSG D
0.203	98	Paved parking, HSG D
0.583	85	Weighted Average
0.380		65.18% Pervious Area
0.203		34.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0	100	0.1500	0.84		<b>Sheet Flow, SF - GRAVEL</b> Fallow n= 0.050 P2= 2.68"
0.7	219	0.1100	4.97		<b>Shallow Concentrated Flow, SCF - CHANNEL</b> Grassed Waterway Kv= 15.0 fps
2.7	319				Total

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024  
Page 58

**Summary for Subcatchment S203:**

Runoff = 15.68 cfs @ 12.25 hrs, Volume= 1.301 af, Depth= 3.11"  
Routed to Reach R6 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
3.148	78	Meadow, non-grazed, HSG D
1.685	79	Woods, Fair, HSG D
0.110	96	Gravel surface, HSG D
0.086	80	>75% Grass cover, Good, HSG D
5.029	79	Weighted Average
5.029		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	100	0.1900	0.17		<b>Sheet Flow, SF - MEADOW</b> Woods: Light underbrush n= 0.400 P2= 2.68"
6.8	1,118	0.1512	2.72		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
16.3	1,218				Total

**Summary for Subcatchment S204:**

Runoff = 2.82 cfs @ 12.15 hrs, Volume= 0.172 af, Depth= 3.01"  
Routed to Pond D1 : RETENTION POND

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
0.687	78	Meadow, non-grazed, HSG D
0.687		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8	100	0.1600	0.25		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
0.6	100	0.1500	2.71		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
7.4	200				Total

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 59

**Summary for Subcatchment S205:**

Runoff = 1.88 cfs @ 12.16 hrs, Volume= 0.121 af, Depth= 3.01"  
 Routed to Pond D3 : RENTENTION POND

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
0.484	78	Meadow, non-grazed, HSG D
0.484		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	100	0.1700	0.25		<b>Sheet Flow, SF - WOODS</b> Grass: Dense n= 0.240 P2= 2.68"
2.4	350	0.1200	2.42		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
9.0	450				Total

**Summary for Subcatchment S206:**

Runoff = 4.58 cfs @ 12.13 hrs, Volume= 0.272 af, Depth= 3.69"  
 Routed to Reach R3 : ROADSIDE SWALE

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
0.320	98	Paved parking, HSG D
0.563	78	Meadow, non-grazed, HSG D
0.883	85	Weighted Average
0.563		63.76% Pervious Area
0.320		36.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, MIN</b>

**Summary for Subcatchment S207:**

Runoff = 3.48 cfs @ 12.15 hrs, Volume= 0.219 af, Depth= 3.11"  
 Routed to Reach R4 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 50-YR Rainfall=5.35"

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 60

Area (ac)	CN	Description
0.683	79	Woods, Fair, HSG D
0.164	78	Meadow, non-grazed, HSG D
0.847	79	Weighted Average
0.847		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	30	0.5000	0.30		<b>Sheet Flow, SF</b> Grass: Dense n= 0.240 P2= 2.68"
6.0	70	0.3000	0.20		<b>Sheet Flow, SF WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
0.5	80	0.3000	2.74		<b>Shallow Concentrated Flow, SCF</b> Woodland Kv= 5.0 fps
8.1	180				Total

**Summary for Subcatchment S208:**

Runoff = 51.70 cfs @ 12.18 hrs, Volume= 3.634 af, Depth= 3.79"  
 Routed to Reach R7 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
0.087	79	Woods, Fair, HSG D
2.085	78	Meadow, non-grazed, HSG D
* 3.920	98	SOLAR PANELS
5.398	80	>75% Grass cover, Good, HSG D
11.490	86	Weighted Average
7.570		65.88% Pervious Area
3.920		34.12% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.4	100	0.1300	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
2.9	570	0.2235	3.31		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
10.3	670				Total

**Summary for Subcatchment S209:**

Runoff = 2.02 cfs @ 12.13 hrs, Volume= 0.117 af, Depth= 3.01"  
 Routed to Reach R5 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 50-YR Rainfall=5.35"



**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 61

Area (ac)	CN	Description
0.012	79	Woods, Fair, HSG D
0.453	78	Meadow, non-grazed, HSG D
0.465	78	Weighted Average
0.465		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, MIN</b>

**Summary for Subcatchment S300:**

Runoff = 17.42 cfs @ 12.24 hrs, Volume= 1.389 af, Depth= 2.56"  
Routed to Link DPE :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 50-YR Rainfall=5.35"

Area (ac)	CN	Description
0.327	98	Paved parking, HSG C
4.927	71	Meadow, non-grazed, HSG C
1.260	73	Woods, Fair, HSG C
6.514	73	Weighted Average
6.187		94.98% Pervious Area
0.327		5.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.2	100	0.1400	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
7.8	1,700	0.0588	3.64		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Grassed Waterway Kv= 15.0 fps
15.0	1,800	Total			

**Summary for Reach R1: E-W SWALE**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 3.79" for 50-YR event  
Inflow = 19.96 cfs @ 12.17 hrs, Volume= 1.373 af  
Outflow = 19.87 cfs @ 12.18 hrs, Volume= 1.373 af, Atten= 0%, Lag= 0.5 min  
Routed to Pond F2 : FOREBAY 2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 12.03 fps, Min. Travel Time= 0.7 min  
Avg. Velocity = 3.96 fps, Avg. Travel Time= 2.0 min

Peak Storage= 801 cf @ 12.18 hrs  
Average Depth at Peak Storage= 0.59' , Surface Width= 4.56'  
Bank-Full Depth= 1.00' Flow Area= 4.0 sf, Capacity= 65.06 cfs

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 62

1.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 3.0 ' / ' Top Width= 7.00'  
Length= 485.0' Slope= 0.1299 ' / '  
Inlet Invert= 968.00', Outlet Invert= 905.00'



**Summary for Reach R2: OVERFLOW SWALE**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth > 3.28" for 50-YR event  
Inflow = 5.98 cfs @ 12.96 hrs, Volume= 3.137 af  
Outflow = 5.98 cfs @ 12.96 hrs, Volume= 3.137 af, Atten= 0%, Lag= 0.1 min  
Routed to Pond D1 : RETENTION POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 9.55 fps, Min. Travel Time= 0.2 min  
Avg. Velocity = 4.69 fps, Avg. Travel Time= 0.4 min

Peak Storage= 75 cf @ 12.96 hrs  
Average Depth at Peak Storage= 0.23' , Surface Width= 3.39'  
Bank-Full Depth= 2.00' Flow Area= 16.0 sf, Capacity= 507.22 cfs

2.00' x 2.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 3.0 ' / ' Top Width= 14.00'  
Length= 120.0' Slope= 0.1958 ' / '  
Inlet Invert= 893.50', Outlet Invert= 870.00'



**Summary for Reach R3: ROADSIDE SWALE**

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth = 3.69" for 50-YR event  
Inflow = 4.58 cfs @ 12.13 hrs, Volume= 0.272 af  
Outflow = 4.30 cfs @ 12.15 hrs, Volume= 0.272 af, Atten= 6%, Lag= 1.4 min  
Routed to Pond B4 : BIORETENTION AREA 4

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 5.86 fps, Min. Travel Time= 2.3 min  
Avg. Velocity = 1.73 fps, Avg. Travel Time= 8.0 min

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024  
Page 63

Peak Storage= 605 cf @ 12.15 hrs  
Average Depth at Peak Storage= 0.36' , Surface Width= 3.13'  
Bank-Full Depth= 1.00' Flow Area= 4.0 sf, Capacity= 42.24 cfs

1.00' x 1.00' deep channel, n= 0.030 Earth, grassed & winding  
Side Slope Z-value= 3.0 ' / ' Top Width= 7.00'  
Length= 825.0' Slope= 0.1018 ' / '  
Inlet Invert= 924.00', Outlet Invert= 840.00'



**Summary for Reach R4:**

Inflow Area = 13.024 ac, 30.10% Impervious, Inflow Depth > 3.25" for 50-YR event  
Inflow = 8.95 cfs @ 12.18 hrs, Volume= 3.527 af  
Outflow = 8.78 cfs @ 12.20 hrs, Volume= 3.524 af, Atten= 2%, Lag= 1.4 min  
Routed to Link DPC :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 2.77 fps, Min. Travel Time= 2.2 min  
Avg. Velocity = 1.21 fps, Avg. Travel Time= 5.0 min

Peak Storage= 1,143 cf @ 12.20 hrs  
Average Depth at Peak Storage= 0.06' , Surface Width= 52.48'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,059.41 cfs

50.00' x 1.00' deep channel, n= 0.035 Earth, dense weeds  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 360.0' Slope= 0.1778 ' / '  
Inlet Invert= 831.00', Outlet Invert= 767.00'



**Summary for Reach R5:**

Inflow Area = 1.832 ac, 17.47% Impervious, Inflow Depth > 3.20" for 50-YR event  
Inflow = 4.70 cfs @ 12.20 hrs, Volume= 0.488 af  
Outflow = 4.67 cfs @ 12.22 hrs, Volume= 0.488 af, Atten= 1%, Lag= 1.0 min  
Routed to Link DPD :

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024  
Page 64

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 2.94 fps, Min. Travel Time= 1.2 min  
Avg. Velocity = 1.40 fps, Avg. Travel Time= 2.6 min

Peak Storage= 349 cf @ 12.22 hrs  
Average Depth at Peak Storage= 0.03' , Surface Width= 51.25'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,753.82 cfs

50.00' x 1.00' deep channel, n= 0.020 Corrugated PE, corrugated interior  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 220.0' Slope= 0.1591 ' / '  
Inlet Invert= 822.00', Outlet Invert= 787.00'



**Summary for Reach R6:**

Inflow Area = 14.805 ac, 22.90% Impervious, Inflow Depth > 3.31" for 50-YR event  
Inflow = 52.45 cfs @ 12.24 hrs, Volume= 4.078 af  
Outflow = 49.42 cfs @ 12.29 hrs, Volume= 4.073 af, Atten= 6%, Lag= 2.9 min  
Routed to Link DPB :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 5.94 fps, Min. Travel Time= 4.5 min  
Avg. Velocity = 1.33 fps, Avg. Travel Time= 20.1 min

Peak Storage= 13,354 cf @ 12.29 hrs  
Average Depth at Peak Storage= 0.16' , Surface Width= 56.26'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,257.76 cfs

50.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 1,606.0' Slope= 0.0990 ' / '  
Inlet Invert= 895.00', Outlet Invert= 736.00'



**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 65

**Summary for Reach R7:**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth = 3.79" for 50-YR event  
 Inflow = 51.70 cfs @ 12.18 hrs, Volume= 3.634 af  
 Outflow = 51.60 cfs @ 12.18 hrs, Volume= 3.634 af, Atten= 0%, Lag= 0.3 min  
 Routed to Pond P1 : WET POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Max. Velocity= 12.59 fps, Min. Travel Time= 0.4 min  
 Avg. Velocity = 4.04 fps, Avg. Travel Time= 1.4 min

Peak Storage= 1,353 cf @ 12.18 hrs  
 Average Depth at Peak Storage= 0.88' , Surface Width= 7.29'  
 Bank-Full Depth= 2.00' Flow Area= 16.0 sf, Capacity= 321.73 cfs

2.00' x 2.00' deep channel, n= 0.022 Earth, clean & straight  
 Side Slope Z-value= 3.0 ' / ' Top Width= 14.00'  
 Length= 330.0' Slope= 0.0788 ' / '  
 Inlet Invert= 924.00', Outlet Invert= 898.00'



**Summary for Pond B1: BIORETENTION AREA 1**

Inflow Area = 4.851 ac, 34.30% Impervious, Inflow Depth = 3.37" for 50-YR event  
 Inflow = 18.72 cfs @ 12.23 hrs, Volume= 1.364 af  
 Outflow = 18.09 cfs @ 12.27 hrs, Volume= 1.359 af, Atten= 3%, Lag= 2.1 min  
 Primary = 0.08 cfs @ 12.27 hrs, Volume= 0.153 af

Routed to Reach R6 :  
 Secondary = 18.00 cfs @ 12.27 hrs, Volume= 1.206 af  
 Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 903.99' @ 12.27 hrs Surf.Area= 7,240 sf Storage= 6,553 cf

Plug-Flow detention time= 63.7 min calculated for 1.359 af (100% of inflow)  
 Center-of-Mass det. time= 61.5 min ( 899.8 - 838.3 )

Volume	Invert	Avail.Storage	Storage Description			
#1	903.00'	14,542 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
903.00	5,991	427.0	0	0	5,991	
905.00	8,631	465.0	14,542	14,542	8,832	

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 66

Device	Routing	Invert	Outlet Devices
#1	Primary	900.50'	<b>8.0" Round Culvert</b> L= 50.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 900.50' / 899.00' S= 0.0300 ' / ' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf
#2	Secondary	903.50'	<b>20.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Device 1	903.00'	<b>0.500 in/hr Exfiltration over Surface area</b>

**Primary OutFlow** Max=0.08 cfs @ 12.27 hrs HW=903.99' TW=895.16' (Dynamic Tailwater)  
 ↳1=Culvert (Passes 0.08 cfs of 2.08 cfs potential flow)  
 ↳3=Exfiltration (Exfiltration Controls 0.08 cfs)

**Secondary OutFlow** Max=17.96 cfs @ 12.27 hrs HW=903.99' TW=895.16' (Dynamic Tailwater)  
 ↳2=Broad-Crested Rectangular Weir(Weir Controls 17.96 cfs @ 1.83 fps)

**Summary for Pond B2: BIORETENTION AREA 2**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 3.43" for 50-YR event  
 Inflow = 18.79 cfs @ 12.19 hrs, Volume= 1.243 af  
 Outflow = 17.98 cfs @ 12.22 hrs, Volume= 1.239 af, Atten= 4%, Lag= 1.8 min  
 Primary = 0.08 cfs @ 12.22 hrs, Volume= 0.143 af

Routed to Reach R6 :  
 Secondary = 17.90 cfs @ 12.22 hrs, Volume= 1.096 af  
 Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 903.99' @ 12.22 hrs Surf.Area= 6,718 sf Storage= 6,064 cf

Plug-Flow detention time= 64.5 min calculated for 1.238 af (100% of inflow)  
 Center-of-Mass det. time= 62.8 min ( 895.8 - 832.9 )

Volume	Invert	Avail.Storage	Storage Description			
#1	903.00'	13,497 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
903.00	5,550	421.0	0	0	5,550	
905.00	8,023	459.0	13,497	13,497	8,353	

Device	Routing	Invert	Outlet Devices
#1	Primary	900.50'	<b>8.0" Round Culvert</b> L= 50.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 900.50' / 899.00' S= 0.0300 ' / ' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf
#2	Secondary	903.50'	<b>20.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 50-YR Rainfall=5.35"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 67

Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66  
2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

#3 Device 1 903.00' **0.500 in/hr Exfiltration over Surface area**

**Primary OutFlow** Max=0.08 cfs @ 12.22 hrs HW=903.99' TW=895.15' (Dynamic Tailwater)

↳**1=Culvert** (Passes 0.08 cfs of 2.07 cfs potential flow)

↳**3=Exfiltration** (Exfiltration Controls 0.08 cfs)

**Secondary OutFlow** Max=17.84 cfs @ 12.22 hrs HW=903.99' TW=895.15' (Dynamic Tailwater)

↳**2=Broad-Crested Rectangular Weir**(Weir Controls 17.84 cfs @ 1.82 fps)

**Summary for Pond B3: BIORETENTION AREA 3**

Inflow Area = 0.583 ac, 34.82% Impervious, Inflow Depth = 3.69" for 50-YR event  
Inflow = 3.36 cfs @ 12.10 hrs, Volume= 0.179 af  
Outflow = 3.11 cfs @ 12.12 hrs, Volume= 0.179 af, Atten= 7%, Lag= 1.3 min  
Primary = 0.02 cfs @ 12.12 hrs, Volume= 0.031 af  
Routed to Reach R6 :  
Secondary = 3.09 cfs @ 12.12 hrs, Volume= 0.148 af  
Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Peak Elev= 898.89' @ 12.12 hrs Surf.Area= 1,512 sf Storage= 1,029 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)  
Center-of-Mass det. time= 79.1 min ( 881.1 - 802.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	898.00'	3,200 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
898.00	800	0	0
900.00	2,400	3,200	3,200

Device	Routing	Invert	Outlet Devices
#1	Device 3	898.00'	<b>0.500 in/hr Exfiltration over Surface area</b>
#2	Secondary	898.50'	<b>5.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Primary	895.50'	<b>8.0" Round Culvert</b> L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 895.50' / 895.00' S= 0.0083 '/' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 50-YR Rainfall=5.35"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 68

**Primary OutFlow** Max=0.02 cfs @ 12.12 hrs HW=898.89' TW=895.10' (Dynamic Tailwater)

↳**3=Culvert** (Passes 0.02 cfs of 1.63 cfs potential flow)

↳**1=Exfiltration** (Exfiltration Controls 0.02 cfs)

**Secondary OutFlow** Max=3.07 cfs @ 12.12 hrs HW=898.89' TW=895.10' (Dynamic Tailwater)

↳**2=Broad-Crested Rectangular Weir**(Weir Controls 3.07 cfs @ 1.58 fps)

**Summary for Pond B4: BIORETENTION AREA 4**

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth = 3.69" for 50-YR event  
Inflow = 4.30 cfs @ 12.15 hrs, Volume= 0.272 af  
Outflow = 4.03 cfs @ 12.18 hrs, Volume= 0.255 af, Atten= 6%, Lag= 1.7 min  
Primary = 0.02 cfs @ 12.18 hrs, Volume= 0.045 af  
Routed to Pond D2 : DETENTION POND  
Secondary = 4.01 cfs @ 12.18 hrs, Volume= 0.210 af  
Routed to Pond D2 : DETENTION POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Peak Elev= 838.84' @ 12.18 hrs Surf.Area= 2,156 sf Storage= 2,222 cf

Plug-Flow detention time= 132.8 min calculated for 0.254 af (94% of inflow)  
Center-of-Mass det. time= 98.3 min ( 908.3 - 810.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	837.00'	5,303 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
837.00	15	0	0
838.00	1,417	716	716
840.00	3,170	4,587	5,303

Device	Routing	Invert	Outlet Devices
#1	Device 3	837.00'	<b>0.500 in/hr Exfiltration over Surface area</b>
#2	Secondary	838.50'	<b>8.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Primary	835.50'	<b>8.0" Round Culvert</b> L= 25.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 835.50' / 834.00' S= 0.0600 '/' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf

**Primary OutFlow** Max=0.02 cfs @ 12.18 hrs HW=838.84' TW=836.30' (Dynamic Tailwater)

↳**3=Culvert** (Passes 0.02 cfs of 1.98 cfs potential flow)

↳**1=Exfiltration** (Exfiltration Controls 0.02 cfs)

**Secondary OutFlow** Max=4.00 cfs @ 12.18 hrs HW=838.84' TW=836.30' (Dynamic Tailwater)

↳**2=Broad-Crested Rectangular Weir**(Weir Controls 4.00 cfs @ 1.46 fps)

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 50-YR Rainfall=5.35"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 69

**Summary for Pond D1: RETENTION POND**

Inflow Area = 12.177 ac, 32.19% Impervious, Inflow Depth > 3.26" for 50-YR event  
 Inflow = 6.59 cfs @ 12.18 hrs, Volume= 3.309 af  
 Outflow = 6.31 cfs @ 12.76 hrs, Volume= 3.308 af, Atten= 4%, Lag= 35.1 min  
 Primary = 6.31 cfs @ 12.76 hrs, Volume= 3.308 af

Routed to Reach R4 :  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Reach R4 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 866.00' @ 12.76 hrs Surf.Area= 1,141 sf Storage= 1,256 cf

Plug-Flow detention time= 2.6 min calculated for 3.308 af (100% of inflow)  
 Center-of-Mass det. time= 2.1 min ( 1,012.4 - 1,010.2 )

Volume	Invert	Avail.Storage	Storage Description			
#1	864.00'	12,104 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
864.00	230	80.0	0	0	230	
866.00	1,140	145.0	1,255	1,255	1,415	
868.00	2,560	210.0	3,606	4,860	3,286	
870.00	4,800	270.0	7,244	12,104	5,627	

Device	Routing	Invert	Outlet Devices									
#1	Primary	864.00'	<b>15.0" Round Culvert</b> L= 50.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 864.00' / 863.00' S= 0.0200 '/' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 1.23 sf									
#2	Secondary	868.75'	<b>10.0' long x 6.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.37 2.51 2.70 2.68 2.68 2.67 2.65 2.65 2.65 2.65 2.66 2.66 2.67 2.69 2.72 2.76 2.83									

**Primary OutFlow** Max=6.31 cfs @ 12.76 hrs HW=866.00' TW=831.05' (Dynamic Tailwater)  
 ↳1=Culvert (Barrel Controls 6.31 cfs @ 5.15 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=864.00' TW=831.00' (Dynamic Tailwater)  
 ↳2=Broad-Crested Rectangular Weir ( Controls 0.00 cfs)

**Summary for Pond D2: DETENTION POND****2024-02-22 Proposed Drainage**

NRCC 24-hr B 50-YR Rainfall=5.35"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 70

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth > 3.46" for 50-YR event  
 Inflow = 4.03 cfs @ 12.18 hrs, Volume= 0.255 af  
 Outflow = 2.15 cfs @ 12.32 hrs, Volume= 0.254 af, Atten= 47%, Lag= 8.3 min  
 Primary = 2.15 cfs @ 12.32 hrs, Volume= 0.254 af  
 Routed to Reach R5 :  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Reach R5 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 836.57' @ 12.32 hrs Surf.Area= 2,224 sf Storage= 2,714 cf

Plug-Flow detention time= 72.8 min calculated for 0.254 af (100% of inflow)  
 Center-of-Mass det. time= 70.6 min ( 978.9 - 908.3 )

Volume	Invert	Avail.Storage	Storage Description			
#1	834.00'	6,977 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
834.00	160	85.0	0	0	160	
836.00	1,710	225.0	1,595	1,595	3,628	
838.00	3,810	285.0	5,382	6,977	6,115	

Device	Routing	Invert	Outlet Devices									
#1	Secondary	836.75'	<b>10.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32									
#2	Device 4	834.00'	<b>2.0" Vert. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads									
#3	Device 4	836.00'	<b>10.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads									
#4	Primary	833.90'	<b>10.0" Round Culvert</b> L= 30.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 833.90' / 833.00' S= 0.0300 '/' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.55 sf									

**Primary OutFlow** Max=2.15 cfs @ 12.32 hrs HW=836.57' TW=822.03' (Dynamic Tailwater)  
 ↳4=Culvert (Passes 2.15 cfs of 3.11 cfs potential flow)  
 ↳2=Orifice/Grate (Orifice Controls 0.17 cfs @ 7.59 fps)  
 ↳3=Orifice/Grate (Orifice Controls 1.98 cfs @ 3.64 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=834.00' TW=822.00' (Dynamic Tailwater)  
 ↳1=Broad-Crested Rectangular Weir ( Controls 0.00 cfs)

**Summary for Pond D3: RETENTION POND**

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 50-YR Rainfall=5.35"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 71

Inflow Area = 0.484 ac, 0.00% Impervious, Inflow Depth = 3.01" for 50-YR event  
 Inflow = 1.88 cfs @ 12.16 hrs, Volume= 0.121 af  
 Outflow = 1.65 cfs @ 12.21 hrs, Volume= 0.117 af, Atten= 12%, Lag= 2.6 min  
 Primary = 1.65 cfs @ 12.21 hrs, Volume= 0.117 af  
 Routed to Reach R5 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 838.84' @ 12.21 hrs Surf.Area= 654 sf Storage= 590 cf

Plug-Flow detention time= 37.5 min calculated for 0.117 af (96% of inflow)  
 Center-of-Mass det. time= 17.2 min ( 843.5 - 826.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	837.00'	1,625 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
837.00	60	0	0
838.00	310	185	185
840.00	1,130	1,440	1,625

Device	Routing	Invert	Outlet Devices
#1	Primary	838.00'	<b>12.0" Round Culvert</b> L= 100.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 838.00' / 837.00' S= 0.0100 ' / Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.64 cfs @ 12.21 hrs HW=838.84' TW=822.03' (Dynamic Tailwater)  
 ↳1=Culvert (Barrel Controls 1.64 cfs @ 3.16 fps)

**Summary for Pond F1: FOREBAY 2**

Inflow Area = 4.851 ac, 34.30% Impervious, Inflow Depth = 3.79" for 50-YR event  
 Inflow = 19.75 cfs @ 12.21 hrs, Volume= 1.534 af  
 Outflow = 18.72 cfs @ 12.23 hrs, Volume= 1.364 af, Atten= 5%, Lag= 1.4 min  
 Primary = 18.72 cfs @ 12.23 hrs, Volume= 1.364 af  
 Routed to Pond B1 : BIORETENTION AREA 1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 904.14' @ 12.25 hrs Surf.Area= 4,498 sf Storage= 10,057 cf

Plug-Flow detention time= 83.3 min calculated for 1.364 af (89% of inflow)  
 Center-of-Mass det. time= 29.5 min ( 838.3 - 808.9 )

Volume	Invert	Avail.Storage	Storage Description
#1	899.00'	14,382 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 50-YR Rainfall=5.35"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 72

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
899.00	218	86.0	0	0	218
901.00	1,277	230.0	1,348	1,348	3,853
903.00	3,198	372.0	4,331	5,679	10,682
905.00	5,618	426.0	8,703	14,382	14,203

Device	Routing	Invert	Outlet Devices
#1	Primary	903.50'	<b>20.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32

**Primary OutFlow** Max=18.02 cfs @ 12.23 hrs HW=904.14' TW=903.98' (Dynamic Tailwater)  
 ↳1=Broad-Crested Rectangular Weir (Weir Controls 18.02 cfs @ 1.42 fps)

**Summary for Pond F2: FOREBAY 2**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 3.79" for 50-YR event  
 Inflow = 19.87 cfs @ 12.18 hrs, Volume= 1.373 af  
 Outflow = 18.79 cfs @ 12.19 hrs, Volume= 1.243 af, Atten= 5%, Lag= 1.0 min  
 Primary = 18.79 cfs @ 12.19 hrs, Volume= 1.243 af  
 Routed to Pond B2 : BIORETENTION AREA 2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 904.14' @ 12.21 hrs Surf.Area= 3,859 sf Storage= 7,897 cf

Plug-Flow detention time= 73.9 min calculated for 1.242 af (90% of inflow)  
 Center-of-Mass det. time= 26.1 min ( 832.9 - 806.8 )

Volume	Invert	Avail.Storage	Storage Description
#1	899.00'	11,697 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
899.00	98	53.0	0	0	98
901.00	930	189.0	887	887	2,728
903.00	2,575	324.0	3,368	4,255	8,263
905.00	5,000	439.0	7,442	11,697	15,287

Device	Routing	Invert	Outlet Devices
#1	Primary	903.50'	<b>20.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32

**Primary OutFlow** Max=17.89 cfs @ 12.19 hrs HW=904.13' TW=903.98' (Dynamic Tailwater)  
 ↳1=Broad-Crested Rectangular Weir (Weir Controls 17.89 cfs @ 1.41 fps)

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 50-YR Rainfall=5.35"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 73

**Summary for Pond P1: WET POND**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth = 3.79" for 50-YR event  
 Inflow = 51.60 cfs @ 12.18 hrs, Volume= 3.634 af  
 Outflow = 5.98 cfs @ 12.96 hrs, Volume= 3.137 af, Atten= 88%, Lag= 46.4 min  
 Primary = 5.98 cfs @ 12.96 hrs, Volume= 3.137 af  
 Routed to Reach R2 : OVERFLOW SWALE  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Reach R2 : OVERFLOW SWALE

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Starting Elev= 894.00' Surf.Area= 12,390 sf Storage= 18,141 cf  
 Peak Elev= 898.02' @ 12.96 hrs Surf.Area= 28,924 sf Storage= 105,167 cf (87,026 cf above start)  
 Flood Elev= 900.00' Surf.Area= 35,579 sf Storage= 168,762 cf (150,621 cf above start)

Plug-Flow detention time= 341.9 min calculated for 2.719 af (75% of inflow)  
 Center-of-Mass det. time= 213.3 min ( 1,020.2 - 806.9 )

Volume	Invert	Avail.Storage	Storage Description
#1	891.00'	168,762 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet) Cum.Store (cubic-feet) Wet.Area (sq-ft)
891.00	2,741	349.0	0 0 2,741
892.00	3,525	397.0	3,125 3,125 5,615
894.00	12,390	626.0	15,016 18,141 24,285
896.00	22,863	877.0	34,722 52,863 54,344
898.00	28,845	1,061.0	51,592 104,455 82,786
900.00	35,579	1,100.0	64,306 168,762 89,833

Device	Routing	Invert	Outlet Devices
#1	Secondary	898.75'	<b>10.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#2	Device 5	894.00'	<b>3.0" Vert. Low Flow Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 5	895.90'	<b>12.0" Horiz. Stand Pipe</b> C= 0.600 Limited to weir flow at low heads
#4	Device 5	898.50'	<b>1.0" x 4.0" Horiz. Orifice/Grate X 13.00 columns</b> X 5 rows C= 0.600 in 30.0" x 30.0" Grate (29% open area)
#5	Primary	893.90'	<b>18.0" Round Culvert</b> L= 70.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 893.90' / 892.00' S= 0.0271 '"/ Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 1.77 sf

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 50-YR Rainfall=5.35"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 74

**Primary OutFlow** Max=5.98 cfs @ 12.96 hrs HW=898.02' TW=893.73' (Dynamic Tailwater)  
 5=Culvert (Passes 5.98 cfs of 13.80 cfs potential flow)  
 2=Low Flow Orifice (Orifice Controls 0.47 cfs @ 9.51 fps)  
 3=Stand Pipe (Orifice Controls 5.51 cfs @ 7.02 fps)  
 4=Orifice/Grate ( Controls 0.00 cfs)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=894.00' TW=893.50' (Dynamic Tailwater)  
 1=Broad-Crested Rectangular Weir ( Controls 0.00 cfs)

**Summary for Link DPA:**

Inflow Area = 2.376 ac, 0.00% Impervious, Inflow Depth = 3.01" for 50-YR event  
 Inflow = 8.41 cfs @ 12.19 hrs, Volume= 0.596 af  
 Primary = 8.41 cfs @ 12.19 hrs, Volume= 0.596 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPB:**

Inflow Area = 14.805 ac, 22.90% Impervious, Inflow Depth > 3.30" for 50-YR event  
 Inflow = 49.42 cfs @ 12.29 hrs, Volume= 4.073 af  
 Primary = 49.42 cfs @ 12.29 hrs, Volume= 4.073 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPC:**

Inflow Area = 13.024 ac, 30.10% Impervious, Inflow Depth > 3.25" for 50-YR event  
 Inflow = 8.78 cfs @ 12.20 hrs, Volume= 3.524 af  
 Primary = 8.78 cfs @ 12.20 hrs, Volume= 3.524 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPD:**

Inflow Area = 1.832 ac, 17.47% Impervious, Inflow Depth > 3.20" for 50-YR event  
 Inflow = 4.67 cfs @ 12.22 hrs, Volume= 0.488 af  
 Primary = 4.67 cfs @ 12.22 hrs, Volume= 0.488 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 50-YR Rainfall=5.35"

Printed 2/23/2024

Page 75

**Summary for Link DPE:**

Inflow Area = 6.514 ac, 5.02% Impervious, Inflow Depth = 2.56" for 50-YR event  
 Inflow = 17.42 cfs @ 12.24 hrs, Volume= 1.389 af  
 Primary = 17.42 cfs @ 12.24 hrs, Volume= 1.389 af, Atten= 0%, Lag= 0.0 min  
 Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/23/2024

Page 76

Time span=0.00-36.00 hrs, dt=0.02 hrs, 1801 points  
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
 Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

**SubcatchmentS100:** Runoff Area=2.376 ac 0.00% Impervious Runoff Depth=3.56"  
 Flow Length=775' Tc=11.3 min CN=78 Runoff=9.92 cfs 0.705 af

**SubcatchmentS200:** Runoff Area=4.851 ac 34.30% Impervious Runoff Depth=4.39"  
 Flow Length=1,171' Tc=13.3 min CN=86 Runoff=22.70 cfs 1.775 af

**SubcatchmentS201:** Runoff Area=4.342 ac 35.08% Impervious Runoff Depth=4.39"  
 Flow Length=636' Tc=9.7 min CN=86 Runoff=22.92 cfs 1.589 af

**SubcatchmentS202:** Runoff Area=0.583 ac 34.82% Impervious Runoff Depth=4.28"  
 Flow Length=319' Tc=2.7 min CN=85 Runoff=3.86 cfs 0.208 af

**SubcatchmentS203:** Runoff Area=5.029 ac 0.00% Impervious Runoff Depth=3.66"  
 Flow Length=1,218' Tc=16.3 min CN=79 Runoff=18.44 cfs 1.535 af

**SubcatchmentS204:** Runoff Area=0.687 ac 0.00% Impervious Runoff Depth=3.56"  
 Flow Length=200' Tc=7.4 min CN=78 Runoff=3.32 cfs 0.204 af

**SubcatchmentS205:** Runoff Area=0.484 ac 0.00% Impervious Runoff Depth=3.56"  
 Flow Length=450' Tc=9.0 min CN=78 Runoff=2.21 cfs 0.144 af

**SubcatchmentS206:** Runoff Area=0.883 ac 36.24% Impervious Runoff Depth=4.28"  
 Tc=6.0 min CN=85 Runoff=5.27 cfs 0.315 af

**SubcatchmentS207:** Runoff Area=0.847 ac 0.00% Impervious Runoff Depth=3.66"  
 Flow Length=180' Tc=8.1 min CN=79 Runoff=4.09 cfs 0.258 af

**SubcatchmentS208:** Runoff Area=11.490 ac 34.12% Impervious Runoff Depth=4.39"  
 Flow Length=670' Tc=10.3 min CN=86 Runoff=59.38 cfs 4.204 af

**SubcatchmentS209:** Runoff Area=0.465 ac 0.00% Impervious Runoff Depth=3.56"  
 Tc=6.0 min CN=78 Runoff=2.38 cfs 0.138 af

**SubcatchmentS300:** Runoff Area=6.514 ac 5.02% Impervious Runoff Depth=3.07"  
 Flow Length=1,800' Tc=15.0 min CN=73 Runoff=20.96 cfs 1.668 af

**Reach R1: E-W SWALE** Avg. Flow Depth=0.63' Max Vel=12.46 fps Inflow=22.92 cfs 1.589 af  
 n=0.022 L=485.0' S=0.1299 '/ Capacity=65.06 cfs Outflow=22.83 cfs 1.589 af

**Reach R2: OVERFLOW SWALE** Avg. Flow Depth=0.26' Max Vel=10.16 fps Inflow=7.32 cfs 3.704 af  
 n=0.022 L=120.0' S=0.1958 '/ Capacity=507.22 cfs Outflow=7.32 cfs 3.704 af

**Reach R3: ROADSIDE SWALE** Avg. Flow Depth=0.38' Max Vel=6.09 fps Inflow=5.27 cfs 0.315 af  
 n=0.030 L=825.0' S=0.1018 '/ Capacity=42.24 cfs Outflow=4.97 cfs 0.315 af

**Reach R4:** Avg. Flow Depth=0.07' Max Vel=2.89 fps Inflow=10.00 cfs 4.165 af  
 n=0.035 L=360.0' S=0.1778 '/ Capacity=1,059.41 cfs Outflow=9.87 cfs 4.162 af



**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/23/2024

Page 77

**Reach R5:** Avg. Flow Depth=0.04' Max Vel=3.20 fps Inflow=5.80 cfs 0.575 af  
 n=0.020 L=220.0' S=0.1591 '/' Capacity=1,753.82 cfs Outflow=5.76 cfs 0.575 af

**Reach R6:** Avg. Flow Depth=0.17' Max Vel=6.30 fps Inflow=60.97 cfs 4.796 af  
 n=0.022 L=1,606.0' S=0.0990 '/' Capacity=1,257.76 cfs Outflow=57.82 cfs 4.791 af

**Reach R7:** Avg. Flow Depth=0.94' Max Vel=13.05 fps Inflow=59.38 cfs 4.204 af  
 n=0.022 L=330.0' S=0.0788 '/' Capacity=321.73 cfs Outflow=59.27 cfs 4.204 af

**Pond B1: BIORETENTIONAREA 1** Peak Elev=904.04' Storage=6,886 cf Inflow=21.59 cfs 1.605 af  
 Primary=0.08 cfs 0.154 af Secondary=20.85 cfs 1.445 af Outflow=20.93 cfs 1.600 af

**Pond B2: BIORETENTIONAREA 2** Peak Elev=904.04' Storage=6,371 cf Inflow=21.65 cfs 1.458 af  
 Primary=0.08 cfs 0.145 af Secondary=20.71 cfs 1.310 af Outflow=20.79 cfs 1.454 af

**Pond B3: BIORETENTIONAREA 3** Peak Elev=898.93' Storage=1,086 cf Inflow=3.86 cfs 0.208 af  
 Primary=0.02 cfs 0.031 af Secondary=3.57 cfs 0.176 af Outflow=3.59 cfs 0.208 af

**Pond B4: BIORETENTIONAREA 4** Peak Elev=838.88' Storage=2,294 cf Inflow=4.97 cfs 0.315 af  
 Primary=0.03 cfs 0.046 af Secondary=4.65 cfs 0.252 af Outflow=4.68 cfs 0.298 af

**Pond D1: RETENTIONPOND** Peak Elev=866.61' Storage=2,058 cf Inflow=7.77 cfs 3.908 af  
 Primary=7.33 cfs 3.906 af Secondary=0.00 cfs 0.000 af Outflow=7.33 cfs 3.906 af

**Pond D2: DETENTIONPOND** Peak Elev=836.78' Storage=3,197 cf Inflow=4.68 cfs 0.298 af  
 Primary=2.49 cfs 0.297 af Secondary=0.11 cfs 0.001 af Outflow=2.60 cfs 0.298 af

**Pond D3: RENTENTIONPOND** Peak Elev=838.94' Storage=655 cf Inflow=2.21 cfs 0.144 af  
 12.0" Round Culvert n=0.020 L=100.0' S=0.0100 '/' Outflow=1.93 cfs 0.139 af

**Pond F1: FOREBAY 2** Peak Elev=904.21' Storage=10,344 cf Inflow=22.70 cfs 1.775 af  
 Outflow=21.59 cfs 1.605 af

**Pond F2: FOREBAY 2** Peak Elev=904.20' Storage=8,142 cf Inflow=22.83 cfs 1.589 af  
 Outflow=21.65 cfs 1.458 af

**Pond P1: WET POND** Peak Elev=898.51' Storage=119,491 cf Inflow=59.27 cfs 4.204 af  
 Primary=7.32 cfs 3.704 af Secondary=0.00 cfs 0.000 af Outflow=7.32 cfs 3.704 af

**Link DPA:** Inflow=9.92 cfs 0.705 af  
 Primary=9.92 cfs 0.705 af

**Link DPB:** Inflow=57.82 cfs 4.791 af  
 Primary=57.82 cfs 4.791 af

**Link DPC:** Inflow=9.87 cfs 4.162 af  
 Primary=9.87 cfs 4.162 af

**Link DPD:** Inflow=5.76 cfs 0.575 af  
 Primary=5.76 cfs 0.575 af

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/23/2024

Page 78

**Link DPE:** Inflow=20.96 cfs 1.668 af  
 Primary=20.96 cfs 1.668 af

**Total Runoff Area = 38.551 ac Runoff Volume = 12.742 af Average Runoff Depth = 3.97"**  
**79.36% Pervious = 30.594 ac 20.64% Impervious = 7.957 ac**

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/23/2024

Page 79

**Summary for Subcatchment S100:**

Runoff = 9.92 cfs @ 12.19 hrs, Volume= 0.705 af, Depth= 3.56"  
 Routed to Link DPA :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
0.763	79	Woods, Fair, HSG D
1.613	78	Meadow, non-grazed, HSG D
2.376	78	Weighted Average
2.376		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.7	50	0.2800	0.18		<b>Sheet Flow, SF - WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
3.1	50	0.2800	0.27		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
3.2	635	0.2272	3.34		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
0.3	40	0.2272	2.38		<b>Shallow Concentrated Flow, SCF - WOODS</b> Woodland Kv= 5.0 fps
11.3	775				Total

**Summary for Subcatchment S200:**

Runoff = 22.70 cfs @ 12.21 hrs, Volume= 1.775 af, Depth= 4.39"  
 Routed to Pond F1 : FOREBAY 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
0.013	79	Woods, Fair, HSG D
0.992	78	Meadow, non-grazed, HSG D
1.664	98	SOLAR PANELS
2.182	80	>75% Grass cover, Good, HSG D
4.851	86	Weighted Average
3.187		65.70% Pervious Area
1.664		34.30% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	100	0.1500	0.24		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
6.3	1,071	0.1634	2.83		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
13.3	1,171				Total

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/23/2024

Page 80

**Summary for Subcatchment S201:**

Runoff = 22.92 cfs @ 12.17 hrs, Volume= 1.589 af, Depth= 4.39"  
 Routed to Reach R1 : E-W SWALE

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
0.014	79	Woods, Fair, HSG D
1.056	78	Meadow, non-grazed, HSG D
1.523	98	SOLAR PANELS
1.749	80	>75% Grass cover, Good, HSG D
4.342	86	Weighted Average
2.819		64.92% Pervious Area
1.523		35.08% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8	100	0.1600	0.25		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
2.9	536	0.1900	3.05		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
9.7	636				Total

**Summary for Subcatchment S202:**

Runoff = 3.86 cfs @ 12.10 hrs, Volume= 0.208 af, Depth= 4.28"  
 Routed to Pond B3 : BIORETENTION AREA 3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
0.380	78	Meadow, non-grazed, HSG D
0.203	98	Paved parking, HSG D
0.583	85	Weighted Average
0.380		65.18% Pervious Area
0.203		34.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0	100	0.1500	0.84		<b>Sheet Flow, SF - GRAVEL</b> Fallow n= 0.050 P2= 2.68"
0.7	219	0.1100	4.97		<b>Shallow Concentrated Flow, SCF - CHANNEL</b> Grassed Waterway Kv= 15.0 fps
2.7	319				Total

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/23/2024

Page 81

**Summary for Subcatchment S203:**

Runoff = 18.44 cfs @ 12.25 hrs, Volume= 1.535 af, Depth= 3.66"  
 Routed to Reach R6 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
3.148	78	Meadow, non-grazed, HSG D
1.685	79	Woods, Fair, HSG D
0.110	96	Gravel surface, HSG D
0.086	80	>75% Grass cover, Good, HSG D
5.029	79	Weighted Average
5.029		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	100	0.1900	0.17		<b>Sheet Flow, SF - MEADOW</b>
					Woods: Light underbrush n= 0.400 P2= 2.68"
6.8	1,118	0.1512	2.72		<b>Shallow Concentrated Flow, SCF - MEADOW</b>
					Short Grass Pasture Kv= 7.0 fps
16.3	1,218	Total			

**Summary for Subcatchment S204:**

Runoff = 3.32 cfs @ 12.15 hrs, Volume= 0.204 af, Depth= 3.56"  
 Routed to Pond D1 : RETENTION POND

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
0.687	78	Meadow, non-grazed, HSG D
0.687		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.8	100	0.1600	0.25		<b>Sheet Flow, SF - MEADOW</b>
					Grass: Dense n= 0.240 P2= 2.68"
0.6	100	0.1500	2.71		<b>Shallow Concentrated Flow, SCF - MEADOW</b>
					Short Grass Pasture Kv= 7.0 fps
7.4	200	Total			

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/23/2024

Page 82

**Summary for Subcatchment S205:**

Runoff = 2.21 cfs @ 12.16 hrs, Volume= 0.144 af, Depth= 3.56"  
 Routed to Pond D3 : RETENTION POND

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
0.484	78	Meadow, non-grazed, HSG D
0.484		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	100	0.1700	0.25		<b>Sheet Flow, SF - WOODS</b>
					Grass: Dense n= 0.240 P2= 2.68"
2.4	350	0.1200	2.42		<b>Shallow Concentrated Flow, SCF - MEADOW</b>
					Short Grass Pasture Kv= 7.0 fps
9.0	450	Total			

**Summary for Subcatchment S206:**

Runoff = 5.27 cfs @ 12.13 hrs, Volume= 0.315 af, Depth= 4.28"  
 Routed to Reach R3 : ROADSIDE SWALE

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
0.320	98	Paved parking, HSG D
0.563	78	Meadow, non-grazed, HSG D
0.883	85	Weighted Average
0.563		63.76% Pervious Area
0.320		36.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, MIN</b>

**Summary for Subcatchment S207:**

Runoff = 4.09 cfs @ 12.15 hrs, Volume= 0.258 af, Depth= 3.66"  
 Routed to Reach R4 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 NRCC 24-hr B 100-YR Rainfall=5.98"

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 83

Area (ac)	CN	Description
0.683	79	Woods, Fair, HSG D
0.164	78	Meadow, non-grazed, HSG D
0.847	79	Weighted Average
0.847		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	30	0.5000	0.30		<b>Sheet Flow, SF</b> Grass: Dense n= 0.240 P2= 2.68"
6.0	70	0.3000	0.20		<b>Sheet Flow, SF WOODS</b> Woods: Light underbrush n= 0.400 P2= 2.68"
0.5	80	0.3000	2.74		<b>Shallow Concentrated Flow, SCF</b> Woodland Kv= 5.0 fps
8.1	180	Total			

**Summary for Subcatchment S208:**

Runoff = 59.38 cfs @ 12.18 hrs, Volume= 4.204 af, Depth= 4.39"  
Routed to Reach R7 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
0.087	79	Woods, Fair, HSG D
2.085	78	Meadow, non-grazed, HSG D
* 3.920	98	SOLAR PANELS
5.398	80	>75% Grass cover, Good, HSG D
11.490	86	Weighted Average
7.570		65.88% Pervious Area
3.920		34.12% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.4	100	0.1300	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
2.9	570	0.2235	3.31		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Short Grass Pasture Kv= 7.0 fps
10.3	670	Total			

**Summary for Subcatchment S209:**

Runoff = 2.38 cfs @ 12.13 hrs, Volume= 0.138 af, Depth= 3.56"  
Routed to Reach R5 :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 100-YR Rainfall=5.98"

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 84

Area (ac)	CN	Description
0.012	79	Woods, Fair, HSG D
0.453	78	Meadow, non-grazed, HSG D
0.465	78	Weighted Average
0.465		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, MIN</b>

**Summary for Subcatchment S300:**

Runoff = 20.96 cfs @ 12.23 hrs, Volume= 1.668 af, Depth= 3.07"  
Routed to Link DPE :

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
NRCC 24-hr B 100-YR Rainfall=5.98"

Area (ac)	CN	Description
0.327	98	Paved parking, HSG C
4.927	71	Meadow, non-grazed, HSG C
1.260	73	Woods, Fair, HSG C
6.514	73	Weighted Average
6.187		94.98% Pervious Area
0.327		5.02% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.2	100	0.1400	0.23		<b>Sheet Flow, SF - MEADOW</b> Grass: Dense n= 0.240 P2= 2.68"
7.8	1,700	0.0588	3.64		<b>Shallow Concentrated Flow, SCF - MEADOW</b> Grassed Waterway Kv= 15.0 fps
15.0	1,800	Total			

**Summary for Reach R1: E-W SWALE**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 4.39" for 100-YR event  
Inflow = 22.92 cfs @ 12.17 hrs, Volume= 1.589 af  
Outflow = 22.83 cfs @ 12.18 hrs, Volume= 1.589 af, Atten= 0%, Lag= 0.5 min  
Routed to Pond F2 : FOREBAY 2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 12.46 fps, Min. Travel Time= 0.6 min  
Avg. Velocity= 4.11 fps, Avg. Travel Time= 2.0 min

Peak Storage= 888 cf @ 12.18 hrs  
Average Depth at Peak Storage= 0.63' , Surface Width= 4.79'  
Bank-Full Depth= 1.00' Flow Area= 4.0 sf, Capacity= 65.06 cfs

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 85

1.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 3.0 ' / ' Top Width= 7.00'  
Length= 485.0' Slope= 0.1299 ' / '  
Inlet Invert= 968.00', Outlet Invert= 905.00'



**Summary for Reach R2: OVERFLOW SWALE**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth > 3.87" for 100-YR event  
Inflow = 7.32 cfs @ 12.88 hrs, Volume= 3.704 af  
Outflow = 7.32 cfs @ 12.90 hrs, Volume= 3.704 af, Atten= 0%, Lag= 1.0 min  
Routed to Pond D1 : RETENTION POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 10.16 fps, Min. Travel Time= 0.2 min  
Avg. Velocity = 4.86 fps, Avg. Travel Time= 0.4 min

Peak Storage= 87 cf @ 12.90 hrs  
Average Depth at Peak Storage= 0.26' , Surface Width= 3.56'  
Bank-Full Depth= 2.00' Flow Area= 16.0 sf, Capacity= 507.22 cfs

2.00' x 2.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 3.0 ' / ' Top Width= 14.00'  
Length= 120.0' Slope= 0.1958 ' / '  
Inlet Invert= 893.50', Outlet Invert= 870.00'



**Summary for Reach R3: ROADSIDE SWALE**

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth = 4.28" for 100-YR event  
Inflow = 5.27 cfs @ 12.13 hrs, Volume= 0.315 af  
Outflow = 4.97 cfs @ 12.15 hrs, Volume= 0.315 af, Atten= 6%, Lag= 1.3 min  
Routed to Pond B4 : BIORETENTION AREA 4

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 6.09 fps, Min. Travel Time= 2.3 min  
Avg. Velocity = 1.80 fps, Avg. Travel Time= 7.7 min

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 86

Peak Storage= 673 cf @ 12.15 hrs  
Average Depth at Peak Storage= 0.38' , Surface Width= 3.29'  
Bank-Full Depth= 1.00' Flow Area= 4.0 sf, Capacity= 42.24 cfs

1.00' x 1.00' deep channel, n= 0.030 Earth, grassed & winding  
Side Slope Z-value= 3.0 ' / ' Top Width= 7.00'  
Length= 825.0' Slope= 0.1018 ' / '  
Inlet Invert= 924.00', Outlet Invert= 840.00'



**Summary for Reach R4:**

Inflow Area = 13.024 ac, 30.10% Impervious, Inflow Depth > 3.84" for 100-YR event  
Inflow = 10.00 cfs @ 12.17 hrs, Volume= 4.165 af  
Outflow = 9.87 cfs @ 12.19 hrs, Volume= 4.162 af, Atten= 1%, Lag= 1.3 min  
Routed to Link DPC :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 2.89 fps, Min. Travel Time= 2.1 min  
Avg. Velocity = 1.26 fps, Avg. Travel Time= 4.7 min

Peak Storage= 1,228 cf @ 12.19 hrs  
Average Depth at Peak Storage= 0.07' , Surface Width= 52.66'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,059.41 cfs

50.00' x 1.00' deep channel, n= 0.035 Earth, dense weeds  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 360.0' Slope= 0.1778 ' / '  
Inlet Invert= 831.00', Outlet Invert= 767.00'



**Summary for Reach R5:**

Inflow Area = 1.832 ac, 17.47% Impervious, Inflow Depth > 3.77" for 100-YR event  
Inflow = 5.80 cfs @ 12.17 hrs, Volume= 0.575 af  
Outflow = 5.76 cfs @ 12.18 hrs, Volume= 0.575 af, Atten= 1%, Lag= 0.9 min  
Routed to Link DPD :

**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/23/2024  
Page 87

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 3.20 fps, Min. Travel Time= 1.1 min  
Avg. Velocity = 1.41 fps, Avg. Travel Time= 2.6 min

Peak Storage= 396 cf @ 12.18 hrs  
Average Depth at Peak Storage= 0.04' , Surface Width= 51.42'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,753.82 cfs

50.00' x 1.00' deep channel, n= 0.020 Corrugated PE, corrugated interior  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 220.0' Slope= 0.1591 ' / '  
Inlet Invert= 822.00', Outlet Invert= 787.00'



**Summary for Reach R6:**

Inflow Area = 14.805 ac, 22.90% Impervious, Inflow Depth > 3.89" for 100-YR event  
Inflow = 60.97 cfs @ 12.24 hrs, Volume= 4.796 af  
Outflow = 57.82 cfs @ 12.28 hrs, Volume= 4.791 af, Atten= 5%, Lag= 2.7 min  
Routed to Link DPB :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 6.30 fps, Min. Travel Time= 4.2 min  
Avg. Velocity = 1.38 fps, Avg. Travel Time= 19.4 min

Peak Storage= 14,738 cf @ 12.28 hrs  
Average Depth at Peak Storage= 0.17' , Surface Width= 56.87'  
Bank-Full Depth= 1.00' Flow Area= 70.0 sf, Capacity= 1,257.76 cfs

50.00' x 1.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 20.0 ' / ' Top Width= 90.00'  
Length= 1,606.0' Slope= 0.0990 ' / '  
Inlet Invert= 895.00', Outlet Invert= 736.00'



**2024-02-22 Proposed Drainage**

Prepared by Environmental Design Partnership  
HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

NRCC 24-hr B 100-YR Rainfall=5.98"

Printed 2/23/2024  
Page 88

**Summary for Reach R7:**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth = 4.39" for 100-YR event  
Inflow = 59.38 cfs @ 12.18 hrs, Volume= 4.204 af  
Outflow = 59.27 cfs @ 12.18 hrs, Volume= 4.204 af, Atten= 0%, Lag= 0.3 min  
Routed to Pond P1 : WET POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Max. Velocity= 13.05 fps, Min. Travel Time= 0.4 min  
Avg. Velocity = 4.20 fps, Avg. Travel Time= 1.3 min

Peak Storage= 1,499 cf @ 12.18 hrs  
Average Depth at Peak Storage= 0.94' , Surface Width= 7.65'  
Bank-Full Depth= 2.00' Flow Area= 16.0 sf, Capacity= 321.73 cfs

2.00' x 2.00' deep channel, n= 0.022 Earth, clean & straight  
Side Slope Z-value= 3.0 ' / ' Top Width= 14.00'  
Length= 330.0' Slope= 0.0788 ' / '  
Inlet Invert= 924.00', Outlet Invert= 898.00'



**Summary for Pond B1: BIORETENTION AREA 1**

Inflow Area = 4.851 ac, 34.30% Impervious, Inflow Depth = 3.97" for 100-YR event  
Inflow = 21.59 cfs @ 12.23 hrs, Volume= 1.605 af  
Outflow = 20.93 cfs @ 12.26 hrs, Volume= 1.600 af, Atten= 3%, Lag= 2.0 min  
Primary = 0.08 cfs @ 12.26 hrs, Volume= 0.154 af  
Routed to Reach R6 :  
Secondary = 20.85 cfs @ 12.26 hrs, Volume= 1.445 af  
Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
Peak Elev= 904.04' @ 12.26 hrs Surf.Area= 7,301 sf Storage= 6,886 cf

Plug-Flow detention time= 55.0 min calculated for 1,599 af (100% of inflow)  
Center-of-Mass det. time= 53.4 min ( 886.2 - 832.8 )

Volume	Invert	Avail.Storage	Storage Description		
#1	903.00'	14,542 cf	Custom Stage Data (Irregular) Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
903.00	5,991	427.0	0	0	5,991
905.00	8,631	465.0	14,542	14,542	8,832

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 89

Device	Routing	Invert	Outlet Devices
#1	Primary	900.50'	<b>8.0" Round Culvert</b> L= 50.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 900.50' / 899.00' S= 0.0300 ' / Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf
#2	Secondary	903.50'	<b>20.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Device 1	903.00'	<b>0.500 in/hr Exfiltration over Surface area</b>

**Primary OutFlow** Max=0.08 cfs @ 12.26 hrs HW=904.04' TW=895.17' (Dynamic Tailwater)

↳1=Culvert (Passes 0.08 cfs of 2.09 cfs potential flow)

↳3=Exfiltration (Exfiltration Controls 0.08 cfs)

**Secondary OutFlow** Max=20.81 cfs @ 12.26 hrs HW=904.04' TW=895.17' (Dynamic Tailwater)

↳2=Broad-Crested Rectangular Weir (Weir Controls 20.81 cfs @ 1.94 fps)

**Summary for Pond B2: BIORETENTION AREA 2**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 4.03" for 100-YR event  
 Inflow = 21.65 cfs @ 12.19 hrs, Volume= 1.458 af  
 Outflow = 20.79 cfs @ 12.22 hrs, Volume= 1.454 af, Atten= 4%, Lag= 1.7 min  
 Primary = 0.08 cfs @ 12.22 hrs, Volume= 0.145 af  
 Routed to Reach R6 :  
 Secondary = 20.71 cfs @ 12.22 hrs, Volume= 1.310 af  
 Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 904.04' @ 12.22 hrs Surf.Area= 6,774 sf Storage= 6,371 cf

Plug-Flow detention time= 56.6 min calculated for 1.454 af (100% of inflow)  
 Center-of-Mass det. time= 54.8 min ( 882.4 - 827.6 )

Volume	Invert	Avail.Storage	Storage Description		
#1	903.00'	13,497 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
903.00	5,550	421.0	0	0	5,550
905.00	8,023	459.0	13,497	13,497	8,353

Device	Routing	Invert	Outlet Devices
#1	Primary	900.50'	<b>8.0" Round Culvert</b> L= 50.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 900.50' / 899.00' S= 0.0300 ' / Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf
#2	Secondary	903.50'	<b>20.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 90

Device	Routing	Invert	Outlet Devices
#3	Device 1	903.00'	<b>0.500 in/hr Exfiltration over Surface area</b> Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

**Primary OutFlow** Max=0.08 cfs @ 12.22 hrs HW=904.04' TW=895.16' (Dynamic Tailwater)

↳1=Culvert (Passes 0.08 cfs of 2.09 cfs potential flow)

↳3=Exfiltration (Exfiltration Controls 0.08 cfs)

**Secondary OutFlow** Max=20.67 cfs @ 12.22 hrs HW=904.04' TW=895.16' (Dynamic Tailwater)

↳2=Broad-Crested Rectangular Weir (Weir Controls 20.67 cfs @ 1.93 fps)

**Summary for Pond B3: BIORETENTION AREA 3**

Inflow Area = 0.583 ac, 34.82% Impervious, Inflow Depth = 4.28" for 100-YR event  
 Inflow = 3.86 cfs @ 12.10 hrs, Volume= 0.208 af  
 Outflow = 3.59 cfs @ 12.12 hrs, Volume= 0.208 af, Atten= 7%, Lag= 1.3 min  
 Primary = 0.02 cfs @ 12.12 hrs, Volume= 0.031 af  
 Routed to Reach R6 :  
 Secondary = 3.57 cfs @ 12.12 hrs, Volume= 0.176 af  
 Routed to Reach R6 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 898.93' @ 12.12 hrs Surf.Area= 1,542 sf Storage= 1,086 cf

Plug-Flow detention time= 70.8 min calculated for 0.208 af (100% of inflow)  
 Center-of-Mass det. time= 70.2 min ( 868.1 - 797.9 )

Volume	Invert	Avail.Storage	Storage Description
#1	898.00'	3,200 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
898.00	800	0	0
900.00	2,400	3,200	3,200

Device	Routing	Invert	Outlet Devices
#1	Device 3	898.00'	<b>0.500 in/hr Exfiltration over Surface area</b>
#2	Secondary	898.50'	<b>5.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Primary	895.50'	<b>8.0" Round Culvert</b> L= 60.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 895.50' / 895.00' S= 0.0083 ' / Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 91

**Primary OutFlow** Max=0.02 cfs @ 12.12 hrs HW=898.93' TW=895.12' (Dynamic Tailwater)

↳ **3=Culvert** (Passes 0.02 cfs of 1.64 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.02 cfs)

**Secondary OutFlow** Max=3.55 cfs @ 12.12 hrs HW=898.93' TW=895.12' (Dynamic Tailwater)

↳ **2=Broad-Crested Rectangular Weir** (Weir Controls 3.55 cfs @ 1.67 fps)

**Summary for Pond B4: BIORETENTION AREA 4**

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth = 4.28" for 100-YR event  
 Inflow = 4.97 cfs @ 12.15 hrs, Volume= 0.315 af  
 Outflow = 4.68 cfs @ 12.18 hrs, Volume= 0.298 af, Atten= 6%, Lag= 1.6 min  
 Primary = 0.03 cfs @ 12.18 hrs, Volume= 0.046 af

Routed to Pond D2 : DETENTION POND

Secondary = 4.65 cfs @ 12.18 hrs, Volume= 0.252 af

Routed to Pond D2 : DETENTION POND

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 838.88' @ 12.18 hrs Surf.Area= 2,185 sf Storage= 2,294 cf

Plug-Flow detention time= 117.7 min calculated for 0.298 af (95% of inflow)  
 Center-of-Mass det. time= 86.8 min ( 892.5 - 805.7 )

Volume	Invert	Avail.Storage	Storage Description
#1	837.00'	5,303 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
837.00	15	0	0
838.00	1,417	716	716
840.00	3,170	4,587	5,303

Device	Routing	Invert	Outlet Devices
#1	Device 3	837.00'	<b>0.500 in/hr Exfiltration over Surface area</b>
#2	Secondary	838.50'	<b>8.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#3	Primary	835.50'	<b>8.0" Round Culvert</b> L= 25.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 835.50' / 834.00' S= 0.0600 ' / Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.35 sf

**Primary OutFlow** Max=0.03 cfs @ 12.18 hrs HW=838.88' TW=836.51' (Dynamic Tailwater)

↳ **3=Culvert** (Passes 0.03 cfs of 1.91 cfs potential flow)

↳ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)

**Secondary OutFlow** Max=4.65 cfs @ 12.18 hrs HW=838.88' TW=836.51' (Dynamic Tailwater)

↳ **2=Broad-Crested Rectangular Weir** (Weir Controls 4.65 cfs @ 1.55 fps)

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 92

**Summary for Pond D1: RETENTION POND**

Inflow Area = 12.177 ac, 32.19% Impervious, Inflow Depth > 3.85" for 100-YR event  
 Inflow = 7.77 cfs @ 12.17 hrs, Volume= 3.908 af  
 Outflow = 7.33 cfs @ 13.00 hrs, Volume= 3.906 af, Atten= 6%, Lag= 50.1 min  
 Primary = 7.33 cfs @ 13.00 hrs, Volume= 3.906 af

Routed to Reach R4 :

Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routed to Reach R4 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 866.61' @ 13.00 hrs Surf.Area= 1,512 sf Storage= 2,058 cf

Plug-Flow detention time= 3.0 min calculated for 3.904 af (100% of inflow)  
 Center-of-Mass det. time= 2.5 min ( 1,007.3 - 1,004.8 )

Volume	Invert	Avail.Storage	Storage Description
#1	864.00'	12,104 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
864.00	230	80.0	0	0	230
866.00	1,140	145.0	1,255	1,255	1,415
868.00	2,560	210.0	3,606	4,860	3,286
870.00	4,800	270.0	7,244	12,104	5,627

Device	Routing	Invert	Outlet Devices
#1	Primary	864.00'	<b>15.0" Round Culvert</b> L= 50.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 864.00' / 863.00' S= 0.0200 ' / Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 1.23 sf
#2	Secondary	868.75'	<b>10.0' long x 6.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.37 2.51 2.70 2.68 2.68 2.67 2.65 2.65 2.65 2.65 2.66 2.66 2.67 2.69 2.72 2.76 2.83

**Primary OutFlow** Max=7.33 cfs @ 13.00 hrs HW=866.61' TW=831.06' (Dynamic Tailwater)

↳ **1=Culvert** (Barrel Controls 7.33 cfs @ 5.97 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=864.00' TW=831.00' (Dynamic Tailwater)

↳ **2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

**Summary for Pond D2: DETENTION POND**



**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 93

Inflow Area = 0.883 ac, 36.24% Impervious, Inflow Depth > 4.05" for 100-YR event  
 Inflow = 4.68 cfs @ 12.18 hrs, Volume= 0.298 af  
 Outflow = 2.60 cfs @ 12.31 hrs, Volume= 0.298 af, Atten= 44%, Lag= 7.6 min  
 Primary = 2.49 cfs @ 12.31 hrs, Volume= 0.297 af

Routed to Reach R5 :  
 Secondary = 0.11 cfs @ 12.31 hrs, Volume= 0.001 af  
 Routed to Reach R5 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 836.78' @ 12.31 hrs Surf.Area= 2,428 sf Storage= 3,197 cf

Plug-Flow detention time= 69.4 min calculated for 0.298 af (100% of inflow)  
 Center-of-Mass det. time= 67.5 min ( 960.1 - 892.5 )

Volume	Invert	Avail.Storage	Storage Description			
#1	834.00'	6,977 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
834.00	160	85.0	0	0	160	
836.00	1,710	225.0	1,595	1,595	3,628	
838.00	3,810	285.0	5,382	6,977	6,115	

Device	Routing	Invert	Outlet Devices											
#1	Secondary	836.75'	<b>10.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32											
#2	Device 4	834.00'	<b>2.0" Vert. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads											
#3	Device 4	836.00'	<b>10.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads											
#4	Primary	833.90'	<b>10.0" Round Culvert</b> L= 30.0' CMP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 833.90' / 833.00' S= 0.0300'/' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.55 sf											

**Primary OutFlow** Max=2.49 cfs @ 12.31 hrs HW=836.78' TW=822.03' (Dynamic Tailwater)  
 ↳4=Culvert (Passes 2.49 cfs of 3.25 cfs potential flow)  
 ↳2=Orifice/Grate (Orifice Controls 0.17 cfs @ 7.90 fps)  
 ↳3=Orifice/Grate (Orifice Controls 2.32 cfs @ 4.24 fps)

**Secondary OutFlow** Max=0.11 cfs @ 12.31 hrs HW=836.78' TW=822.03' (Dynamic Tailwater)  
 ↳1=Broad-Crested Rectangular Weir (Weir Controls 0.11 cfs @ 0.40 fps)

**Summary for Pond D3: RENTENTION POND**

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 94

Inflow Area = 0.484 ac, 0.00% Impervious, Inflow Depth = 3.56" for 100-YR event  
 Inflow = 2.21 cfs @ 12.16 hrs, Volume= 0.144 af  
 Outflow = 1.93 cfs @ 12.21 hrs, Volume= 0.139 af, Atten= 13%, Lag= 2.7 min  
 Primary = 1.93 cfs @ 12.21 hrs, Volume= 0.139 af  
 Routed to Reach R5 :

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 838.94' @ 12.21 hrs Surf.Area= 694 sf Storage= 655 cf

Plug-Flow detention time= 33.3 min calculated for 0.139 af (97% of inflow)  
 Center-of-Mass det. time= 16.1 min ( 837.8 - 821.7 )

Volume	Invert	Avail.Storage	Storage Description	
#1	837.00'	1,625 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)	
Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	
837.00	60	0	0	
838.00	310	185	185	
840.00	1,130	1,440	1,625	

Device	Routing	Invert	Outlet Devices
#1	Primary	838.00'	<b>12.0" Round Culvert</b> L= 100.0' CMP, end-section conforming to fill, Ke= 0.500 Inlet / Outlet Invert= 838.00' / 837.00' S= 0.0100'/' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.92 cfs @ 12.21 hrs HW=838.93' TW=822.04' (Dynamic Tailwater)  
 ↳1=Culvert (Barrel Controls 1.92 cfs @ 3.27 fps)

**Summary for Pond F1: FOREBAY 2**

Inflow Area = 4.851 ac, 34.30% Impervious, Inflow Depth = 4.39" for 100-YR event  
 Inflow = 22.70 cfs @ 12.21 hrs, Volume= 1.775 af  
 Outflow = 21.59 cfs @ 12.23 hrs, Volume= 1.605 af, Atten= 5%, Lag= 1.3 min  
 Primary = 21.59 cfs @ 12.23 hrs, Volume= 1.605 af  
 Routed to Pond B1 : BIORETENTION AREA 1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 904.21' @ 12.25 hrs Surf.Area= 4,577 sf Storage= 10,344 cf

Plug-Flow detention time= 76.0 min calculated for 1.604 af (90% of inflow)  
 Center-of-Mass det. time= 27.9 min ( 832.8 - 804.9 )

Volume	Invert	Avail.Storage	Storage Description
#1	899.00'	14,382 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 95

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
899.00	218	86.0	0	0	218
901.00	1,277	230.0	1,348	1,348	3,853
903.00	3,198	372.0	4,331	5,679	10,682
905.00	5,618	426.0	8,703	14,382	14,203

Device	Routing	Invert	Outlet Devices
#1	Primary	903.50'	<b>20.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32

Primary OutFlow Max=20.83 cfs @ 12.23 hrs HW=904.20' TW=904.03' (Dynamic Tailwater)

↳1=Broad-Crested Rectangular Weir(Weir Controls 20.83 cfs @ 1.49 fps)

**Summary for Pond F2: FOREBAY 2**

Inflow Area = 4.342 ac, 35.08% Impervious, Inflow Depth = 4.39" for 100-YR event  
 Inflow = 22.83 cfs @ 12.18 hrs, Volume= 1.589 af  
 Outflow = 21.65 cfs @ 12.19 hrs, Volume= 1.458 af, Atten= 5%, Lag= 1.0 min  
 Primary = 21.65 cfs @ 12.19 hrs, Volume= 1.458 af  
 Routed to Pond B2 : BIORETENTION AREA 2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Peak Elev= 904.20' @ 12.21 hrs Surf.Area= 3,937 sf Storage= 8,142 cf

Plug-Flow detention time= 67.8 min calculated for 1.458 af (92% of inflow)  
 Center-of-Mass det. time= 24.8 min ( 827.6 - 802.8 )

Volume	Invert	Avail.Storage	Storage Description
#1	899.00'	11,697 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
899.00	98	53.0	0	0	98
901.00	930	189.0	887	887	2,728
903.00	2,575	324.0	3,368	4,255	8,263
905.00	5,000	439.0	7,442	11,697	15,287

Device	Routing	Invert	Outlet Devices
#1	Primary	903.50'	<b>20.0' long x 3.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 Coef. (English) 2.44 2.58 2.68 2.67 2.65 2.64 2.64 2.68 2.68 2.72 2.81 2.92 2.97 3.07 3.32

Primary OutFlow Max=20.66 cfs @ 12.19 hrs HW=904.19' TW=904.02' (Dynamic Tailwater)

↳1=Broad-Crested Rectangular Weir(Weir Controls 20.66 cfs @ 1.49 fps)

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 96

**Summary for Pond P1: WET POND**

Inflow Area = 11.490 ac, 34.12% Impervious, Inflow Depth = 4.39" for 100-YR event  
 Inflow = 59.27 cfs @ 12.18 hrs, Volume= 4.204 af  
 Outflow = 7.32 cfs @ 12.88 hrs, Volume= 3.704 af, Atten= 88%, Lag= 42.1 min  
 Primary = 7.32 cfs @ 12.88 hrs, Volume= 3.704 af  
 Routed to Reach R2 : OVERFLOW SWALE  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Reach R2 : OVERFLOW SWALE

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs  
 Starting Elev= 894.00' Surf.Area= 12,390 sf Storage= 18,141 cf  
 Peak Elev= 898.51' @ 12.88 hrs Surf.Area= 30,485 sf Storage= 119,491 cf (101,351 cf above start)  
 Flood Elev= 900.00' Surf.Area= 35,579 sf Storage= 168,762 cf (150,621 cf above start)

Plug-Flow detention time= 327.9 min calculated for 3.286 af (78% of inflow)  
 Center-of-Mass det. time= 211.8 min ( 1,014.7 - 802.9 )

Volume	Invert	Avail.Storage	Storage Description
#1	891.00'	168,762 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
891.00	2,741	349.0	0	0	2,741
892.00	3,525	397.0	3,125	3,125	5,615
894.00	12,390	626.0	15,016	18,141	24,285
896.00	22,863	877.0	34,722	52,863	54,344
898.00	28,845	1,061.0	51,592	104,455	82,786
900.00	35,579	1,100.0	64,306	168,762	89,833

Device	Routing	Invert	Outlet Devices
#1	Secondary	898.75'	<b>10.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32
#2	Device 5	894.00'	<b>3.0" Vert. Low Flow Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 5	895.90'	<b>12.0" Horiz. Stand Pipe</b> C= 0.600 Limited to weir flow at low heads
#4	Device 5	898.50'	<b>1.0" x 4.0" Horiz. Orifice/Grate X 13.00 columns</b> X 5 rows C= 0.600 in 30.0" x 30.0" Grate (29% open area)
#5	Primary	893.90'	<b>18.0" Round Culvert</b> L= 70.0' CMP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 893.90' / 892.00' S= 0.0271 ' Cc= 0.900 n= 0.020 Corrugated PE, corrugated interior, Flow Area= 1.77 sf

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 97

**Primary OutFlow** Max=7.32 cfs @ 12.88 hrs HW=898.51' TW=893.76' (Dynamic Tailwater)

↳ **5=Culvert** (Passes 7.32 cfs of 14.52 cfs potential flow)

↳ **2=Low Flow Orifice** (Orifice Controls 0.49 cfs @ 10.08 fps)

↳ **3=Stand Pipe** (Orifice Controls 6.11 cfs @ 7.77 fps)

↳ **4=Orifice/Grate** (Orifice Controls 0.72 cfs @ 0.40 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=894.00' TW=893.50' (Dynamic Tailwater)

↳ **1=Broad-Crested Rectangular Weir** ( Controls 0.00 cfs)

**Summary for Link DPA:**

Inflow Area = 2.376 ac, 0.00% Impervious, Inflow Depth = 3.56" for 100-YR event  
Inflow = 9.92 cfs @ 12.19 hrs, Volume= 0.705 af  
Primary = 9.92 cfs @ 12.19 hrs, Volume= 0.705 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPB:**

Inflow Area = 14.805 ac, 22.90% Impervious, Inflow Depth > 3.88" for 100-YR event  
Inflow = 57.82 cfs @ 12.28 hrs, Volume= 4.791 af  
Primary = 57.82 cfs @ 12.28 hrs, Volume= 4.791 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPC:**

Inflow Area = 13.024 ac, 30.10% Impervious, Inflow Depth > 3.83" for 100-YR event  
Inflow = 9.87 cfs @ 12.19 hrs, Volume= 4.162 af  
Primary = 9.87 cfs @ 12.19 hrs, Volume= 4.162 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**Summary for Link DPD:**

Inflow Area = 1.832 ac, 17.47% Impervious, Inflow Depth > 3.77" for 100-YR event  
Inflow = 5.76 cfs @ 12.18 hrs, Volume= 0.575 af  
Primary = 5.76 cfs @ 12.18 hrs, Volume= 0.575 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

**2024-02-22 Proposed Drainage**

NRCC 24-hr B 100-YR Rainfall=5.98"

Prepared by Environmental Design Partnership

Printed 2/23/2024

HydroCAD® 10.20-2g s/n 00476 © 2022 HydroCAD Software Solutions LLC

Page 98

**Summary for Link DPE:**



Inflow Area = 6.514 ac, 5.02% Impervious, Inflow Depth = 3.07" for 100-YR event  
Inflow = 20.96 cfs @ 12.23 hrs, Volume= 1.668 af  
Primary = 20.96 cfs @ 12.23 hrs, Volume= 1.668 af, Atten= 0%, Lag= 0.0 min  
Routed to nonexistent node 1L

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.02 hrs

# National Flood Hazard Layer FIRMette



73°23'10"W 42°54'24"N

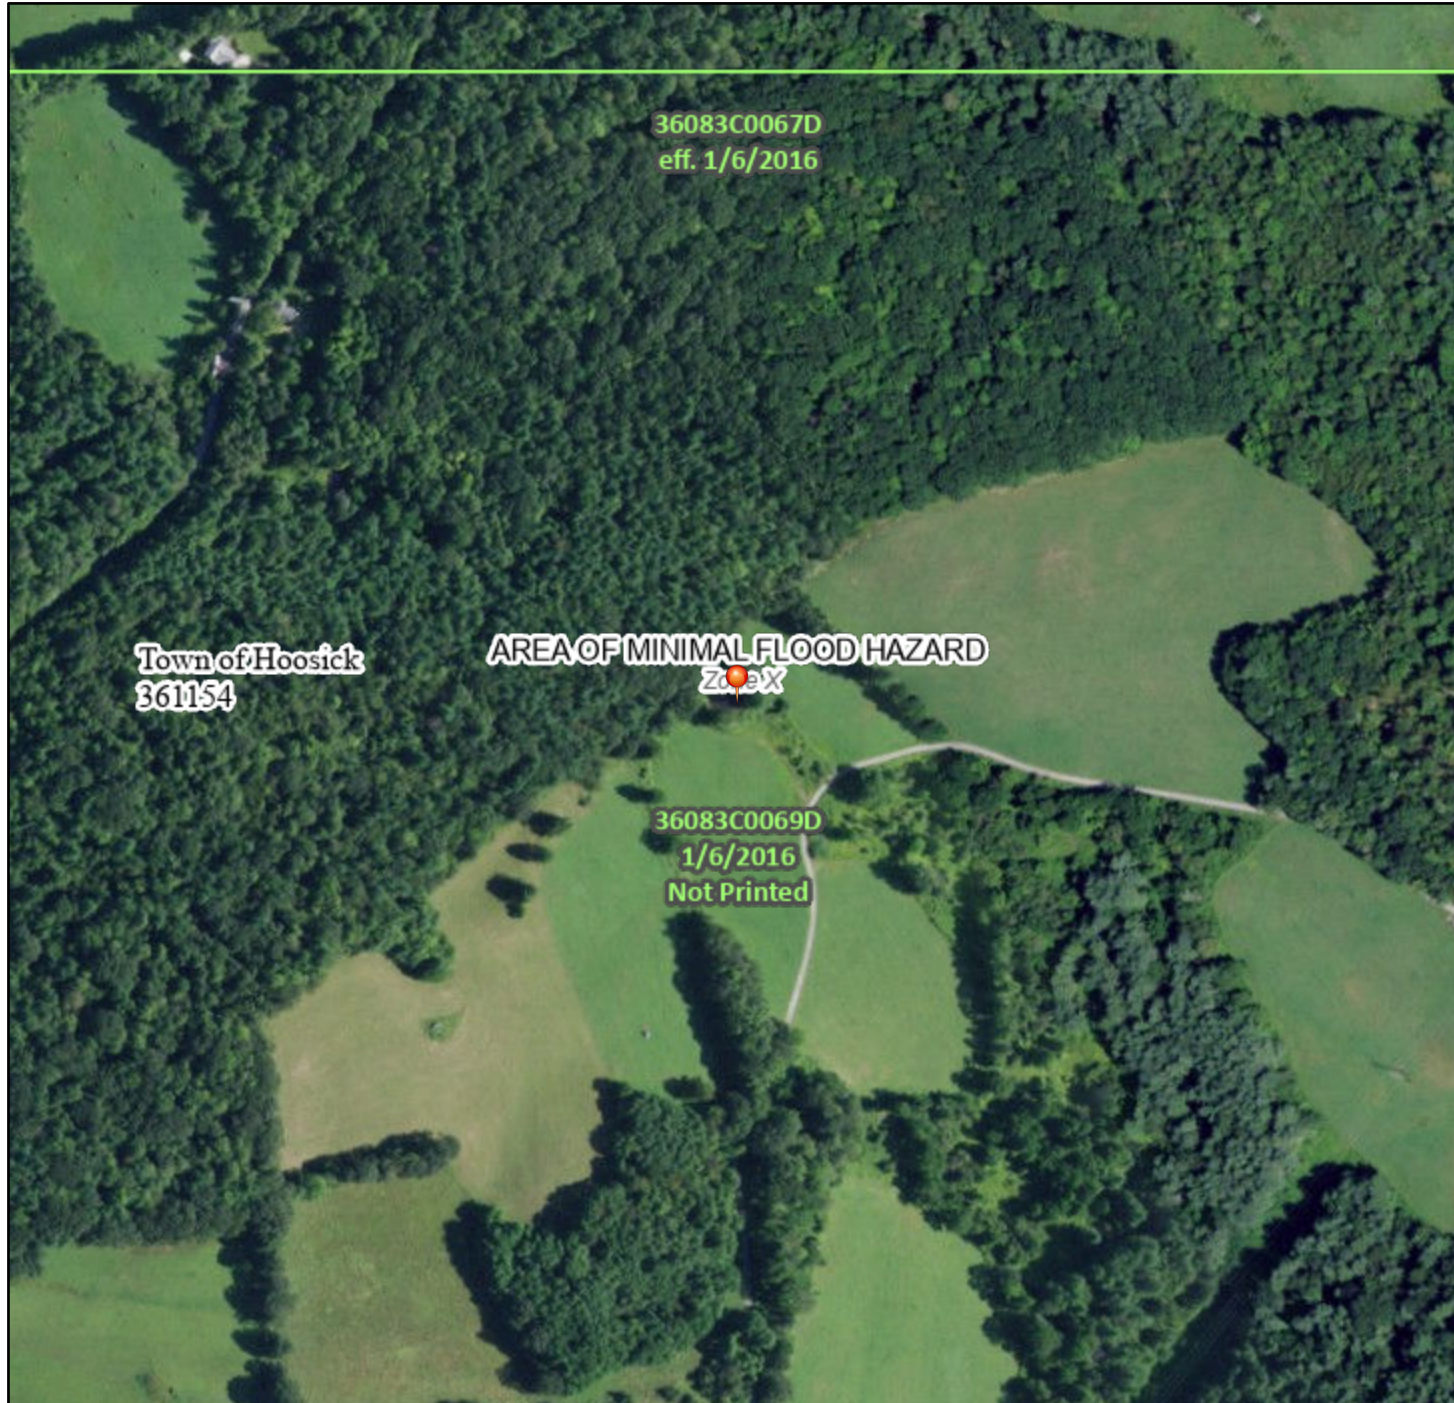

1:6,000

73°22'32"W 42°53'57"N

Basemap Imagery Source: USGS National Map 2023

## Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

- |                                    |  |  |
|------------------------------------|--|--|
| <b>SPECIAL FLOOD HAZARD AREAS</b>  |  | Without Base Flood Elevation (BFE)<br><i>Zone A, V, A99</i>  |
|                                    |  | With BFE or Depth <i>Zone AE, AO, AH, VE, AR</i>   |
|                                    |  | Regulatory Floodway  |
| <b>OTHER AREAS OF FLOOD HAZARD</b> |  | 0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile <i>Zone X</i> |
|                                    |  | Future Conditions 1% Annual Chance Flood Hazard <i>Zone X</i>  |
|                                    |  | Area with Reduced Flood Risk due to Levee. See Notes. <i>Zone X</i>  |
|                                    |  | Area with Flood Risk due to Levee <i>Zone D</i>  |
| <b>OTHER AREAS</b>                 |  | NO SCREEN Area of Minimal Flood Hazard <i>Zone X</i>   |
|                                    |  | Effective LOMRs  |
| <b>GENERAL STRUCTURES</b>          |  | Area of Undetermined Flood Hazard <i>Zone D</i>  |
|                                    |  | Channel, Culvert, or Storm Sewer   |
|                                    |  | Levee, Dike, or Floodwall  |
| <b>OTHER FEATURES</b>              |  | 20.2 Cross Sections with 1% Annual Chance  |
|                                    |  | 17.5 Water Surface Elevation   |
|                                    |  | 8 Coastal Transect   |
|                                    |  | 5.13 Base Flood Elevation Line (BFE)   |
|                                    |  | Limit of Study   |
| <b>MAP PANELS</b>                  |  | Jurisdiction Boundary  |
|                                    |  | Coastal Transect Baseline  |
|                                    |  | Profile Baseline   |
|                                    |  | Hydrographic Feature   |
|                                    |  | Digital Data Available   |
|                                    |  | No Digital Data Available  |
|                                    |  | Unmapped   |



The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on **8/24/2023 at 9:24 AM** and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.

# Environmental Resource Mapper



The coordinates of the point you clicked on are:

**UTM 18**

**Easting:** 632251.4840309622

**Northing:** 4751169.578054071

**Longitude/Latitude**

**Longitude:** -73.38004679975852

**Latitude:** 42.90168921695387

The approximate address of the point you clicked on is:

12090, Hoosick Falls, New York

**County:** Rensselaer

**Town:** Hoosick

**USGS Quad:** EAGLE BRIDGE

If your project or action is within or near an area with a rare animal, a permit may be required if the species is listed as endangered or threatened and the department determines the action may be harmful to the species or its habitat.

If your project or action is within or near an area with rare plants and/or significant natural communities, the environmental impacts may need to be addressed.

The presence of a unique geological feature or landform near a project, unto itself, does not trigger a requirement for a NYS DEC permit. Readers are advised, however, that there is the chance that a unique feature may also show in another data layer (ie. a wetland) and thus be subject to permit jurisdiction.

Please refer to the "Need a Permit?" tab for permit information or other authorizations regarding these natural resources.

**Disclaimer:** If you are considering a project or action in, or near, a wetland or a stream, a NYS DEC permit may be required. The Environmental Resources Mapper does not show all natural resources which are regulated by NYS DEC, and for which permits from NYS DEC are required. For example, Regulated Tidal Wetlands, and Wild, Scenic, and Recreational Rivers, are currently not included on the maps.



**New York State  
Parks, Recreation and  
Historic Preservation**

**KATHY HOCHUL**  
Governor

**ERIK KULLESEID**  
Commissioner

April 03, 2023

Laurel Mitchell  
900 Route 146  
Clifton Park, NY 12065

Re: NYSERDA  
Wilson Hill Solar/5 MW/19.63 Acres  
Tax parcel 26.-1-12.21/1 - Wilson Hill Rd, Town of Hoosick, Rensselaer County, NY  
23PR02744

Dear Laurel Mitchell:

Thank you for requesting the comments of the Office of Parks, Recreation and Historic Preservation (OPRHP). We have reviewed the project in accordance with the New York State Historic Preservation Act of 1980 (Section 14.09 of the New York Parks, Recreation and Historic Preservation Law). These comments are those of the OPRHP and relate only to Historic/Cultural resources. They do not include potential environmental impacts to New York State Parkland that may be involved in or near your project. Such impacts must be considered as part of the environmental review of the project pursuant to the State Environmental Quality Review Act (New York Environmental Conservation Law Article 8) and its implementing regulations (6 NYCRR Part 617).

Based upon this review, it is the opinion of OPRHP that no properties, including archaeological and/or historic resources, listed in or eligible for the New York State and National Registers of Historic Places will be impacted by this project.

If further correspondence is required regarding this project, please be sure to refer to the OPRHP Project Review (PR) number noted above.

Sincerely,

R. Daniel Mackay

Deputy Commissioner for Historic Preservation  
Division for Historic Preservation

rev: D. Bagrow



United States  
Department of  
Agriculture

**NRCS**



Natural  
Resources  
Conservation  
Service

A product of the National  
Cooperative Soil Survey,  
a joint effort of the United  
States Department of  
Agriculture and other  
Federal agencies, State  
agencies including the  
Agricultural Experiment  
Stations, and local  
participants

# Custom Soil Resource Report for **Rensselaer County, New York**




# Custom Soil Resource Report Soil Map

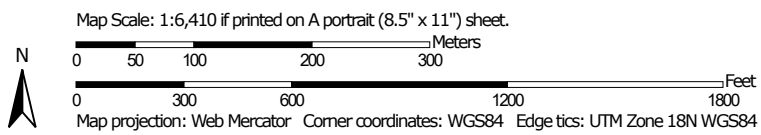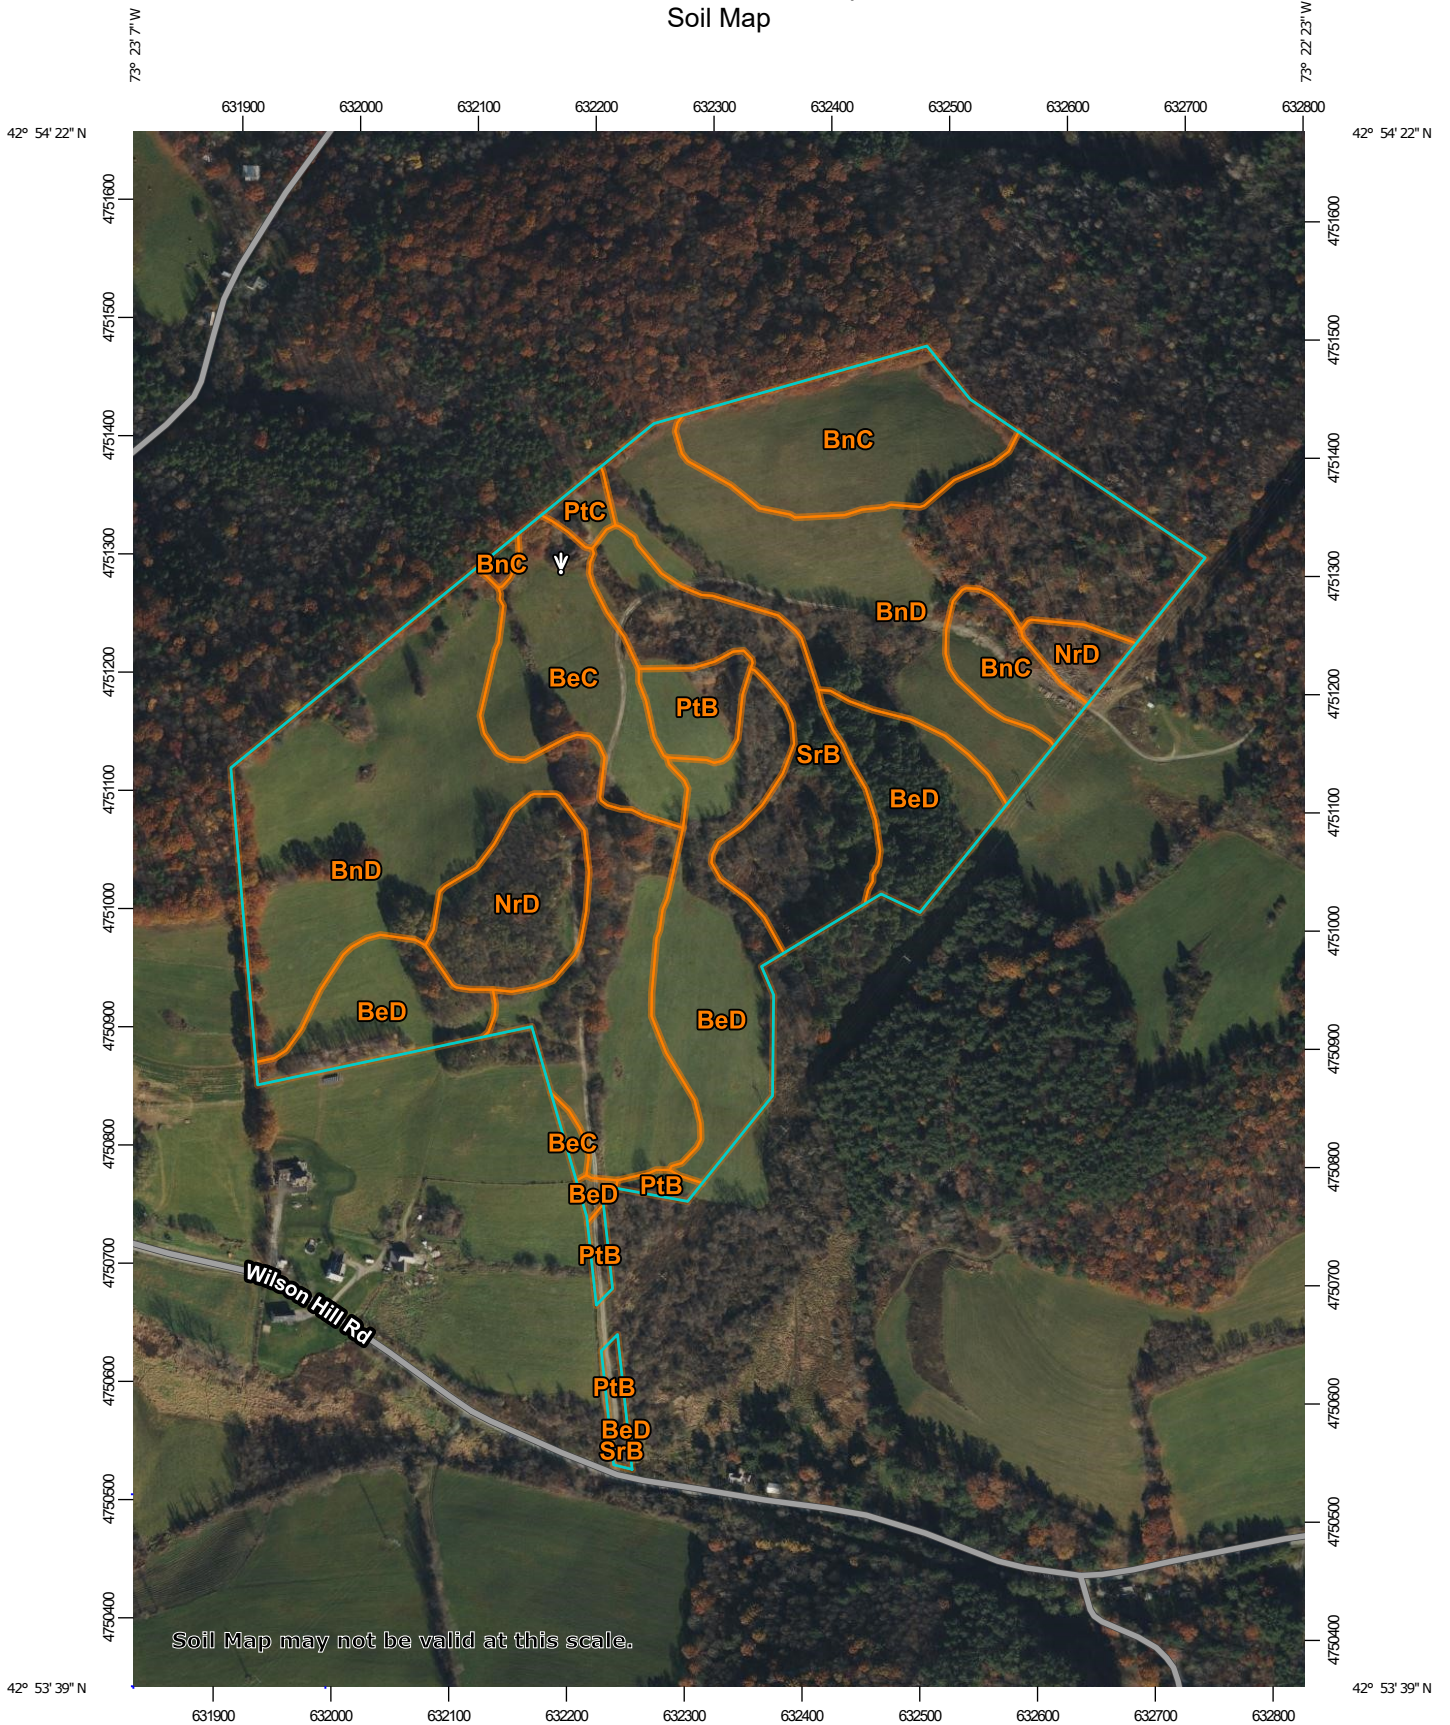



### MAP LEGEND

**Area of Interest (AOI)**

 Area of Interest (AOI)

**Soils**

 Soil Map Unit Polygons

 Soil Map Unit Lines


 Soil Map Unit Points

**Special Point Features**






-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot

-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features


**Water Features**

 Streams and Canals

**Transportation**

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

**Background**

 Aerial Photography

### MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:15,800.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Rensselaer County, New York  
 Survey Area Data: Version 19, Sep 10, 2022

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 15, 2021—Nov 8, 2021

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
BeC	Bernardston gravelly silt loam, 8 to 15 percent slopes	5.9	7.3%
BeD	Bernardston gravelly silt loam, 15 to 25 percent slopes	14.0	17.2%
BnC	Bernardston-Nassau complex, rolling	8.8	10.7%
BnD	Bernardston-Nassau complex, hilly	37.7	46.2%
NrD	Nassau-Rock outcrop complex, hilly	4.9	6.0%
PtB	Pittstown gravelly silt loam, 3 to 8 percent slopes	2.4	3.0%
PtC	Pittstown gravelly silt loam, 8 to 15 percent slopes	0.5	0.7%
SrB	Scriba silt loam, 3 to 8 percent slopes	7.3	9.0%
<b>Totals for Area of Interest</b>		<b>81.5</b>	<b>100.0%</b>

## Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas

## Custom Soil Resource Report

are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.



## United States Department of the Interior



FISH AND WILDLIFE SERVICE  
New York Ecological Services Field Office  
3817 Luker Road  
Cortland, NY 13045-9385  
Phone: (607) 753-9334 Fax: (607) 753-9699  
Email Address: [fw5es\\_nyfo@fws.gov](mailto:fw5es_nyfo@fws.gov)

In Reply Refer To:  
Project Code: 2023-0047131  
Project Name: Wilson Hill

February 20, 2023

Subject: List of threatened and endangered species that may occur in your proposed project location or may be affected by your proposed project

### To Whom It May Concern:

The enclosed species list identifies threatened, endangered, proposed and candidate species, as well as proposed and final designated critical habitat, that may occur within the boundary of your proposed project and/or may be affected by your proposed project. The species list fulfills the requirements of the U.S. Fish and Wildlife Service (Service) under section 7(c) of the Endangered Species Act (Act) of 1973, as amended (16 U.S.C. 1531 *et seq.*).

New information based on updated surveys, changes in the abundance and distribution of species, changed habitat conditions, or other factors could change this list. Please feel free to contact us if you need more current information or assistance regarding the potential impacts to federally proposed, listed, and candidate species and federally designated and proposed critical habitat. Please note that under 50 CFR 402.12(e) of the regulations implementing section 7 of the Act, the accuracy of this species list should be verified after 90 days. This verification can be completed formally or informally as desired. The Service recommends that verification be completed by visiting the ECOS-IPaC website at regular intervals during project planning and implementation for updates to species lists and information. An updated list may be requested through the ECOS-IPaC system by completing the same process used to receive the enclosed list.

The purpose of the Act is to provide a means whereby threatened and endangered species and the ecosystems upon which they depend may be conserved. Under sections 7(a)(1) and 7(a)(2) of the Act and its implementing regulations (50 CFR 402 *et seq.*), Federal agencies are required to utilize their authorities to carry out programs for the conservation of threatened and endangered species and to determine whether projects may affect threatened and endangered species and/or designated critical habitat.

A Biological Assessment is required for construction projects (or other undertakings having similar physical impacts) that are major Federal actions significantly affecting the quality of the human environment as defined in the National Environmental Policy Act (42 U.S.C. 4332(2)

(c)). For projects other than major construction activities, the Service suggests that a biological evaluation similar to a Biological Assessment be prepared to determine whether the project may affect listed or proposed species and/or designated or proposed critical habitat. Recommended contents of a Biological Assessment are described at 50 CFR 402.12.

If a Federal agency determines, based on the Biological Assessment or biological evaluation, that listed species and/or designated critical habitat may be affected by the proposed project, the agency is required to consult with the Service pursuant to 50 CFR 402. In addition, the Service recommends that candidate species, proposed species and proposed critical habitat be addressed within the consultation. More information on the regulations and procedures for section 7 consultation, including the role of permit or license applicants, can be found in the "Endangered Species Consultation Handbook" at:

<http://www.fws.gov/endangered/esa-library/pdf/TOC-GLOS.PDF>

**Migratory Birds:** In addition to responsibilities to protect threatened and endangered species under the Endangered Species Act (ESA), there are additional responsibilities under the Migratory Bird Treaty Act (MBTA) and the Bald and Golden Eagle Protection Act (BGEPA) to protect native birds from project-related impacts. Any activity, intentional or unintentional, resulting in take of migratory birds, including eagles, is prohibited unless otherwise permitted by the U.S. Fish and Wildlife Service (50 C.F.R. Sec. 10.12 and 16 U.S.C. Sec. 668(a)). For more information regarding these Acts see <https://www.fws.gov/birds/policies-and-regulations.php>.

The MBTA has no provision for allowing take of migratory birds that may be unintentionally killed or injured by otherwise lawful activities. It is the responsibility of the project proponent to comply with these Acts by identifying potential impacts to migratory birds and eagles within applicable NEPA documents (when there is a federal nexus) or a Bird/Eagle Conservation Plan (when there is no federal nexus). Proponents should implement conservation measures to avoid or minimize the production of project-related stressors or minimize the exposure of birds and their resources to the project-related stressors. For more information on avian stressors and recommended conservation measures see <https://www.fws.gov/birds/bird-enthusiasts/threats-to-birds.php>.

In addition to MBTA and BGEPA, Executive Order 13186: *Responsibilities of Federal Agencies to Protect Migratory Birds*, obligates all Federal agencies that engage in or authorize activities that might affect migratory birds, to minimize those effects and encourage conservation measures that will improve bird populations. Executive Order 13186 provides for the protection of both migratory birds and migratory bird habitat. For information regarding the implementation of Executive Order 13186, please visit <https://www.fws.gov/birds/policies-and-regulations/executive-orders/e0-13186.php>.

We appreciate your concern for threatened and endangered species. The Service encourages Federal agencies to include conservation of threatened and endangered species into their project planning to further the purposes of the Act. **Please include the Consultation Code in the header of this letter with any request for consultation or correspondence about your project that you submit to our office.**

---

Attachment(s):

- Official Species List

## **OFFICIAL SPECIES LIST**

This list is provided pursuant to Section 7 of the Endangered Species Act, and fulfills the requirement for Federal agencies to "request of the Secretary of the Interior information whether any species which is listed or proposed to be listed may be present in the area of a proposed action".

This species list is provided by:

**New York Ecological Services Field Office**

3817 Luker Road

Cortland, NY 13045-9385

(607) 753-9334

---

## PROJECT SUMMARY

Project Code: 2023-0047131  
Project Name: Wilson Hill  
Project Type: Power Gen - Solar  
Project Description: power gen  
Project Location:

The approximate location of the project can be viewed in Google Maps: <https://www.google.com/maps/@42.90083575,-73.38041766015009,14z>



Counties: Rensselaer County, New York

---



## ENDANGERED SPECIES ACT SPECIES

There is a total of 1 threatened, endangered, or candidate species on this species list.

Species on this list should be considered in an effects analysis for your project and could include species that exist in another geographic area. For example, certain fish may appear on the species list because a project could affect downstream species.

IPaC does not display listed species or critical habitats under the sole jurisdiction of NOAA Fisheries<sup>1</sup>, as USFWS does not have the authority to speak on behalf of NOAA and the Department of Commerce.

See the "Critical habitats" section below for those critical habitats that lie wholly or partially within your project area under this office's jurisdiction. Please contact the designated FWS office if you have questions.

- 
1. [NOAA Fisheries](#), also known as the National Marine Fisheries Service (NMFS), is an office of the National Oceanic and Atmospheric Administration within the Department of Commerce.

## INSECTS

NAME	STATUS
Monarch Butterfly <i>Danaus plexippus</i> No critical habitat has been designated for this species. Species profile: <a href="https://ecos.fws.gov/ecp/species/9743">https://ecos.fws.gov/ecp/species/9743</a>	Candidate

## CRITICAL HABITATS

THERE ARE NO CRITICAL HABITATS WITHIN YOUR PROJECT AREA UNDER THIS OFFICE'S JURISDICTION.

---

## **IPAC USER CONTACT INFORMATION**

Agency: Environmental Design Partnership

Name: Laurel Mitchell

Address: 900 Route 146

City: Clifton Park

State: NY

Zip: 12065

Email: laurel@laurelmitchell.com

Phone: 5183477141

---



### Notice Criteria Tool

[Notice Criteria Tool - Desk Reference Guide V\\_2018.2.0](#)

The requirements for filing with the Federal Aviation Administration for proposed structures vary based on a number of factors: height, proximity to an airport, location, and frequencies emitted from the structure, etc. For more details, please reference [CFR Title 14 Part 77.9](#).

You must file with the FAA at least 45 days prior to construction if:

- your structure will exceed 200ft above ground level
- your structure will be in proximity to an airport and will exceed the slope ratio
- your structure involves construction of a traverseway (i.e. highway, railroad, waterway etc...) and once adjusted upward with the appropriate vertical distance would exceed a standard of 77.9(a) or (b)
- your structure will emit frequencies, and does not meet the conditions of the [FAA Co-location Policy](#)
- your structure will be in an instrument approach area and might exceed part 77 Subpart C
- your proposed structure will be in proximity to a navigation facility and may impact the assurance of navigation signal reception
- your structure will be on an airport or heliport
- filing has been requested by the FAA


If you require additional information regarding the filing requirements for your structure, please identify and contact the appropriate FAA representative using the [Air Traffic Areas of Responsibility map](#) for Off Airport construction, or contact the [FAA Airports Region / District Office](#) for On Airport construction.

The tool below will assist in applying Part 77 Notice Criteria.

<b>* Structure Type:</b>	SOLAR   Solar Panel <span style="float:right">▼</span>			
	Please select structure type and complete location point information.			
<b>Latitude:</b>	42 <input type="text"/> Deg	54 <input type="text"/> M	02.85 <input type="text"/> S	N <input type="text"/> ▼
<b>Longitude:</b>	73 <input type="text"/> Deg	22 <input type="text"/> M	55.76 <input type="text"/> S	W <input type="text"/> ▼
<b>Horizontal Datum:</b>	NAD83 ▼			
<b>Site Elevation (SE):</b>	988 <input type="text"/> (nearest foot)			
<b>Structure Height :</b>	20 <input type="text"/> (nearest foot)			
<b>Is structure on airport:</b>	<input checked="" type="radio"/> No <input type="radio"/> Yes			

### Results

You do not exceed Notice Criteria.

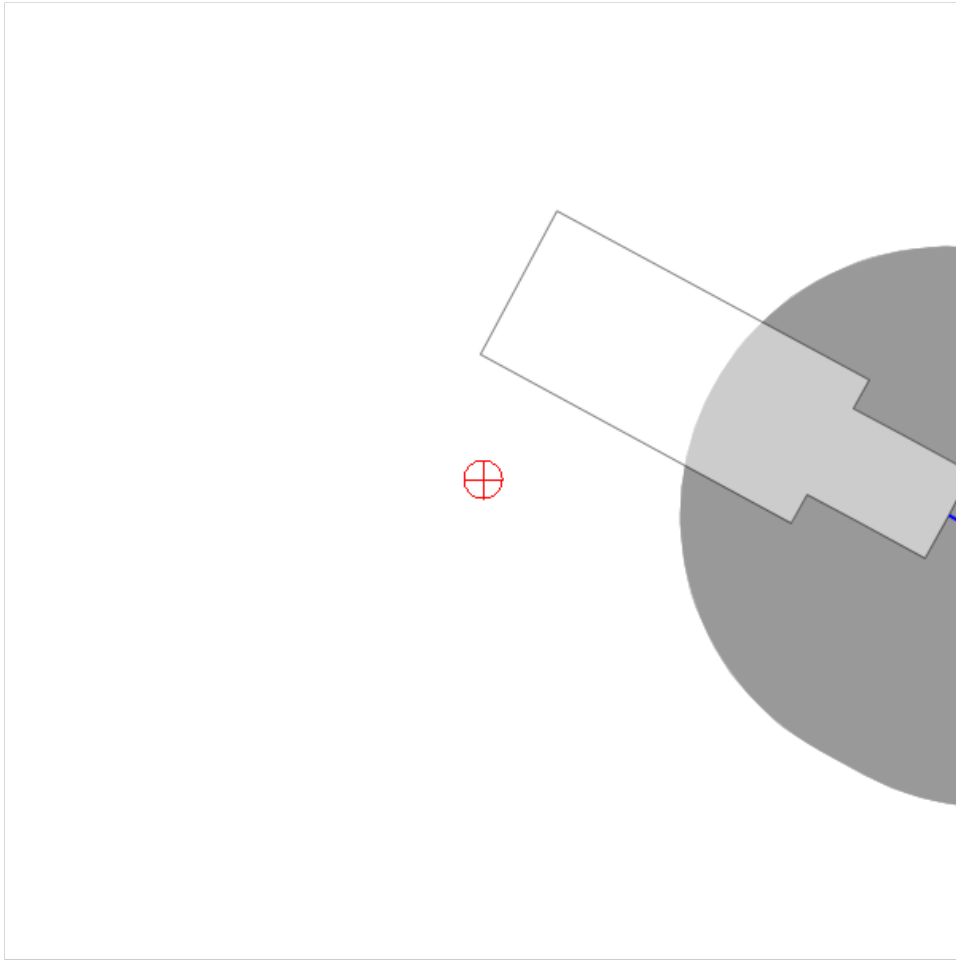

**SECTION 7**  
**Completed Inspection Reports**